LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE INSTALLATION

No. 94380112401

Issued 03/10/94
Expires 09/10/94
Revenue Code 18754

Establishment
KIM STOKES
T9N R7E SEC 13
HIDDEN VALLEY ACRES BLK 1 LOT 4

FEES: $150.00

TOTAL $150.00

Permittee
KIM STOKES
3335 Q ST
LINCOLN NE 68503

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

Jerry Hood 441-8029

RECEIVED MAR 0 9 1994

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: ~~471-7800~~ 441-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: 3/8/94

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 13 ;
   Block 1 : Lot 4 : Addition Hidden Valley Acres First addition
   Street Address 6500 ROCKY RIDGE RD.

2. Property Use: Residential ☑ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☑
   CHANGE ~~Lagoon~~

4. Distance to public sewer: miles ~~ft.~~

Kmi Stokes
Signature of Applicant (Owner or Lessee)

3335 D, Lincoln, NE 68503
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 3/9/94 . Date Frwd. 3/11/94 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 3/11/94 . Date Frwd. 3/11/94 . ACTION: Approved ☒ Disapproved ☐ Signature: Gary Lyon

3. City or County Engineer: Date Rec'd. 3-11-94 . Date Frwd. 3-11-94 . ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL _____

Sewer, tank & distribution Dept.

Site Visits:
Date: 10/27/95 by: J.C.H.
Date: 11/6/95 by: J.C.H.
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 11/6/95 By: Jerrold C. Hood

GENERAL NOTARY-State of Nebraska
DARLENE M. OLTMANS
My Comm. Exp. Jan. 6, 1999

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

COPY

FORM 23-43

County of Lancaster
State of Nebraska.
Jerrold C. Hood is an employee of Lincoln-Lancaster Co. Health Dept. This is a true copy of original.

Certified true copy.
Jerrold C. Hood R.E.H.S.
4/18/96

Darlene M Oltmans
Notary Public

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township _____; Range _____; Section & ¼ Section _____.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☒ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: _____ to _____. Weather: Precip. _____ Temp. _____.

Block 1 Lot 4
Hidden Vally Estates
6500 Rocky Ridge Rd.

OWNER: Mike Stoltes
Address: _____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	24"	8/1	10:00	8/2	10:00	8/2	12:00	6"	12:30	6	30	1 3/4	
2	28"	"	"	"	"	"	"	"	"	"	"	1 ½	
3	28"	"	"	"	"	"	"	"	"	"	"	1 ¼	
4	30"	"	"	"	"	"	"	"	"	"	"	3/4	
5	32"	"	"	"	"	"	"	"	"	"	"	3/4	
6	22"	"	"	"	"	"	"	"	"	"	"	1	

Sum of Percolation Rates: 6.17
Average of Rates: _____
Mean of Rates: _____

John Stuhmer
Signature of Person Conducting Test

Address 9811 N.W. 40th Phone 437-6023

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Sharpsburg
Date: _____

Approved Percolation Rate (a)
A. ~~25~~ 26 min./inch
B. _____ min./inch
C. _____ min./inch

_____
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material class 160 plastic; Diameter 4 in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank 42' ft.
4. Number of clean-outs 1.
5. Distances to:
Well or Suction Line NA ft.;
Stream NA ft.; Pressure Line 100 plus ft.; Property Line _____ ft.


B. SEPTIC TANK:
1. Material concrete; No. of compartments _____.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☑ No ☐
(Company _____)
4. Manholes: Over Inlet; diam. no in.
Over Outlet; diam. no in.
Riser Above ☑ Below ☐ Grade ____ in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☑; or Tee ☐
7. Depth of top of tank below finished grade 6" in.
8. Distances to:
Well or Suction Line NA ft.;
Stream NA ft.; Pressure Line 100 plus ft.; Property Line 100' ft.

C. DISTRIBUTION BOX:
1. Material concrete; Number - available outlets _____.
2. Factory Built: Yes ☑ No ☐
(Company _____)
3. Distance from Septic Tank 6' ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☑
Diameter of Half Round 15" or
Perforated Pipe 4".
Material: fiberglass ☐; plastic ☑; concrete ☐; other _____.
2. Lateral Lines:
Number 2; Length of each line 100, 100, _____, _____, _____ ft.;
Total length of laterals 200 ft.;
Distance between lateral lines 9 ft.
3. Trench dimensions: Width 4½-5 ft.;
Slope 3" in/100 ft.; Average Depth 22 in.
4. Filter Material: Gravel
Depth of Material 18" in.
5. Distances to:
Well or Suction Line NA ft.;
Stream NA ft.; Pressure Line 100 plus ft.; Property Line 100 plus ft.

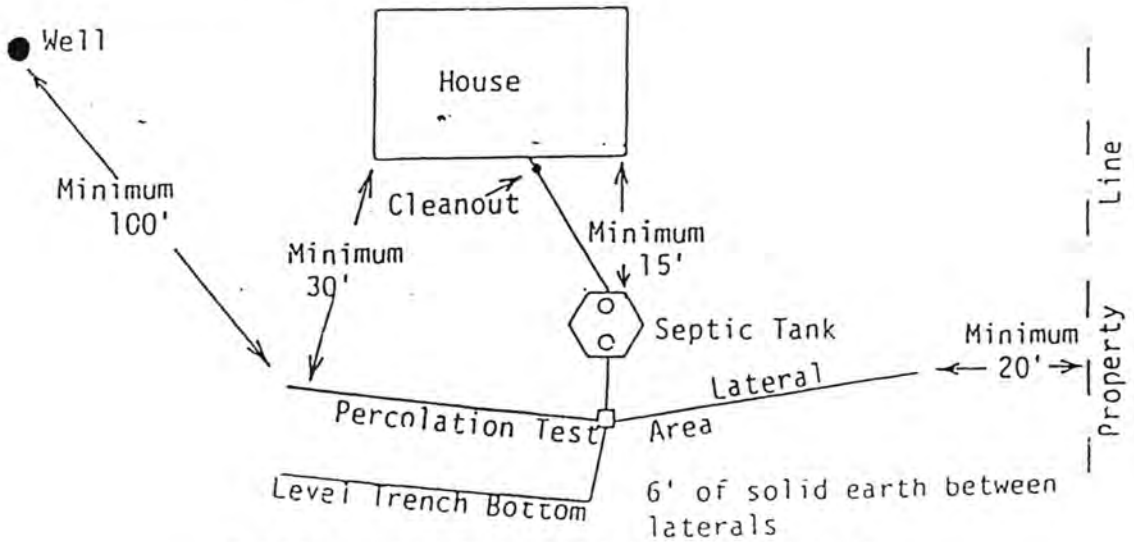

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

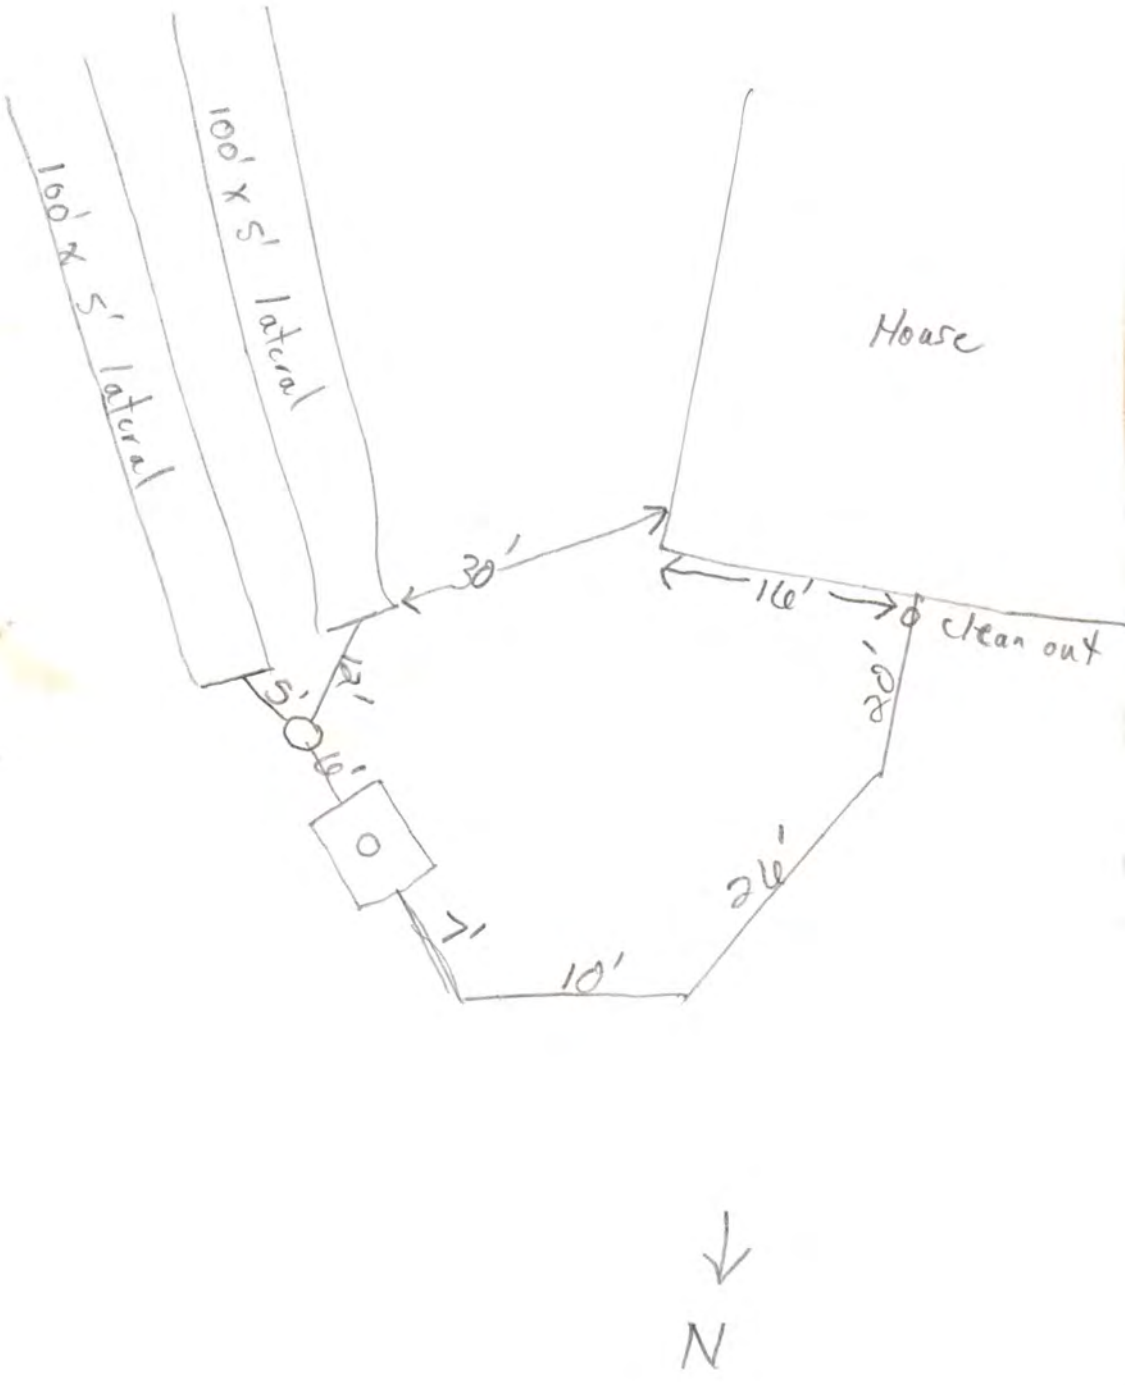
100' x 5' lateral
100' x 5' lateral
House
30'
16'
clean out
20'
5'
12'
6'
24'
7'
10'
N