CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 940

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

April 18, 1977
THIS LICENSE OR PERMIT EXPIRES

Dennis R. Schworer
LICENSEE OR PERMITTEE

3940 North 15 St., Lincoln, NE 68521
ADDRESS

T9N, R7E, Sec. 16, Lot 3 I.T.
NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION
ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
42355 [illegible]	[illegible]	30.00 -

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION
HEALTH

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 940

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-11-76

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9 North Range 7 E ; Section 16
Block ____; Lot 3 I.T. ; Addition ____
Street Address 5614 S PINE LAKE ROAD

2. Property Use: Residential ____ ☑ ; Commercial ____ ☐
No. of Bedrooms 3 . Describe: ____
Other Use ____ ☐
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☑ ; Other ☐

4. Distance to public sewer: 1-MILE ft.

Dennis R Schwoer
Signature of Applicant (Owner or Lessee)

3940 N 15
Address
LINCOLN NE
68521

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 10/18/76 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 10/18/76 . Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 10-18-76 . ACTION: Approved ☐ Disapproved ☒
Date Frwd. 10-18-76 . Signature: g Williamson

3. City ~~or County~~ Engineer: Date Rec'd. 10-18-76 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 10-18-76 . Signature: [signature]

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]

County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 940

DATE: 10-18-76

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9 North ; Range 7E ; Section 16 ; Block ; Lot 3 I.L. ; Addition .
   Street Address .

2. Property Use: Residential [ ]; Commercial [ ]
   No. of Bedrooms 3
   Describe:
   Other Use
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [✓]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Dennis R Schwarz
Signature of Applicant (owner or lessee)

3940 N-15
Address
LINCOLN NE 68524

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
   Filing Fee: $ 30.00

2. Site Visits:
   Date: 5-2-77 by: jw
   Date: by:
   Date: by:

3. Date: Approved [X]; Disapproved [ ] 10/18/76
   by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: 5-2-77 by: James Weverka

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. 940

PROPERTY WHERE SOIL TESTED:

Owner: Dennis Schwerer

Location: Township 9N ; Range 7E
Section & ¼ Sect. 16 Lot 1 T 50.½SW¼ Address 3940 No 15th 432-7866 Home 432-4451 work
Property Dimensions: 649 ft. x 400 ft.
Area: 5.96 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: Oct 15 to Oct 16. Weather: Precip. ____ Temp. ____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	30"	10/15	10:AM	10/16	10:AM	10/16	11:30	10"	12:00	6	30	4	7.50
2	"	"	"	"	"	"	11:40	"	12:10	3½	"	6½	4.61
3	"	"	"	"	"	"	11:50	"	12:20	2	"	8	3.75
4	"	"	"	"	"	"	12:00	"	12:30	4	"	6	5.00
5	"	"	"	"	"	"	12:10	"	12:40	4½	"	5½	5.45
6	"	"	"	"	"	"	12:20	"	12:50	4	"	6	5.00

Sum of Percolation Rates 31.31
Average of Rates: 5.22
Mean of Rates: ____

John Struhmyer
Signature of Person Conducting Test

Address 401 Teakwood Dr.
Phone: 489-2510

(Do not write below this line)

REVIEWING ACTION

REMARKS: ____


Approved Percolation Rate(s)
A. ____ min./inch
B. ____ min./inch
C. ____ min./inch

DATE: October 18, 1976

Jerrold C. Hood
Signature of Reviewing Official

1" = 100 Ft.

N

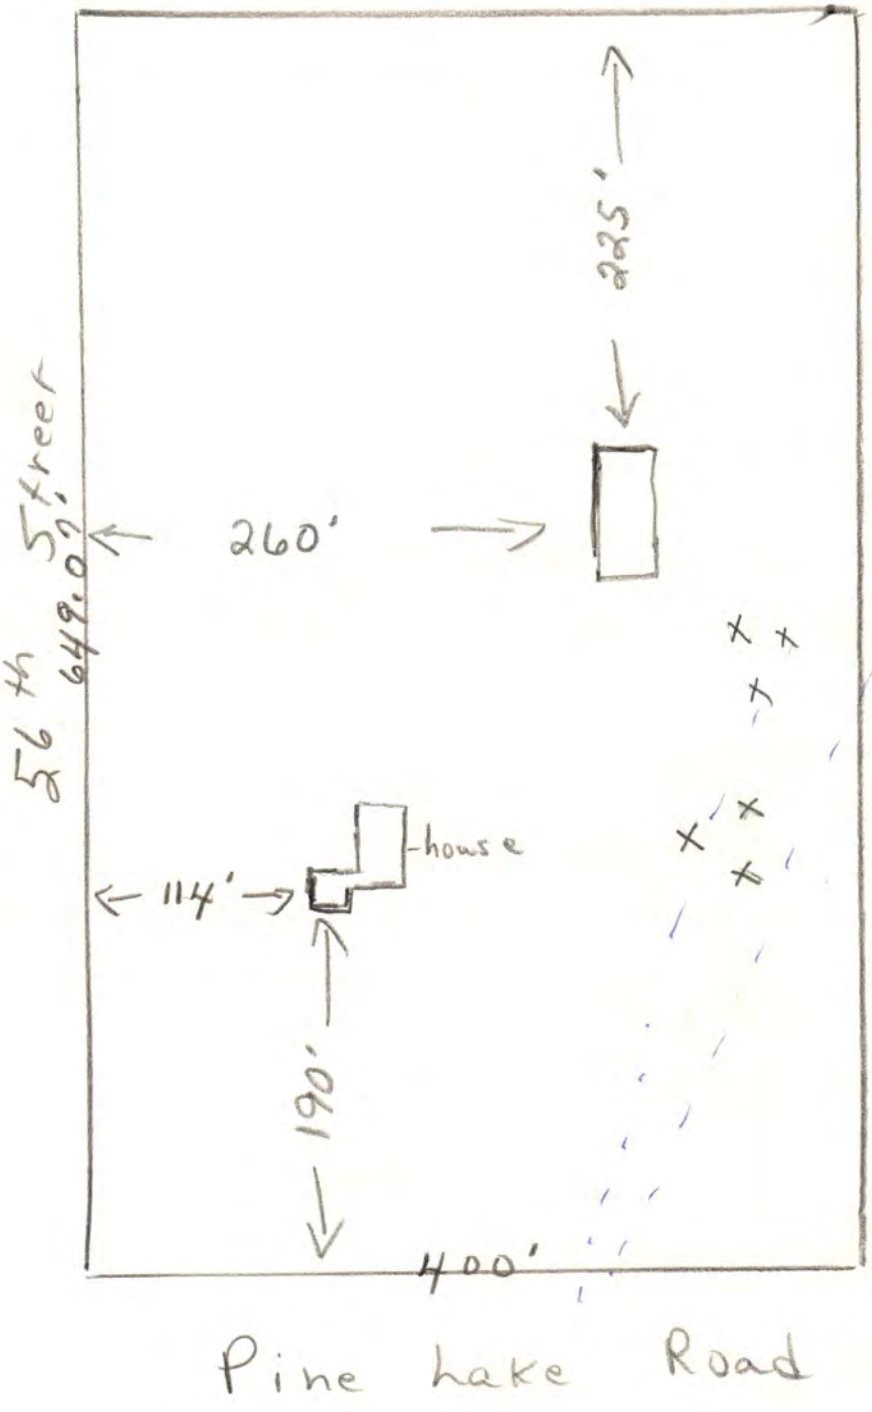

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)
474-1541

FILE NO. 940

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PVC; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 40 ft.
4. Number of clean-outs NONE
5. Distances To:
Well or Suction Line 150 ft.; Stream ___ ft.; Pressure Line 100 ft.; Property Line 50 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material CONCRETE; No. of compartments 1000
2. Capacity 1000 gals.; Liquid depth 49 in.
3. Factory Built: Yes ☑ (Company PRE CAST)
No ☐
4. Manholes: Over Inlet; diam. 6 in.
Over Outlet; diam. 6 in.
Below Grade 12 in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☑; or Tee ☐
Depth of outlet below inlet 2 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
Well or Suction Line 150 ft.; Stream ___ ft.; Pressure Line ___ ft.; Property Line ___ ft.

C. DISTRIBUTION BOX CONCRETE
1. Material CONCRETE; No. available outlets 5.
2. Factory Built: Yes ☑, (Company PRE CAST) No ☐
3. Dimension: Length 24 in.; Width 12 in. Depth 12 in.
4. Distance from Septic Tank 4 ft.
5. Serial Distribution: Yes ☐, No ☐ (If yes, show detailed plans.)


D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF ROUND
2. Lateral Lines: Depth below grade ___ in. Number ___; Length of each line ___ ft Total length of Laterals 100 ft.; Slope 0 in/100 ft. Diameter of pipe 24 in.; Shape HALF ROUND Material: concrete ☑; fiber asbestos ☐; clay ☐; other ___ Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth ___ in.; Width 48 in.
4. Filter Material: GRAVEL. Depth of material from trench bottom 24 in.
5. Distances To:
Well or Suction Line 150 ft.; Stream ___ ft.; Pressure Line ___ ft. Property Line ___ ft.
6. Percolation Rate: _____ minutes/inch

TYPICAL SKETCHES

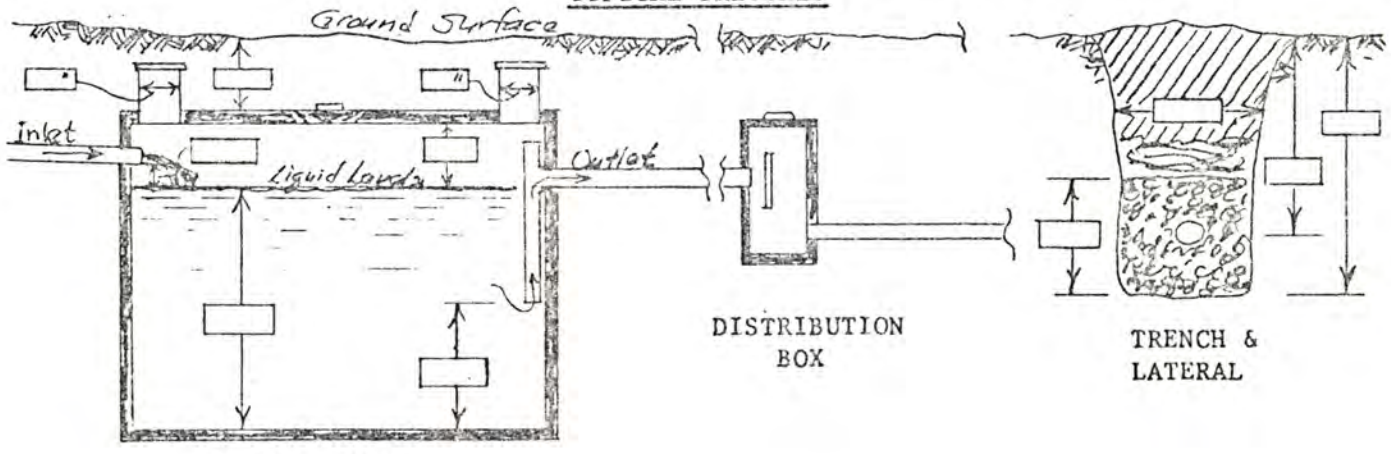

Signature of Applicant

W

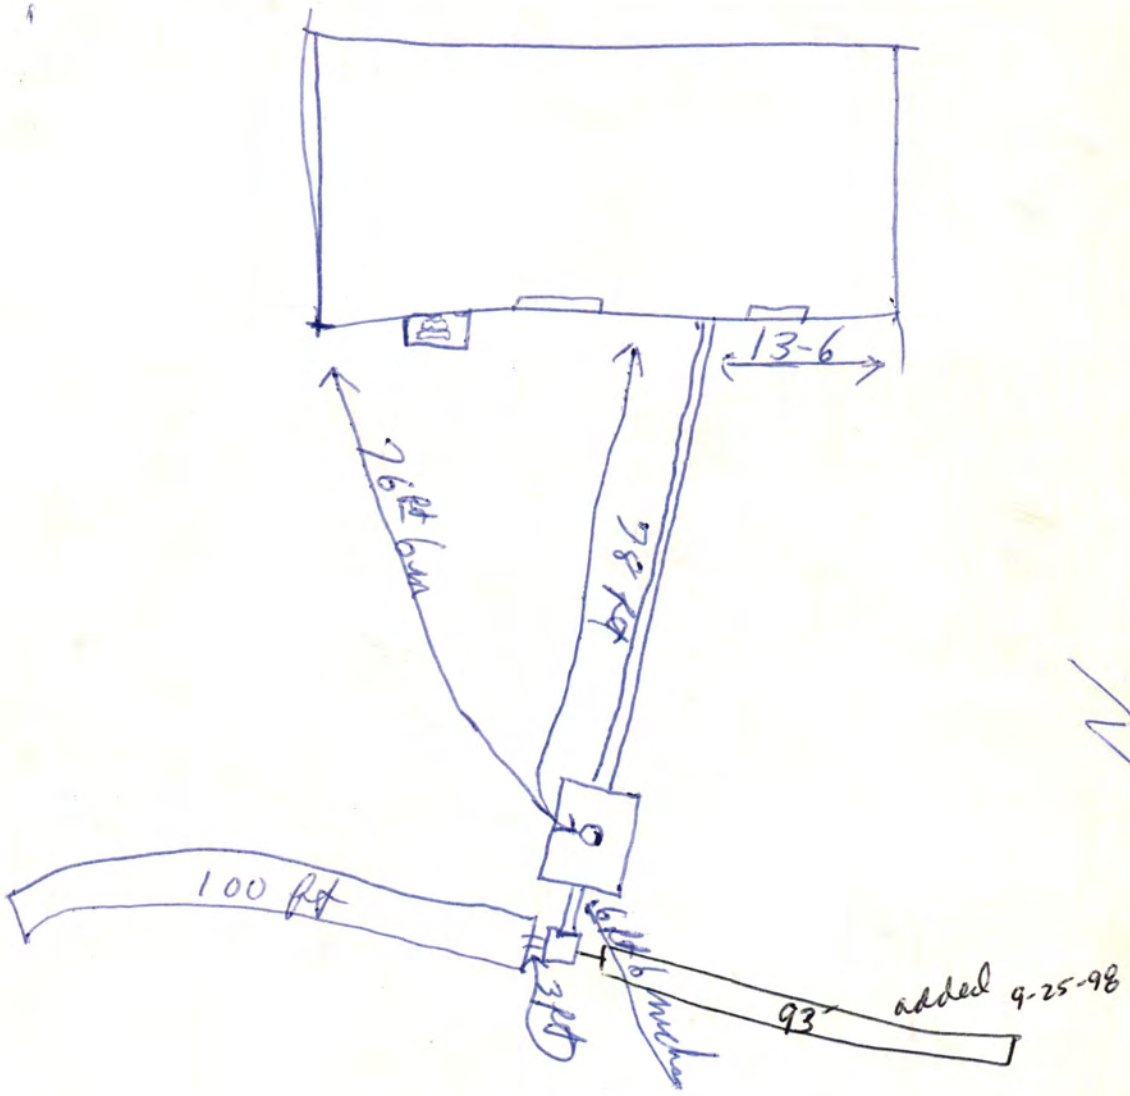

S

N

5-2-77

Casement

Clyde D. Verhoff

E

013

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

[X] Evaluation of the Individual Water System Date: 9/27/91

[X] Evaluation of the Sewage Disposal System [X] Enclosed is $150.00

Legal Description of Property: TWP. 9 N ; RANGE 7E6pm; SECTION 16 ; BLOCK -

LOT 148; ADDITION - ; Street Address 5600 Pine Lake Road Lincoln NE

Directions to Property Northeast corner of 56th and Pinelake Rd.

Location of Well West of Home by Cedar Trees Tap Location: Inside [X] Outside [X]

Location of Sewage System Halfway between House and Morton Year Installed 1977

	NAME	ADDRESS	PHONE
Present Owner:	Richard & Sherian Dinges	5600 Pine Lake Rd	423-7352
Tenant/Buyer:	Roger & Jane Berg	8110 Mrytle	489-1296
Return to:	JANICE Ann Deck Century Realty	2855 So 70th Lincoln 68506	483-2951

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Jane Berg Address 8110 Mrytle

==========

HEALTH DEPARTMENT USE ONLY

Date Received OCTOBER 3, 1991 Received $150.00 Check [X] Cash [ ]

PRELIMINARY STATUS--DATE 10/7/91

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	[X]	[ ]	Approved:	[X]	Date 10/7/91 by J.C.H.
Bacteria	[X]	[ ]	Provisional:	[ ]	Date _____ by ____
Nitrate	[X]	[ ]	Disapproved:	[ ]	Date _____ by ____

Comments: IF THE SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY IT SHOULD BE CHECKED TO SEE IF IS NEEDED. SEWAGE SYSTEM IS NOW 14 YEARS OLD. See Attached Letter [ ]

FINAL STATUS

	WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
	Approved: [X]	Approved: [X]	Provisional Approval: [ ]

APPROVED BY Jerrold C. Hood R.S. DATE OCTOBER 14, 1991

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

10:50A.M.