FILE NO. 326

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

November 14, 1973
THIS LICENSE OR PERMIT EXPIRES

Gordon W. Anderson — 1912 Kings Highway
LICENSEE OR PERMITTEE — ADDRESS

T9N; R7E; Sec. NW 1/4 of Sec. 16; Bl. 1; Lot 1; Frontier Acres
NAME OF ESTABLISHMENT, IF ANY — ADDRESS

LEGAL DESCRIPTION

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-10.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. _____

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N; Range 7E; Section NW¼ 16;
Block 1; Lot 1; Addition ~~Frontiegaes~~;
Street Address 6200 Old Cheney Rd

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms _____ Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Gordon W. Andersen
Signature of Applicant (owner or lessee)

3111 O
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance 6-8-73

3. Site Visits:
Date: 6-8-73 by: jw
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 5/11/73
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 6-8-73 by: James Wevelsa

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 326

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 7E; Section NW¼ 16;
Block 1; Lot 1; Addition Fourteen Acres
Street Address 6200 Oldchevy Rd.

2. Property Use: Residential AA ☒; Commercial ☐
No. of Bedrooms 3. Describe:

Other Use ☐
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: ft.

Signature of Applicant (owner or lessee)

Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 5/11/73. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5/14/73. Signature: Jerrold C. Todd

2. Supt. Bldg. Insp.: Date Rec'd. 5-14-73. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5-14-73. Signature: Chas. Sealby Supt. Bldgs. & Grounds

3. City Engineer: Date Rec'd. 5/14/73. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5/14/73. Signature: Rex Amen

REMARKS OR REASONS FOR DISAPPROVAL

FINAL ACTION ON SITE CLEARANCE: Approved ☒ Disapproved ☐

Date Applicant Notified: Signature

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Location: Township 9N R7E
Section & ¼ Sect. NW¼16
Property Dimensions: 318 ft. x 410 ft.
Area: 3 acres. (Attach sketch of property showing hole location).

Owner: Gordon Anderson
Address 1912 Kings Hwy

Soil Type: Silty Clay ☐; Silty Clay Loam ■; Sandy Loam ☐
Crete-Sharpsburg
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: MAY 10 1973 to 11 MAY 1973. Weather: Precip. NONE Temp. 70°

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	27"	5/10	10⁰⁰ AM	5/11	9AM	5/11	9AM	5 1/16	9³¹	5 10/16	31	9/16	
2	27"	5/10	10⁰⁵	5/11	9AM	5/11	9AM	6 8/16	9³²	3 4/16	32	1 3/4	
3	27"	5/10	10¹⁰	5/11	9AM	5/11	9AM	8 3/16	9³⁴	9 13/16	34	1 5/8	
4	27"	5/10	10¹⁵	5/11	9AM	5/11	9AM	7 5/16	9³⁴	7 14/16	34	9/16	
5	27"	5/10	10²⁰	5/11	9AM	5/11	9AM	6"	9³¹	7 8/16	31	1 1/2	
6	27"	5/10	10²⁵ AM	5/11	9AM	5/11	9AM	7 8/16	9³¹	9 2/16	31	1 5/8	

Sum of Percolation Rates
Average of Rates:
Mean of Rates:

KB Smith
Signature of Person Conducting Test

Address 6500 Pioneers Blvd
Phone: 489-8874

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 24 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: May 11, 1973

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. _____

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material plastic; Diameter 4 in.
2. Distance above basement floor ___in.; or below basement floor ___in.
3. Distance between dwelling and septic tank 108 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Fiberglass; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ___in.
3. Factory Built: Yes ☑ (Company Fiberglass
No ☐
4. Manholes: ✓ Over Inlet; diam. ___in.
Over Outlet; diam. ___in.
Below Grade ___in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade 20 in.
8. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.


C. DISTRIBUTION BOX
1. Material Concrete; No. available outlets 6.
2. Factory Built: Yes ☑, (Company Pre Cast No ☐
3. Dimension: Length ___in.; Width ___in. Depth ___in.
4. Distance from Septic Tank 8 ft.
5. Serial Distribution: Yes ☑, No ☐ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: half moons
2. Lateral Lines: Depth below grade 30 in. Number 2; Length of each line 100 ft Total length of Laterals 169 ft.; 71
Slope ___in/100 ft. Diameter of pipe ___ in.; Shape ⌒
Material: concrete ☐; fiber asbestos ☑; clay ☐; other ___
Distance between lateral lines 6 ft.
3. Trench Dimensions: Depth 30 in.; Width 48 in.
4. Filter Material: gravel.
Depth of material from trench bottom ___in.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.
Property Line ___ft.
6. Percolation Rate: 24 minutes/inch

TYPICAL SKETCHES

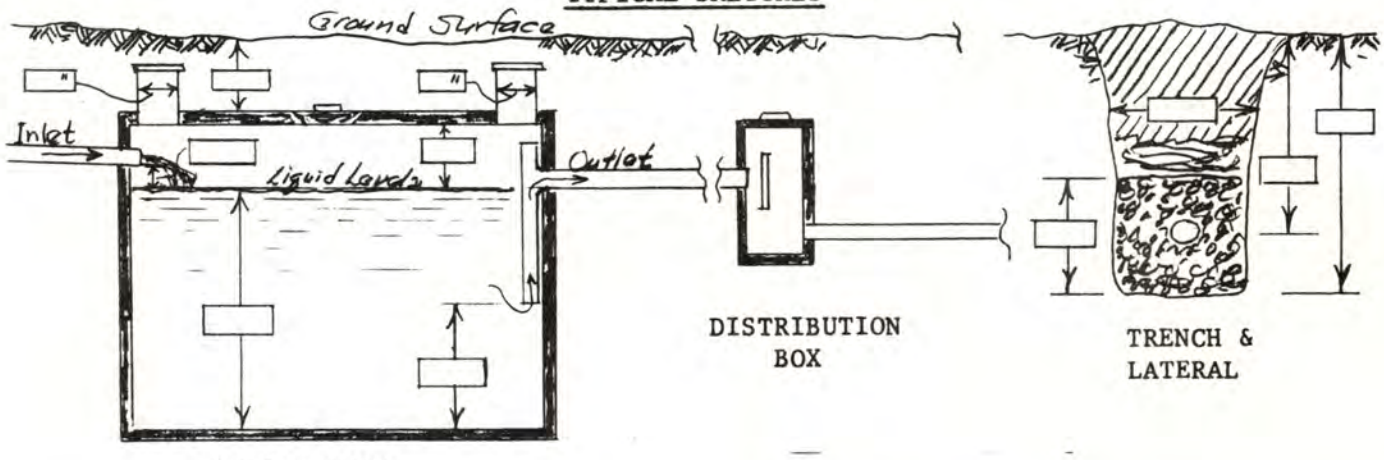

Signature of Applicant

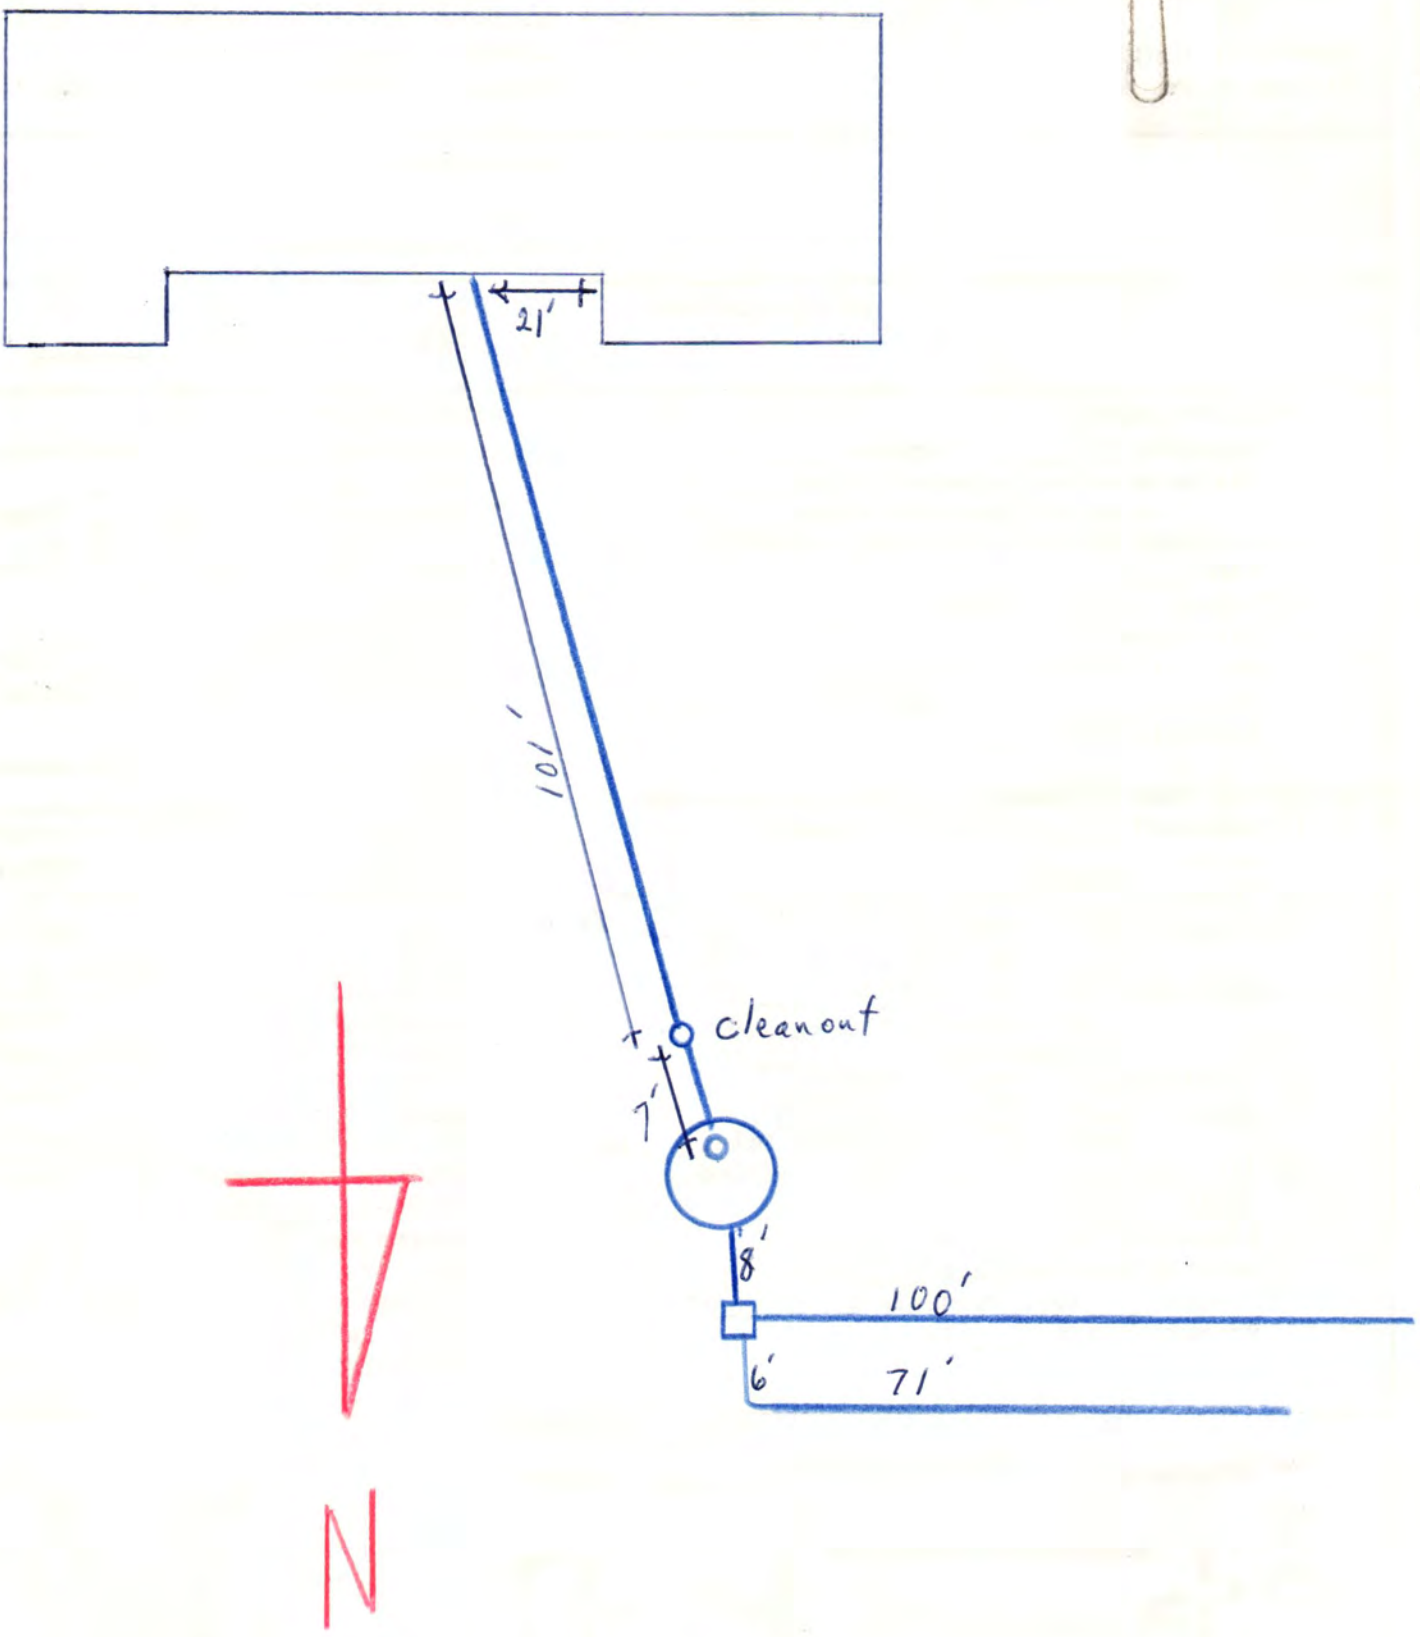

Inspected by James Wevelka
6-8-73

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 6111 Old Cheney, Lincoln, Nebraska 68516

Twp 9N Range 7E Section 16 1/4 ___ 1/4 ___ Block 1 Lot 1 Addition Frontier Acres, LCN

Directions to Property Hiway 2 Eaxt to Old Cheney - property in on the corner of Wagon Road and Old Cheney (Stone Faced House) Home Sold Sign - if unable to find, call Jeff Johnson 432-0756

Location of Well ___ Tap Location: Inside ☒ Outside ☒

Location of Sewage System North of Driveway-lined up with garage Year Installed 1973

	NAME	ADDRESS	PHONE
Present Owner:	Linda A Anderson	6111 Old Cheney Rd Lincoln, Ne. 68516	423 0646
Tenant/Buyer:	Robert L & Jean M. Winters	6231 S 48th St. Lincoln, Ne. 68516	421 2600
Return to:	Sheryl Pflug/ATI Title Company	P.O. Box 67069 Lincoln, Ne. 68506-7069	434-3272

Signature of Applicant Sheryl Pflug Address P.O. Box 67069 Lincoln NE 68506 Date 8 / 17 / 93

HEALTH DEPARTMENT USE ONLY

Date Received 08 / 20 / 93 Received $150.00 Check ☒ #18949 Cash ☐

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 8 / 24 / 93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	☒	☐	Approved ☒	Date ___/___/___ by ___
Bacteria	☒ 0 /ml	☐ ___ /ml	Provisional ☐	Date ___/___/___ by ___
Nitrate	☒ 5.9 ppm	☐ ___ ppm	Disapproved ☐	Date ___/___/___ by ___

Comments: THE SEPTIC TANK SHOULD BE CHECKED TO SEE IF IT NEEDS PUMPING.

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☒ Provisional Approval: ☐

Approved by Jerrold C. Hood R.E.H.S. Date 8 / 27 / 93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

133

Plat Of Survey

Survey of: LOT 1 B1 FRONTIER ACRES,

NW¼ Section 16 T 9 N, R 7 E of 6th P.M.

Date _____ 19____ Weather _____


TRANSIT ENGINEERING COMPANY
Consulting Engineers — Planners — Land Surveyors

2547 North 33rd Street
Lincoln, Nebraska 68504

N

Scale 1"=100'

PLOT PLAN

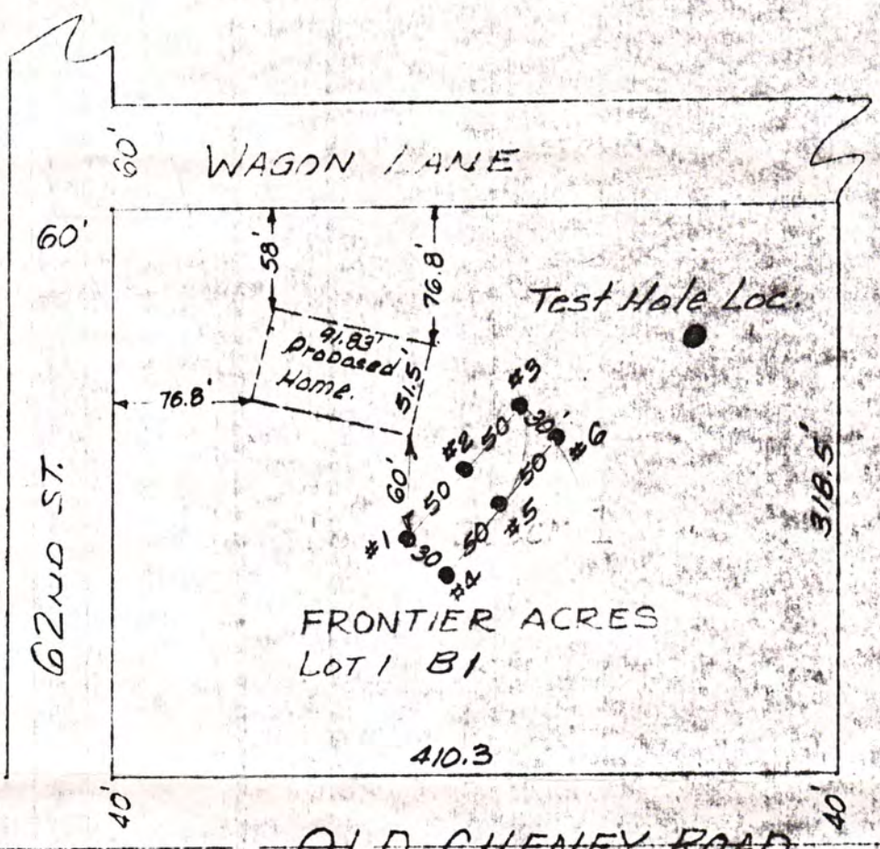

NEBRASKA REGISTERED LS-250 LAND SURVEYOR K. B. SMITH

Land Surveyor's Seal

Signed this 7TH day of MAY 19 23

Name: KB Smith

Surveyor's license No. L.S. 250