LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 93390032601

Issued 05/07/93
Expires 11/07/93
Revenue Code 18754

Establishment
LARRY SCHWARCK
T9N R7E SEC 11
LOT 6
4800 S 84 STREET

FEES: $50.00

TOTAL $50.00

Permittee
LARRY SCHWARCK
8200 OLD CHENEY RD
LINCOLN NE 68510

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 5-6-93

The undersigned hereby applies for a permit to ALTER ☑, EXTEND ☑, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 11 ;
Block _____ ; Lot 6 I.T. ; Addition _____
Street Address 4800 So 84th

2. Property Use: Residential X ☐; Commercial _____ ☐
No. Bedrooms 4 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: add Lift Station and 100' perf pipe lateral and 65' Sewer for future D Comp x lateral

5. Work to be done by: Owner ☐ ; or Contractor ☑, L. Schevarek
Contractor's Name

6. Estimated cost of project:

a. Materials	$
b. Labor	$
c. Other	$
TOTAL	$ 2000

L Schevarek
Signature of Applicant (owner or lessee)

8200 old Cheney
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 50.00

2. Site Visits:
Date: 5/5/93 by: J.C.H.
Date: 5/6/93 by: J.C.H.
Date: 7/19/93 by: J.C.H.

3. Date: Approved ☒; Disapproved ☐
by: Jerrold E. Wood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 5/7/93 by: J.C. Hook

FORM 20104-0477 RECEIVED AUG 0 1993
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material _____; Diameter _____ in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank _____ ft.
4. Number of clean-outs _____.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material _____; No. of compartments _____.
2. Capacity _____ gals.;
3. Factory Built: Yes ☐ No ☐
(Company _____)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☐ Grade _____ in.
5. Inlet: Baffle ☐ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☐
7. Depth of top of tank below finished grade _____ in.
8. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material _____; Number - available outlets _____.
2. Factory Built: Yes ☐ No ☐
(Company _____)
3. Distance from Septic Tank _____ ft.


D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☐
Diameter of Half Round _____ or Perforated Pipe _____.
Material: fiberglass ☐ ; plastic ☐ ; concrete ☐ ; other _____.
2. Lateral Lines:
Number 3 ; Length of each line 100, 100, 100, _____, _____ ft.;
Total length of laterals 300 ft.;
Distance between lateral lines _____ ft.
3. Trench dimensions: Width 3 ft.;
Slope 6 in/100 ft.; Average Depth 30 in.
4. Filter Material: _____
Depth of Material 16 in.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

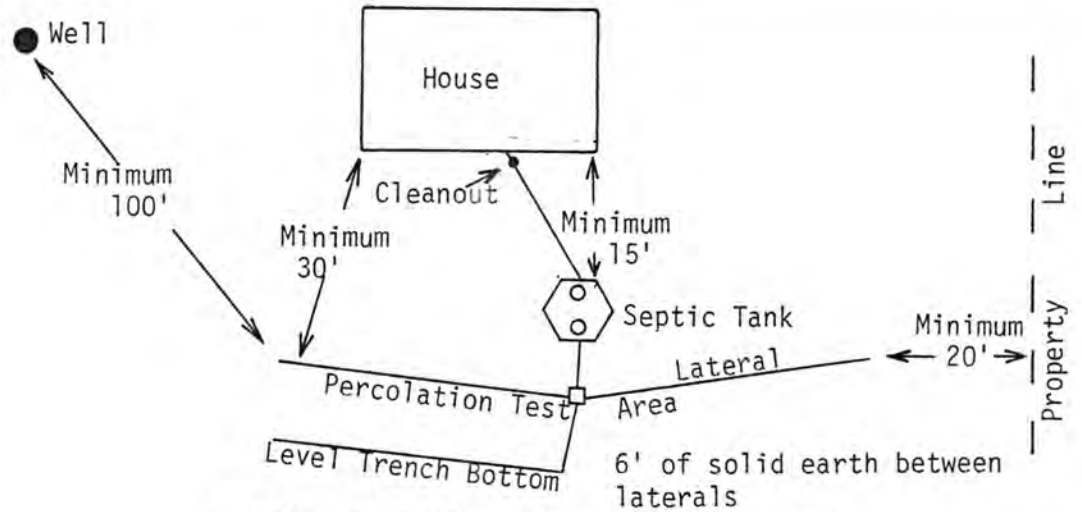

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

AS BUILT DRAWING OF SYSTEM

DATE 7-15-93 INSTALLER Larry Schwarz

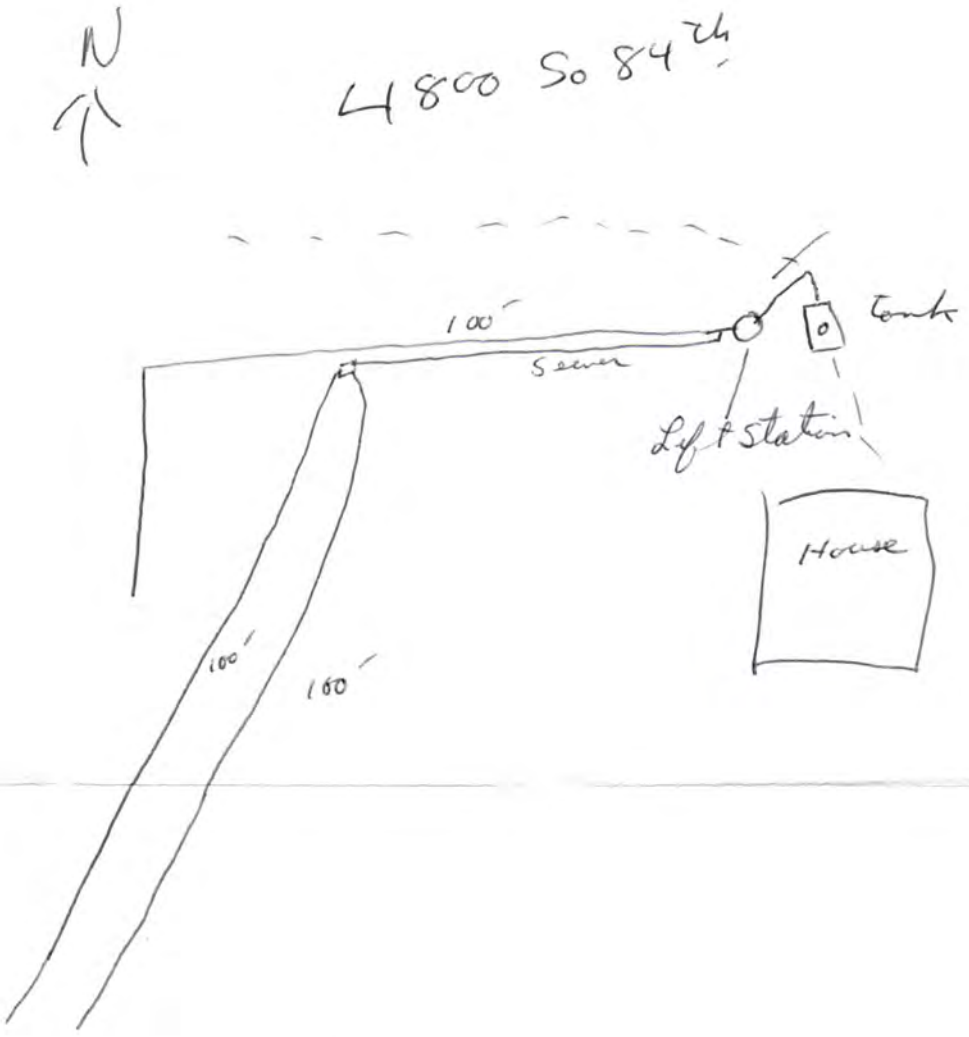

add 200' perf pipe lateral
+ Disconect Deep lateral