CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. B 72

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — February 27, 1969

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Louis W. Long — Route 8, Lincoln, Nebraska

LICENSEE OR PERMITTEE — ADDRESS

T 9N; R 7E; Section 17; Lot 8; Colonial Acres 2nd Addition

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
143-1535	10.0116	24.0114

30.00

APPLICATION

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 72

DATE: 8-22-68

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N; Range 7E; Section 17;
Block ____; Lot 8; Addition Calaveras 1st Ac 2nd
Street Address Rt 8.

2. Property Use: Residential ____ [V]; Commercial ____ [ ]
No. of Bed Rooms 3 Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [V]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

L St Long
Signature of Applicant (owner or lessee)

Rt 8 Lincoln Nebr.
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: ____
Filing Fee: $____. ____

2. Date Site Clearance ____

3. Site Visits:
Date: ____ by: ____
Date: ____ by: ____
Date: ____ by: ____

4. Date: Approved [X]; Disapproved [ ]: 8/27/68
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: ____
Date Issued: ____ Serial ____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 1/15/74 by: Jerrold C. Hood

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 72

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 7E; Section 17;
Block ___; Lot 8; Addition Cobnic 1/Ac. 2nd
Street Address Rt 8.

2. Property Use: Residential ___ ☑; Commercial ___ ☐
No. of Bedrooms 3. Describe: ___
Other Use ___ ☐
Describe: ___

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Distance to public sewer: 2000 + ft.

L O Long
Signature of Applicant (owner or lessee)

Rt 8 Lincoln Nebr.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 8/27/68. ACTION: Approved ___ ☒ Disapproved ☐
Date Frwd. 8/28/68. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 8-28-68. ACTION: Approved ___ ☒ Disapproved ☐
Date Frwd. ___. Signature: Chas. Teel, By Bob Skinner

3. City Engineer: Date Rec'd. ___. ACTION: Approved ___ ☑ Disapproved ☐
Date Frwd. 8-28-68. Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ___

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: ___ Signature ___

FORM HD-33(67) SOIL ABSORPTION
TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Location: Township _____
Section & ¼ Sect. _____
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: _____
Address _____

Dates of Tests: 8/24/68 to 8/25/68. Weather: Precip. ____ Temp. ____F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	34	8/24	8AM	8/25	9AM	8/25	9:15	12	9:45	11	30	1	
2	36							12		11	30	1	
3	36							12		9½	30	2½	
4	32							12		14½	30	2½	
5	34							14		13	30	1	
6	36							12		11	30	1	

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

L. H. Long
Signature of Person Conducting Test

Address 309 WPlo
Phone: 466-1820

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 30 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: August 27, 1968

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 72

SPECIFICATIONS

DATE: 8-22-68


A. BUILDING SEWER:
1. Material ~~Cast Iron~~ PLASTIC; Diameter 4" in.
2. Distance above basement floor ~~12~~ in.; or below basement floor 12 in.
3. Distance between dwelling and septic tank ~~75~~ ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ~~1050~~ ft.; ~~79~~
Stream ~~1250~~ ft.; Pressure Line ~~133~~ ft.;
Property Line ~~126~~ ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Conc Block; No. of compartments 2.
2. Capacity 1000 gals.; Liquid depth 48" in.
3. Factory Built: Yes ☐ (Company _____)
No ☑
4. Manholes: Over Inlet; diam. 24" in.
Over Outlet; diam. 24" in.
Below Grade 24" in. Top
5. Inlet: Baffle ☐; or Tee ☑
6. Outlet: Baffle ☐; or Tee ☑
Depth of outlet below inlet 12 in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line 100 ft.;
Stream 1250 ft.; Pressure Line 133 ft.;
Property Line 128 ft.

C. DISTRIBUTION BOXES
1. Material Conc Bl No. available outlets 2.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP No ☐
3. Dimension: Length 36 in.; Width 24 in. Depth 32 in.
4. Distance from Septic Tank 8 ft.
5. Serial Distribution: Yes ☐, No ☒
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: ORANGE BURG & HALFMOON
2. Lateral Lines: Depth below grade 36 in.
Number 3; Length of each line 75 ft
Total length of Laterals 225 ft.;
Slope 36 in/100 ft. Diameter of pipe 4 in.; Shape Round & O
Material: concrete ☐; (fiber) asbestos ☒; clay ☐; other FIBERGLASS
Distance between lateral lines 20 ft.
3. Trench Dimensions: Depth 30 in.; Width 36 in.
4. Filter Material: Gravel & ~~Crushed Rock~~
Depth of material from trench bottom 12 in.
5. Distances To:
Well or Suction Line 150 ft.;
Stream 1250 ft.; Pressure Line 150 ft.
Property Line 128 ft.
6. Percolation Rate: 20 minutes/inch

TYPICAL SKETCHES

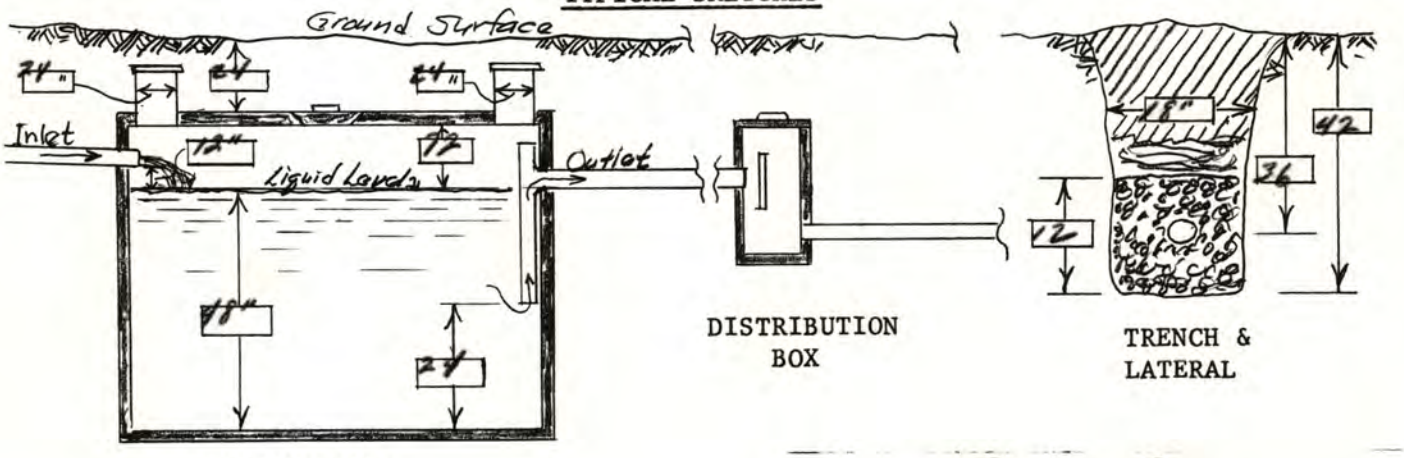


SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

L W Long
Signature of Applicant

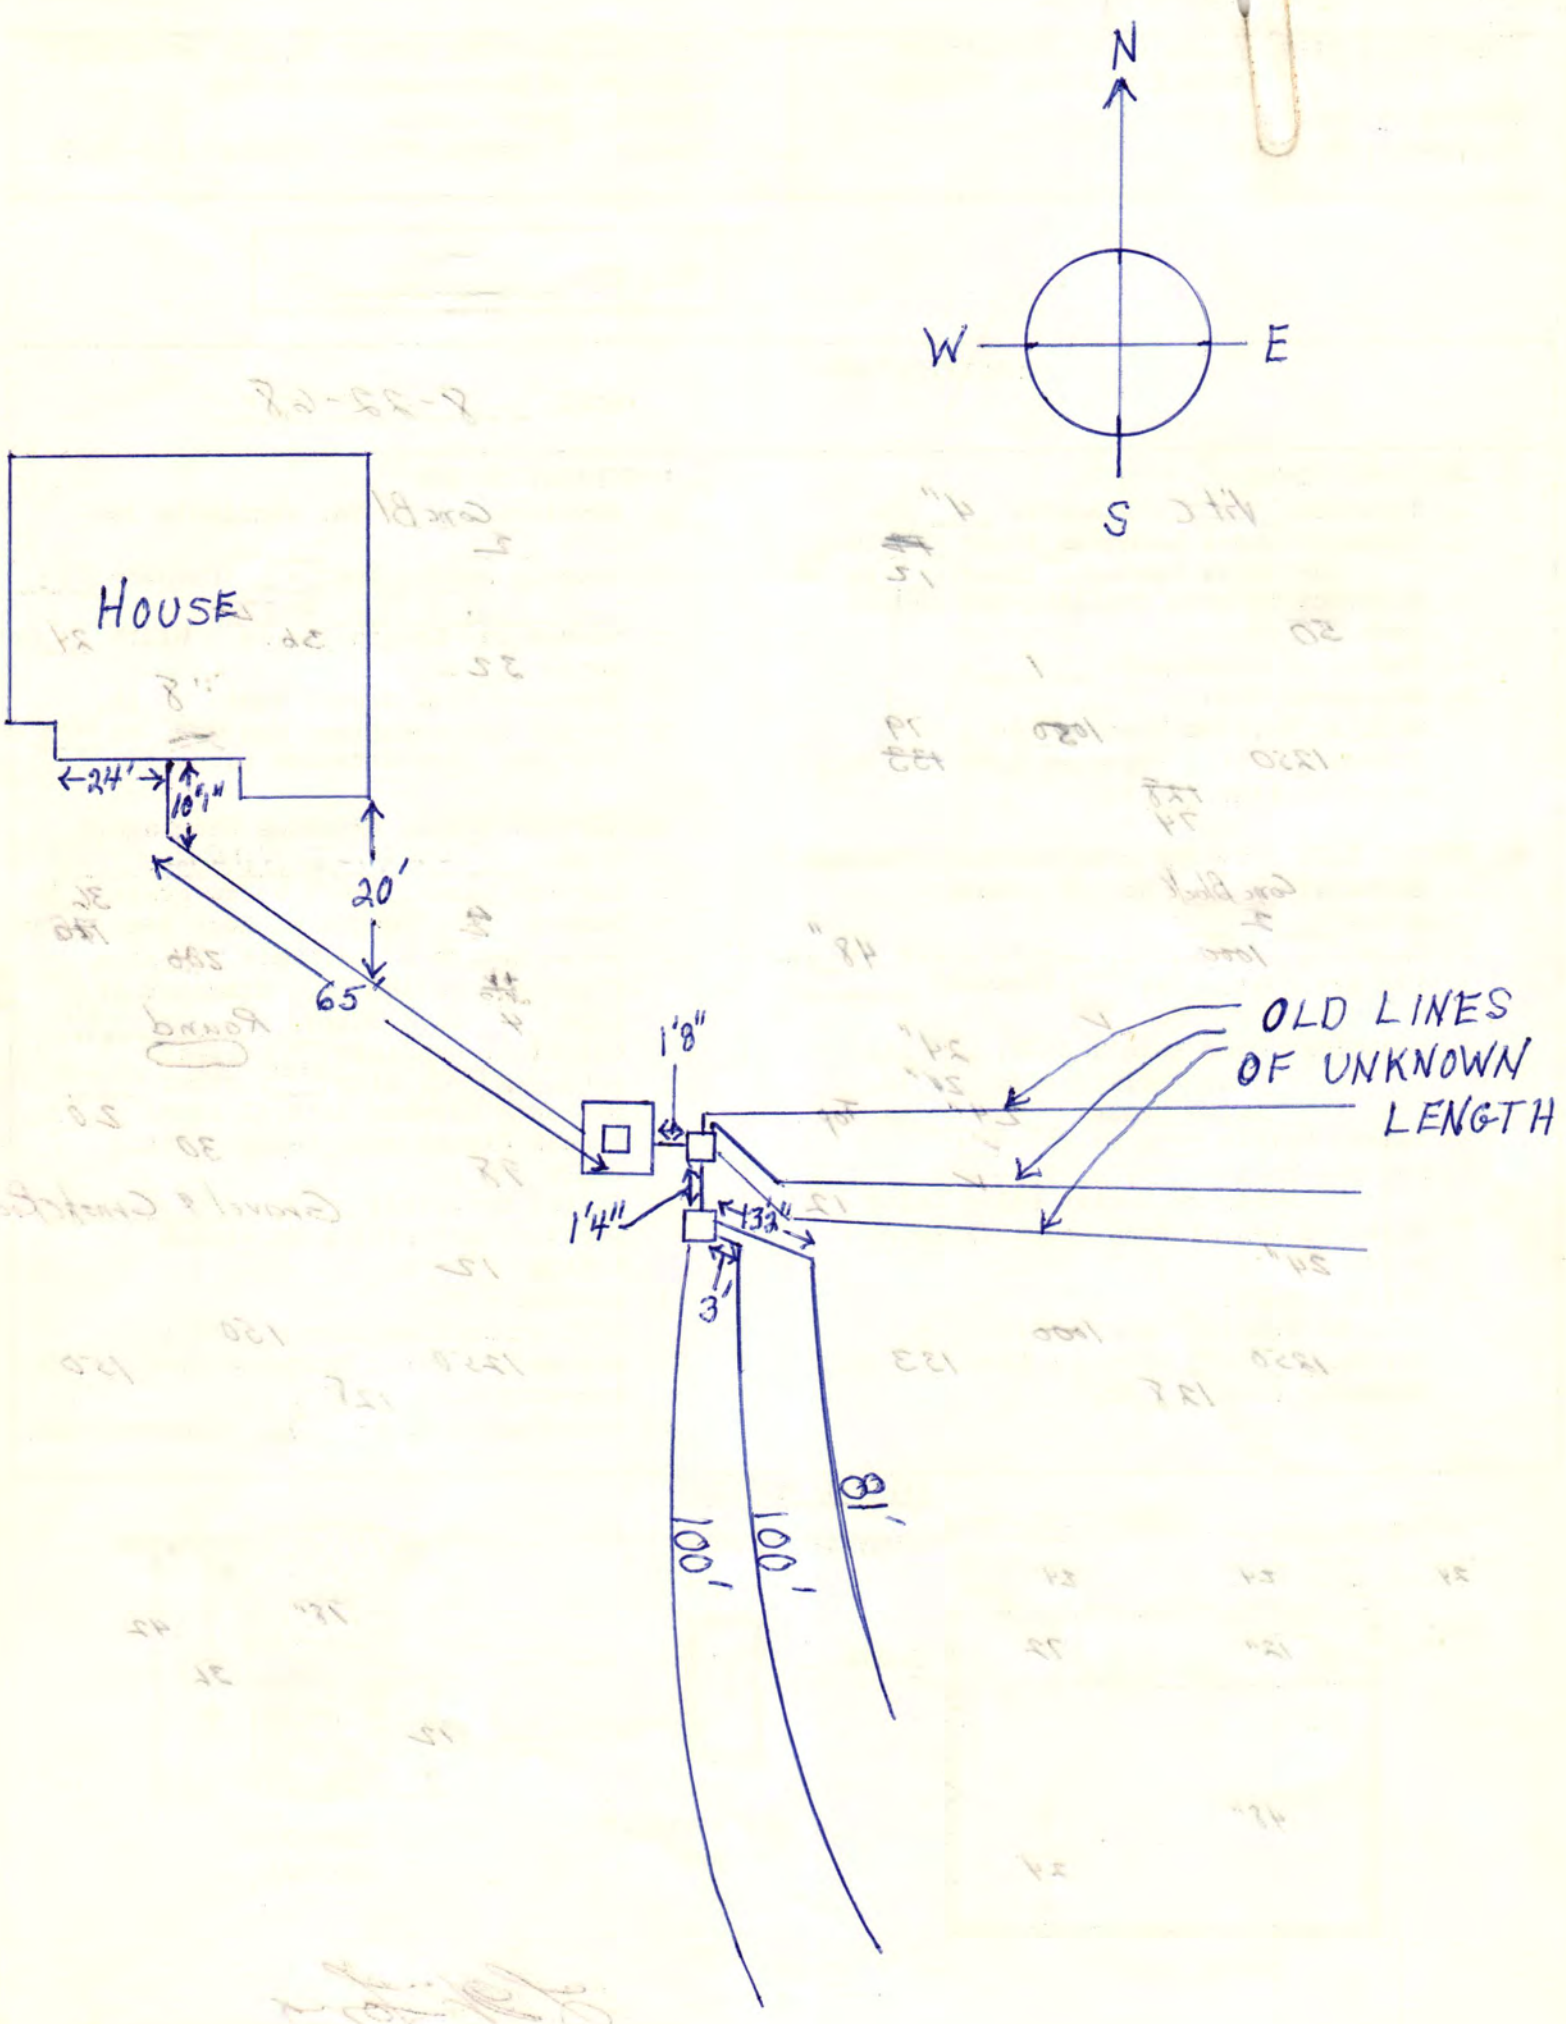
N
W
E
S
HOUSE
24'
10'4"
20'
65'
1'8"
OLD LINES
OF UNKNOWN
LENGTH
1'4"
13½"
3'
100'
100'
81'

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St. Marys Avenue #214 Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: May 16 1991 $150.00

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $75.00

Legal Description of Property: TWP. 9N; RANGE 7E; SECTION 17; BLOCK ____

LOT 8; ADDITION Colonial View; Street Address 5401 Saltillo Rd.

Directions to Property ____

Location of Well ____ Tap Location: Inside ☐ Outside ☐

Location of Sewage System ____ Year Installed ____

	NAME	ADDRESS	PHONE
Present Owner:	[illegible]	5401 Saltillo Rd	488-3011 H 483-6354
Tenant/Buyer:			
Return to:	LINDA JOHNSON	WOODS BROS. REALTY 3201 PIONEER BLVD.	

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant [signature] Address 5401 Saltillo Rd

==========

HEALTH DEPARTMENT USE ONLY $150.00

Date Received JULY 11, 1991 Received $75.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE JULY 12, 1991

COMMUNITY SYSTEM

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☒	Date 7/12/91 by J.C.H.
Bacteria	☒	☐	Provisional:	☐	Date ____ by ____
Nitrate	☒	☐	Disapproved:	☐	Date ____ by ____

Comments: IF SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY IT SHOULD BE CHECKED TO SEE IF IT IS NEEDED.

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY [signature] DATE JULY 17, 1991

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

006

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-8000 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☐ Evaluation of the Individual Water System Date: 7-30-92

☑ Evaluation of the Sewage Disposal System ☐ Enclosed is $150.00

Legal Description of Property: TWP. 9 ; RANGE 7 ; SECTION 17 ; BLOCK ___

LOT 8 ; ADDITION Colonial Acres 2nd ; Street Address 5401 Cornell Rd

Directions to Property South of Hwy 2 on 56th ¼ mile

Location of Well Semi-public supply Tap Location: Inside ☐ Outside ☐

Location of Sewage System ___ Year Installed ___

	NAME	ADDRESS	PHONE
Present Owner:	Gary Goranson	5401 Cornell Rd	437-8255 & 483-7451
Tenant/Buyer:	Dean Sicking	#9 Ranchero Rd (Texas)	1-409-845-1902
Return to:	Century 21-	2200 So. 40th Suite #103	489-5911 Denise Riley 41-486-1439

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant ___ Address ___

HEALTH DEPARTMENT USE ONLY

Date Received 7-30-92 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 7-31-92

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:	SITE VISIT:
Construction	☒	☐	Approved: ☒	Date 7-31-92 by [illegible]
Bacteria	☒	☒ 12	Provisional: ☐	Date 8-6-92 by [illegible]
Nitrate	☒ <0.1	☐	Disapproved: ☐	Date ___ by ___

Comments: Recommend checking to see if septic tank needs pumping.

See Attached Letter ☐

FINAL STATUS * Approval based on second water sample which was collected inside house. Recommend a 3rd & 4th set of samples collect inside & outside to be more certain of water quality.

WATER SYSTEM:*	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Ron Mayfield RS DATE 8-7-92

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832