FILE NO. 726

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

May 12, 1976 — THIS LICENSE OR PERMIT EXPIRES

Ronald Biloff — LICENSEE OR PERMITTEE

4036 Linden — ADDRESS

T9N; R7E; Sec. 17; Lot 2; Colonial Acres 2nd Add. — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
110.15	110.16	148.14	6-2

624-1535

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒

County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 726

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 11/12/75

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9 North; Range 7-E; Section 17
   Block ____; Lot 2; Addition 2nd addition, Colonial acres.
   Street Address 5400 Concord Rd

2. Property Use: Residential ____ ☑; Commercial ____ ☐
   No. of Bedrooms 3. Describe: ____
   Other Use ____ ☐
   Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Distance to public sewer: ____ ft.

Ronald Beloff
Signature of Applicant (Owner or Lessee)

4036 Linden
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 11/12/75. Date Frwd. 11/12/75.
   ACTION: Approved ☒ Disapproved ☐
   Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. ____. Date Frwd. ____.
   ACTION: Approved ☒ Disapproved ☐
   Signature: Hal Williamson

3. City or County Engineer: Date Rec'd. 11/12/75. Date Frwd. 11/12/75.
   ACTION: Approved ☒ Disapproved ☐
   Signature: Joe Bird for Al Imig

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 726

DATE: 11/12/75

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9-N ; Range 7-E ; Section 17 ; Block ; Lot 3 ; Addition 2nd Colonial acres.
Street Address 5400 Concord rd.

2. Property Use: Residential ☑; Commercial ☐
No. of Bedrooms 3
Describe:
Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Ronald Biloff
Signature of Applicant (owner or lessee)

4036 Linden
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: 4-1-76 by:
Date: by:
Date: by:

3. Date: Approved ☒; Disapproved ☐ 11/13/75
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4-1-76 by: Ron Mangum

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 726

PROPERTY WHERE SOIL TESTED:
Location: Township 9N 7E
Section & ¼ Sect. 14 NW 2
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Wayne Kubert
Address 3100 O

Dates of Tests: 11-9-72 to 11-10-72. Weather: Precip. Rain Temp. 50°

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Start Time (Hr. Min.)	End Date (Mo. Day)	End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Start Time (Hr. Min.)	Start Water Level (in.)	End Time (Hr. Min.)	End Water Level (in.)	Results Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36	11/8		11/9		11/10					60	1	
2		11/9		11/9		11/10					60	1	
3		11/9		11/9		11/10					60	1	
4		11/9		11/9		11/10					60	1	
5		11/9		11/9		11/10					60	1	
6		11/9		11/9		11/10					60	1	

Roger Bailey
Signature of Person Conducting Test

Address 4131 Colonial Dr.
Phone: 434 320 2466

Sum of Percolation Rates
Average of Rates:
Mean of Rates:
1" every 45 min

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

DATE: November 14, 1972

Approved Percolation Rate(s)
A. 48 min./inch
B. _____ min./inch
C. _____ min./inch

Gerald C. Hood
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 726

SPECIFICATIONS

DATE: _____

A. BUILDING SEWER:

1. Material PVC; Diameter 4 in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank 95 ft.
4. Number of clean-outs 1.
5. Distances To:
   Well or Suction Line ____ft.;
   Stream ____ft.; Pressure Line ____ft.;
   Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)

1. Material Concrete; No. of compartments _____.
2. Capacity 1000 gals.; Liquid depth ____in.
3. Factory Built: Yes ☐ (Company precast)
   No ☐
4. Manholes: Over Inlet; diam. ____in.
   Over Outlet; diam. ___in.
   Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
   Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade 8 in.
8. Distances To:
   Well or Suction Line 95' ft.;
   Stream ____ft.; Pressure Line ____ft.;
   Property Line ____ft.


C. DISTRIBUTION BOX

1. Material Concrete; No. available outlets _____.
2. Factory Built: Yes ☑, (Company precast) No ☐
3. Dimension: Length ____in.; Width ___in. Depth ____in.
4. Distance from Septic Tank 7 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)


D. ABSORPTION FIELD: (Provide drawings.)

1. Type: Seepage bed
2. Lateral Lines: Depth below grade ___in. Number 3; Length of each line ___ft Total length of Laterals 229 ft.; Slope Level in/100 ft. Diameter of pipe ____ in.; Shape ½ moon
   Material: concrete ☑; fiber asbestos ☐; clay ☐; other _____
   Distance between lateral lines ____ft.
3. Trench Dimensions: Depth 3-5 ft.; Width 48 in.
4. Filter Material: gravel.
   Depth of material from trench bottom 20 in.
5. Distances To:
   Well or Suction Line 105 ft.;
   Stream _____ft.; Pressure Line ____ft.
   Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

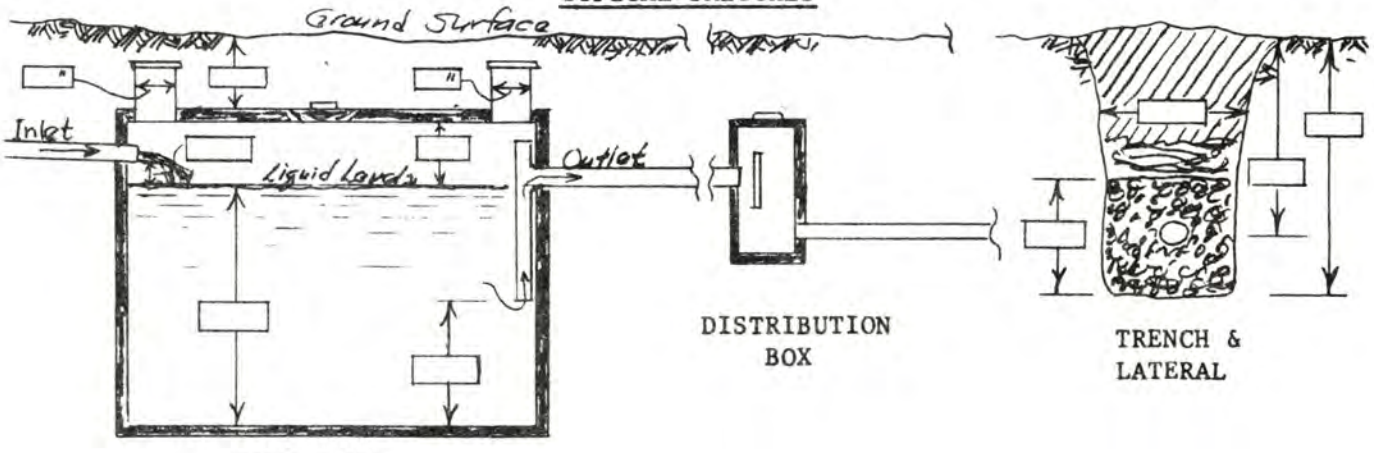

_____
Signature of Applicant

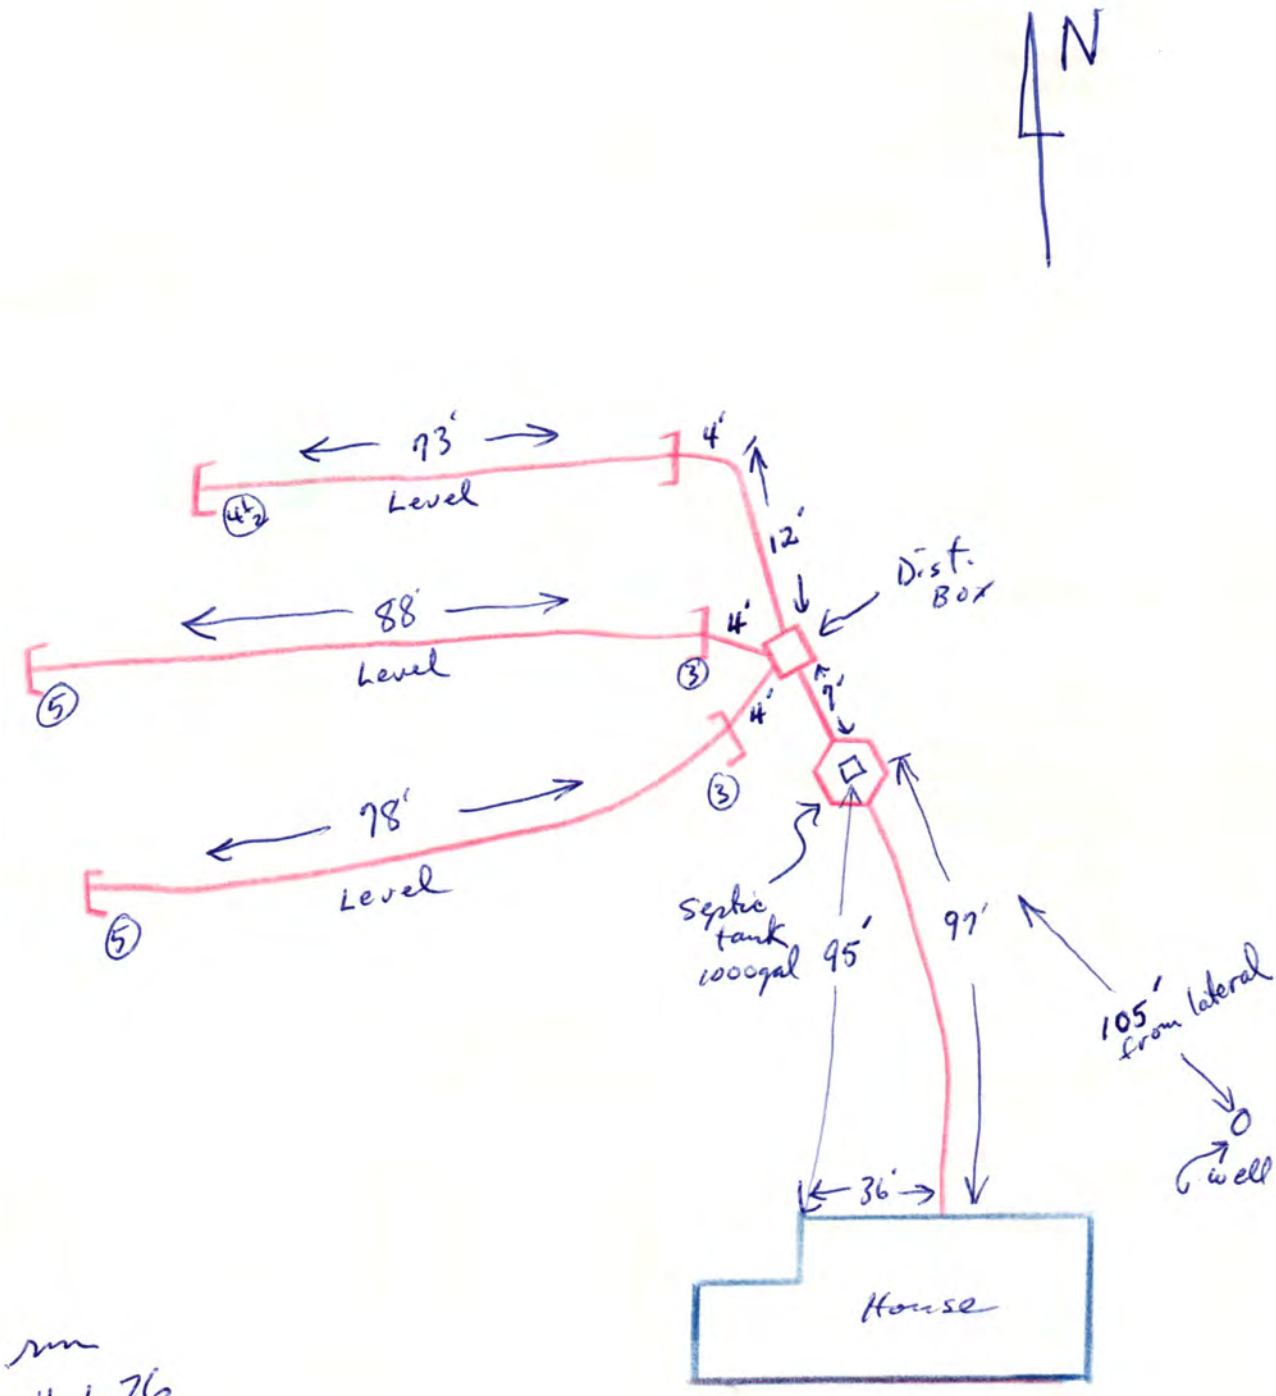
N
73'
Level
4'
4½
12'
Dist. Box
88'
Level
4'
3
5
4'
7'
3
78'
Level
5
Septic tank 1000gal
95'
97'
105' from lateral
well
36'
House

sm
4-1-76