CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 73

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — March 1, 1969

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Carl Wohlfarth — 3130 Orchard Street

LICENSEE OR PERMITTEE — ADDRESS

T 9N; R 7 E; Section 16; Lot 1; Lees Summit Addition

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
110.15	110.16	148.14	6-2
143-1535	10.0116	24.0114	

SERIAL NO. — DATE — AMOUNT

14357 NOV 29 68 30.00

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 73

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 7E; Section 16;
Block ____; Lot 1; Addition LEES SUMMIT ADD
Street Address _____.

2. Property Use: Residential ____ ☑; Commercial ____ ☐
No. of Bedrooms 4. Describe: _____

Other Use ____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Distance to public sewer: _____ ft.

x Carl A Wolcott
Signature of Applicant (owner or lessee)

3130 Orchard
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 8/29/68. ACTION: Approved ____ ☒ Disapproved ☐
Date Frwd. 8/29/68. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 8/29/68. ACTION: Approved ____ ☒ Disapproved ☐
Date Frwd. 8/29/68. Signature: Chas Seale By Bob Skinner

3. City Engineer: Date Rec'd. _____. ACTION: Approved ____ ☐ Disapproved ☐
Date Frwd. 8-29-68. Signature: _____

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: _____ Signature _____

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 73

DATE: 28 Aug 68

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N; Range 7E; Section 16; SUMMIT ADDITION ADD
Block ____; Lot 1; Addition LEES
Street Address ____.

2. Property Use: Residential ____ [✓]; Commercial ____ [ ]
No. of Bed Rooms 4 Describe: ____

Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [✓]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

x Carl C Wolfarth
Signature of Applicant (owner or lessee)

3130 Orchard
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: ____
Filing Fee: $____. ____

2. Date Site Clearance ____

3. Site Visits:
Date: 11/14/68 by: J.C.H.
Date: ____ by: ____
Date: ____ by: ____

4. Date: Approved [X]; Disapproved [ ]: 8/29/68
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: ____
Date Issued: ____ Serial ____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 11/14/68 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 73

PROPERTY WHERE SOIL TESTED:
Location: Township 9N
Section & ¼ Sect. 16
Property Dimensions: ___ ft. x ___ ft.
Area: _____ acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☑; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: CARL WOHLFARTH
Address 3130 ORCHARD ST.

Dates of Tests: 28 Aug to 28 Aug. Weather: Precip. Rain Temp. 70 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36	8/28/68	0700	8/28	800	8/28	800	30	810	29	10	1	10/1
2	36	8/28/68	0700	8/28	800	8/28	800	30	812	29	12	1	12/1
3	36	8/28/68	0700	8/28	800	8/28	800	30	810	29	11	1	11/1
			AM		PM		PM						

Donald Magee
Signature of Person Conducting Test

Address Rt 8
Phone: 488-8099

Sum of Percolation Rates
Average of Rates: 11/1
Mean of Rates:

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 11 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: August 29, 1968

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 73

SPECIFICATIONS

DATE: 28 Aug

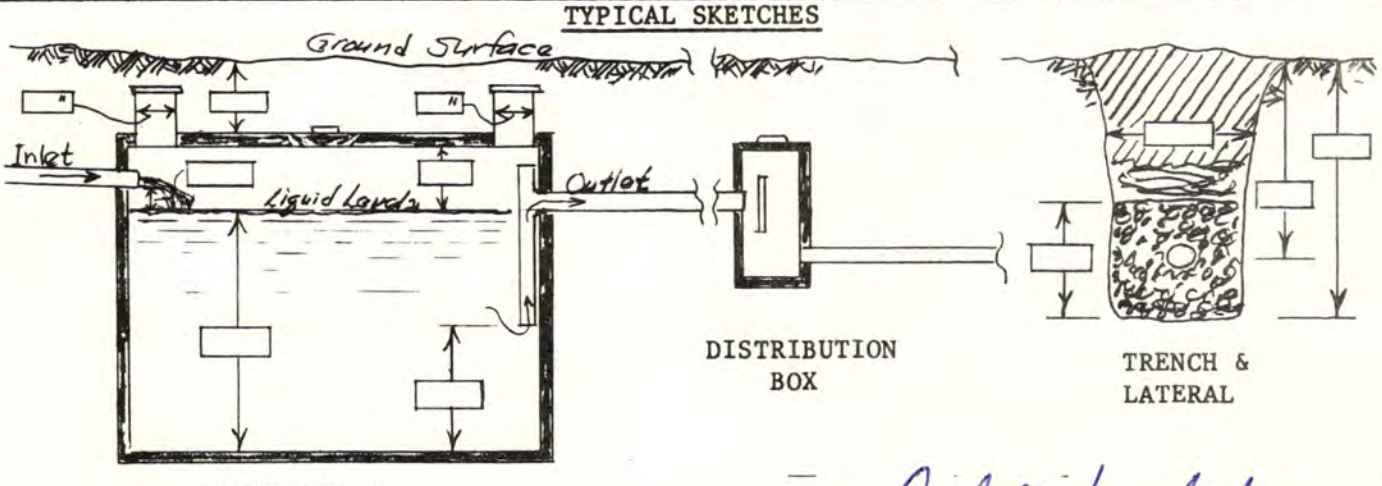
A. BUILDING SEWER:
1. Material Clay; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 40 ft.
4. Number of clean-outs ___.
5. Distances To:
Well or Suction Line 100+ ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line 150 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Fiber Glass; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 48 in.
3. Factory Built: Yes ☑ (Company Concrete Co.) No ☐
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. ___ in.
Below Grade 20 in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☑
Depth of outlet below inlet 2 in.
7. Depth of top of tank below finished grade 20 in.
8. Distances To:
Well or Suction Line 100+ ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line 150 ft.

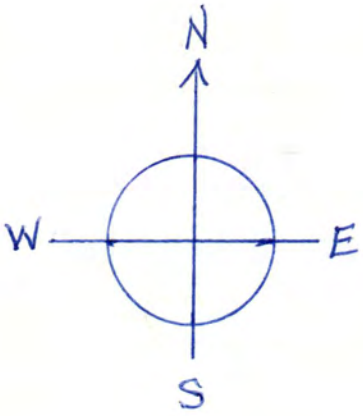
C. DISTRIBUTION BOX
1. Material Concrete; No. available outlets 5.
2. Factory Built: Yes ☑, (Company Fiber Cast) No ☐
3. Dimension: Length 13 in.; Width 11 in. Depth 8 in.
4. Distance from Septic Tank 7 ft.
5. Serial Distribution: Yes ☑, No ☐ (If yes, show detailed plans.)

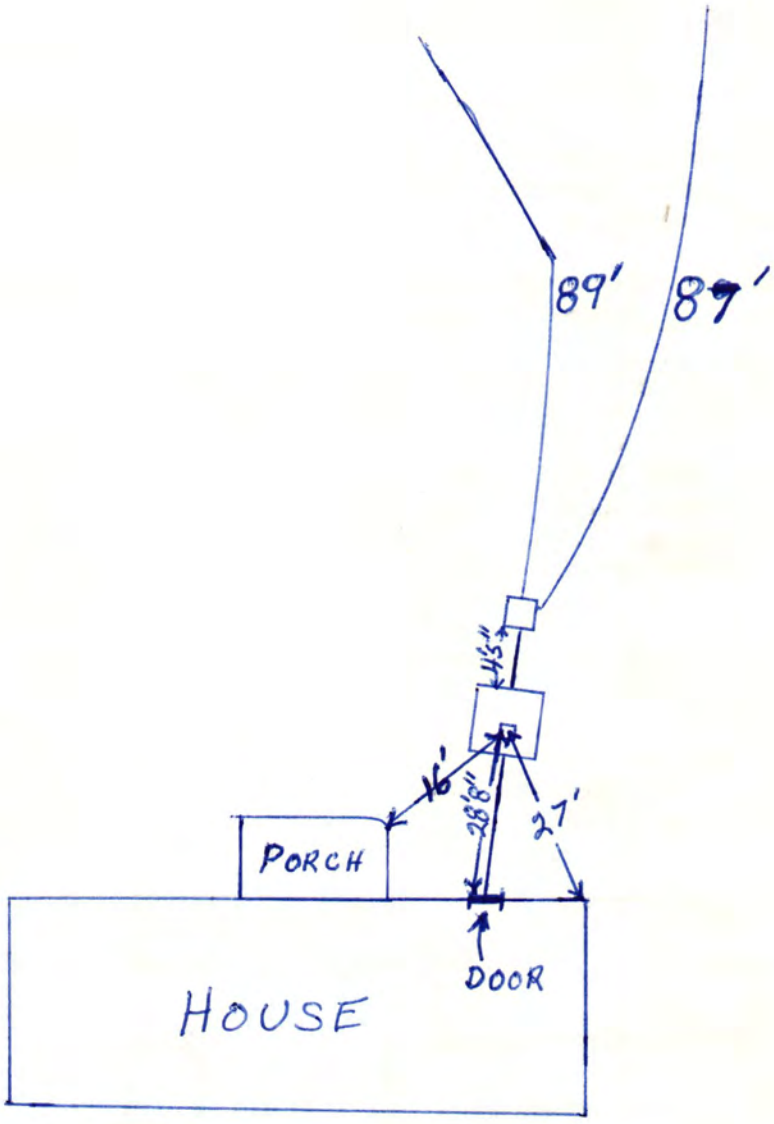
D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Half moon
2. Lateral Lines: Depth below grade 18 in. Number 2; Length of each line 85 ft Total length of Laterals 165 ft.; Slope 4 in/100 ft. Diameter of pipe 4 in.; Shape Half moon Material: concrete ☐; fiber asbestos ☐; clay ☐; other ___ Distance between lateral lines 20 ft.
3. Trench Dimensions: Depth 34 in.; Width 48 in.
4. Filter Material: Gravel. Depth of material from trench bottom 16 in.
5. Distances To:
Well or Suction Line 100+ ft.;
Stream ___ ft.; Pressure Line ___ ft.
Property Line 150 ft.
6. Percolation Rate: 11/1 minutes/inch

TYPICAL SKETCHES



x Carl C Wohlfarth
Signature of Applicant


N
W
E
S


89'
87'
4½"
16'
28'8"
27'
PORCH
DOOR
HOUSE