FILE # 2722

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

6 MONTHS — THIS LICENSE OR PERMIT EXPIRES

ROBERT W. ARTZ/ARTZ & SONS CONSTRUCTION, INC., 5737 FRANKLIN, LINCOLN, NE 68506 — LICENSEE OR PERMITTEE / ADDRESS

T9N; R7E; Sec 20; Bk 2; Lot 1; Country Acres — NAME OF ESTABLISHMENT, IF ANY / ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2722 ☒

DATE: 8/25/88

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. T9N ; Range R7E ; Section 20 ; Block 3 : Lot 1 : Addition COUNTRY ACRES
   Street Address _____

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: 300 ft.

Robert w Artz
Artz & Sons const Inc
Signature of Applicant (Owner or Lessee)

5735 Franklin
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/25/88. Date Frwd. 8/25/88. ACTION: Approved ☒ Disapproved ☐ Signature: Jerold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 8/25/88. Date Frwd. 8/25/88. ACTION: Approved ☒ Disapproved ☐ Signature: Gale Peters

3. City or County Engineer: Date Rec'd. 8-25-88. Date Frwd. 8-25-88. ACTION: Approved ☒ Disapproved ☐ Signature: Donna Daniels

REMARKS OR REASONS FOR DISAPPROVAL NO WELL PERMIT

Site Visits:
Date: 11-14-88 by: rm need drawing
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 11-17-88 By: Ron Mangrum

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

RECEIVED NOV 17 1988

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material PVC 160 ; Diameter 4 in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank 118 ft.
4. Number of clean-outs 2 .
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material Pre Cast ; No. of compartments _____ .
2. Capacity 1500 gals.;
3. Factory Built: Yes ☒ No ☐
(Company _____)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☐ Grade _____ in.
5. Inlet: Baffle ☐ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☐
7. Depth of top of tank below finished grade 10" in.
8. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material Pre Cast ; Number - available outlets _____ .
2. Factory Built: Yes ☒ No ☐
(Company _____)
3. Distance from Septic Tank 17 ft.


D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☒ Perforated Pipe ☐
Diameter of Half Round _____ or Perforated Pipe _____ .
Material: fiberglass ☐ ; plastic ☐ ; concrete ☐ ; other _____ .
2. Lateral Lines:
Number 3 ; Length of each line 100 , 100 , 100 , _____ , _____ ft.;
Total length of laterals 300 ft.;
Distance between lateral lines 8-12 ft.
3. Trench dimensions: Width 4 ft.;
Slope 0-6 in/100 ft.; Average Depth 36-38 in.
4. Filter Material: Road Gravel
Depth of Material 28" in.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

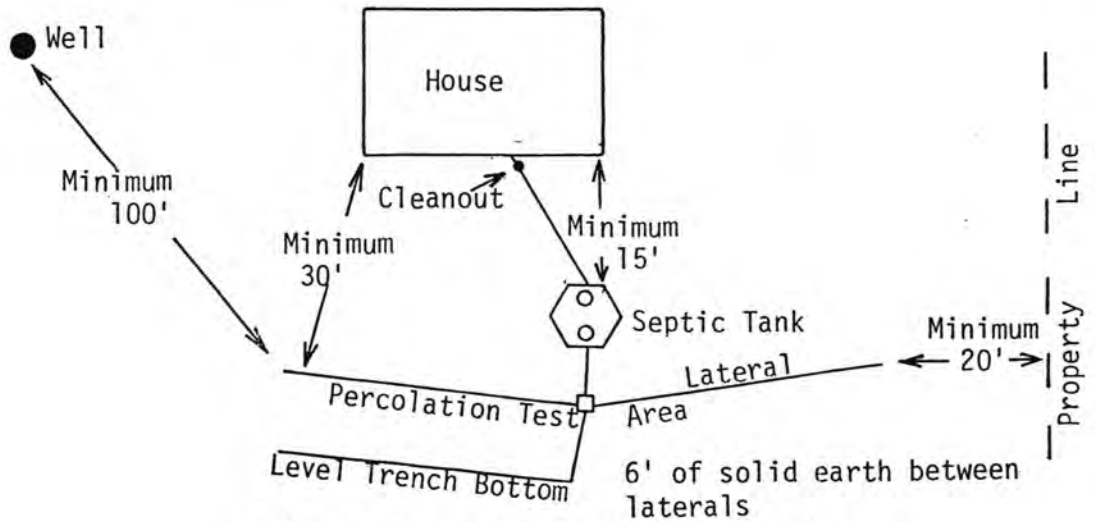

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

11-14-88

Larry Schwarck

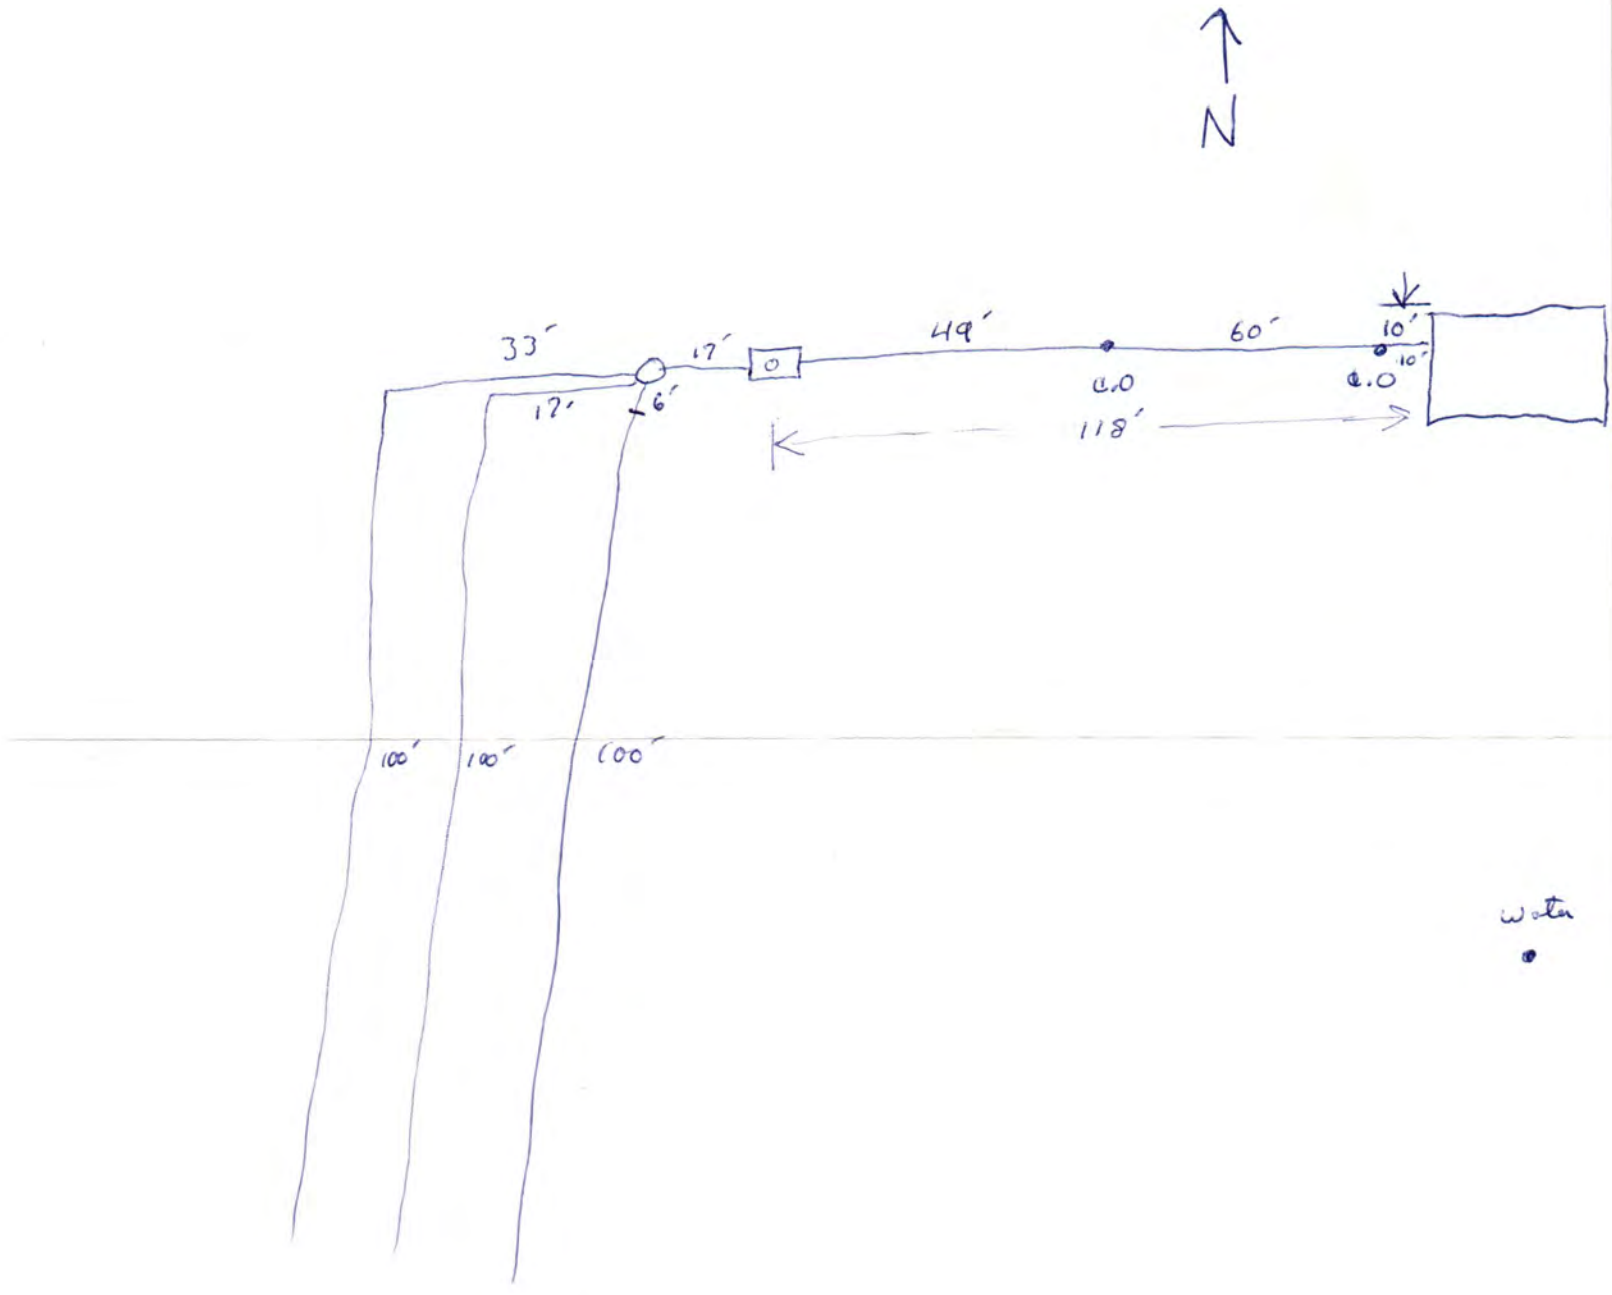

5200 Cauuy