LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET
Lincoln, NE 68510-1514
(402) 441-8000

NON TRANSFERABLE

PERMIT

Permit No. 97390054501

SEWAGE SYSTEM REPAIR

Issued 03/24/97
Expires 09/24/97
Revenue Code 18754

Establishment

JOHN MATEJOVICH
T9N R7E SEC 20
COUNTRY ACRES SOUTH BLK 1 LOT 3

FEES: $50.00

TOTAL $50.00

Permittee

JOHN MATEJOVICH
5000 BRIDLE LN
LINCOLN NE 68516

Issued By M. Jane Ford
Health Director

3445

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]

County Resolution No. 2832 [ ]

Lincoln-Lancaster County
HEALTH DEPARTMENT
3140 "N" STREET LINCOLN, NE 68510-1514

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 3-21-97

The undersigned hereby applies for a permit to ALTER [ ], EXTEND [X], or REPAIR [ ] an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 20 ;
Block 1 ; Lot 3 ; Addition COUNTRY ACRES SOUTH.
Street Address 5000 BRIDLE LANE

2. Property Use: Residential [✓]; Commercial [ ]
No. Bedrooms 4
Describe _____
Other Use [ ]
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Description of proposed alteration, extension or repair: check EXISTING LATERALS & EXTEND TWO SHORT LATERAL AW ADDITION 150 FEET

5. Work to be done by: Owner [ ] ; or Contractor [X], LARRY SCHWARCIC
Contractor's Name

6. Estimated cost of project:

a. Materials	$
b. Labor	$
c. Other	$
TOTAL	$ 1400 -

John D Matejovich
Signature of Applicant (owner or lessee)

5000 BRIDLE LANE
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: 3-21-97 MS
Filing Fee: $ 150.00 # 1016

2. Site Visits:
Date: 3/31/97 by: J.C.H
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved [X]; Disapproved [ ]
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/7/97 by: J.C. Hood

002

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

3059

Legal Description of Property: Street Address 5000 Bridle Lane

Twp 9N Range 7E Section 20 1/4 ___ 1/4 ___ Block 1 Lot 3 Addition Country Acres South Addn

Directions to Property 56 St. South of Old Chaney Approx. 1½ mi, West side of 56

Location of Well BACK of House by Driveway Tap Location: Inside ☐ Outside ☐

Location of Sewage System IN Front of Home Year Installed ___

	NAME	ADDRESS	PHONE
Present Owner:	Doug Wismer	5000 Bridle Lane	421-6481
Tenant/Buyer:	John Matejavich	R.D. 1, Hebron Rd. Imperial, PA 15126	412-899-3213
Return to: c/o Kiam	State Title Co.		

Signature of Applicant Donna Semin Address 225 No. 10th ER Lincoln, NE Date 6/10/96

HEALTH DEPARTMENT USE ONLY

Date Received 06/11/96 Received $150.00 Check ☑ Cash ☐ #4926

PRELIMINARY STATUS--By Jerrold Hood **DATE:** 6/12/96

WATER SYSTEM:	Approved	Disapproved
Construction	☐	☒
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ <0.1 ppm	☐ ___ ppm

SEWAGE SYSTEM

Approved ☐

Provisional ☒

Disapproved ☐

Additional Site Visits

Date 6/14/96 by L.C.H.

Date ___/___/___ by ___

Date ___/___/___ by ___

Comments: ELECTRICAL CONDUIT IS BROKEN AT WELL HEAD. SOME LEAKAGE AT SOUTHWESTERN LATERAL AT SOME TIME Well corrected 6/14/96 L.C.H. ALTHOUGH NOT IN VIOLATION See Attached Letter ☐

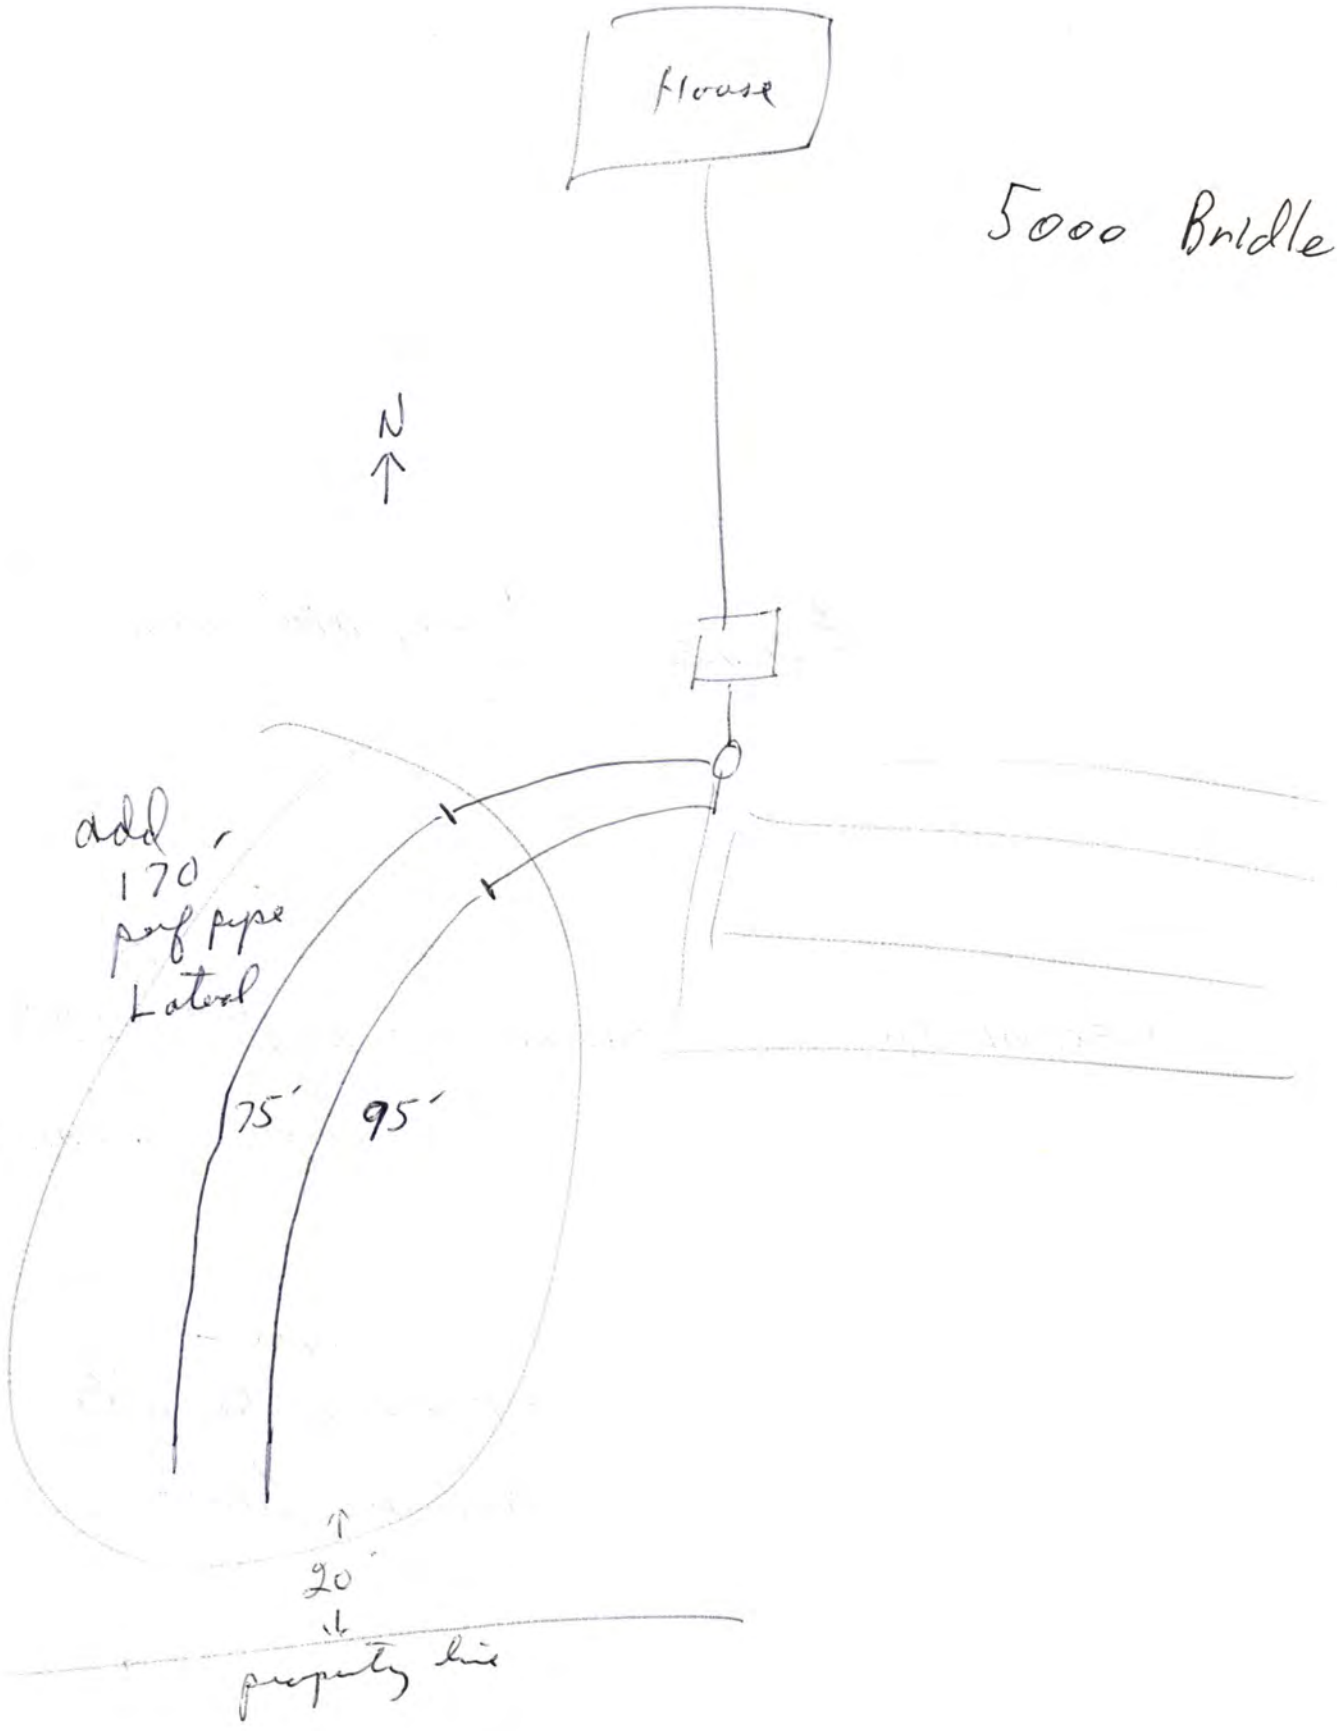
THE WET ONE SPOT IN THE SEPTIC SYSTEM BEARS WATCHING....

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Jerrold C. Hood R.E.H.S. Date 6/18/96

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.


House
5000 Bridle
N
add
170'
perf pipe
Lateral
75'
95'
20
property line