FILE NO. 885

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

January 26, 1977 — THIS LICENSE OR PERMIT EXPIRES

George Devitt — LICENSEE OR PERMITTEE

3344 South 44 Street — ADDRESS

T9N; R7E; Sec. 22; Bl. 3; Lot 9; Clarendon Hills Add; LAGOON — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
41931	JUL 27 '76	30.00 -

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

HEALTH
APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 885

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 7-27-76

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 27
   Block 3 ; Lot 9 ; Addition Clarendon Hills
   Street Address Riviera Ter

2. Property Use: Residential ☐ ; Commercial ☐
   No. of Bedrooms 3. Describe:
   Other Use ☐
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒

4. Distance to public sewer: 2 mi ft.

George Davitt
Signature of Applicant (Owner or Lessee)

3344 So 44 489 3043
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 7/27/76. Date Frwd. 7/27/76. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: Date Rec'd. . Date Frwd. 7-27-76. ACTION: Approved ☒ Disapproved ☐ Signature:
3. City or County Engineer: Date Rec'd. 7/27/76. Date Frwd. . ACTION: Approved ☒ Disapproved ☐ Signature:

REMARKS OR REASONS FOR DISAPPROVAL

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 885

DATE: 7-26-76

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 22 ; Block 3 ; Lot 9 ; Addition Clarendon Hills.
   Street Address 11 add .

2. Property Use: Residential [X]; Commercial [ ]
   No. of Bedrooms 3
   Other Use
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [ ]; Other [X] Topsoil

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

George Devitt
Signature of Applicant (owner or lessee)

3344 So44 489-3043
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
   Filing Fee: $ 30.00

2. Site Visits:
   Date: 2-17-76 by: jw
   Date: 2-18-76 by: jw
   Date: by:

3. Date: Approved [X]; Disapproved [ ] 7/27/76
   by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: 2-18-76 by: James Weverka

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. 885

PROPERTY WHERE SOIL TESTED:
Location: Township 9N ; Range 7E
Section & ¼ Sect. 22
Property Dimensions: ___ft. x ___ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☒; Sandy Clay ☐

Owner: George Divitt
Address 3344 Ly 44 489-3043
Lot 9 Block 3 Clarendon Hills

Dates of Tests: 7-21-76 to 7-22-76. Weather: Precip. No Temp. 95°

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36	7-21	9AM	7-21	1 PM	7-22	11 A	6	12A	6	1Hr.		
2												Did	
3												not	
4												pass	
5													
6													

Sum of Percolation Rates
Average of Rates:
Mean of Rates:

Signature of Person Conducting Test

Address
Phone:

(Do not write below this line)

REVIEWING ACTION

REMARKS:

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

DATE: July 27, 1976

Signature of Reviewing Official

001

ASAP PLEASE!

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☐ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 7300 Revere Lane Clarenden Hills

Twp 9N Range 7E Section 22 1/4 ___ 1/4 ___ Block 3 Lot 9 Addition ___

Directions to Property So. on 70th past Pine Lake to Revere then East to property

Location of Well In Front of House Tap Location: Inside ☐ Outside ☒

Location of Sewage System Lagoon Year Installed 1976 ??

	NAME	ADDRESS	PHONE
Present Owner:	Glodis Devitt	7000 Revere Lane Lincoln 68516	421-3135
Tenant/Buyer:	Terry Beyer	5724 Elkcrest Lincoln, Ne. 68516	488-4940
Return to:	Sandra Harder	Woods Bros Realty 3201 Pioneer Blvd Lincoln, NE 68502	483-4151

Signature of Applicant Terry P. Beyer Address 5724 Elkcrest Lincoln, NE 68516 Date 4/13/93

HEALTH DEPARTMENT USE ONLY

Date Received 05/14/93 Received $150.00 ✓ Check ☒ # 7445 Cash ☐

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 5/17/93

WATER SYSTEM:	Approved	Disapproved	**SEWAGE SYSTEM**	**Additional Site Visits**
Construction	☒	☐	Approved ☐	Date 6/11/93 by J.C.H
Bacteria	☒ ___/ml	☐ ___/ml	Provisional ☐	Date ___/___/___ by ___
Nitrate	☒ 0.1 ppm	☐ ___ppm	Disapproved ☒	Date ___/___/___ by ___

Comments: Need lock on lagoon gate. Need warning signs on fence. Should replace electrical plate on well head. Lagoon is very full. Corrected 6/11/93 J.C.H. See Attached Letter ☐

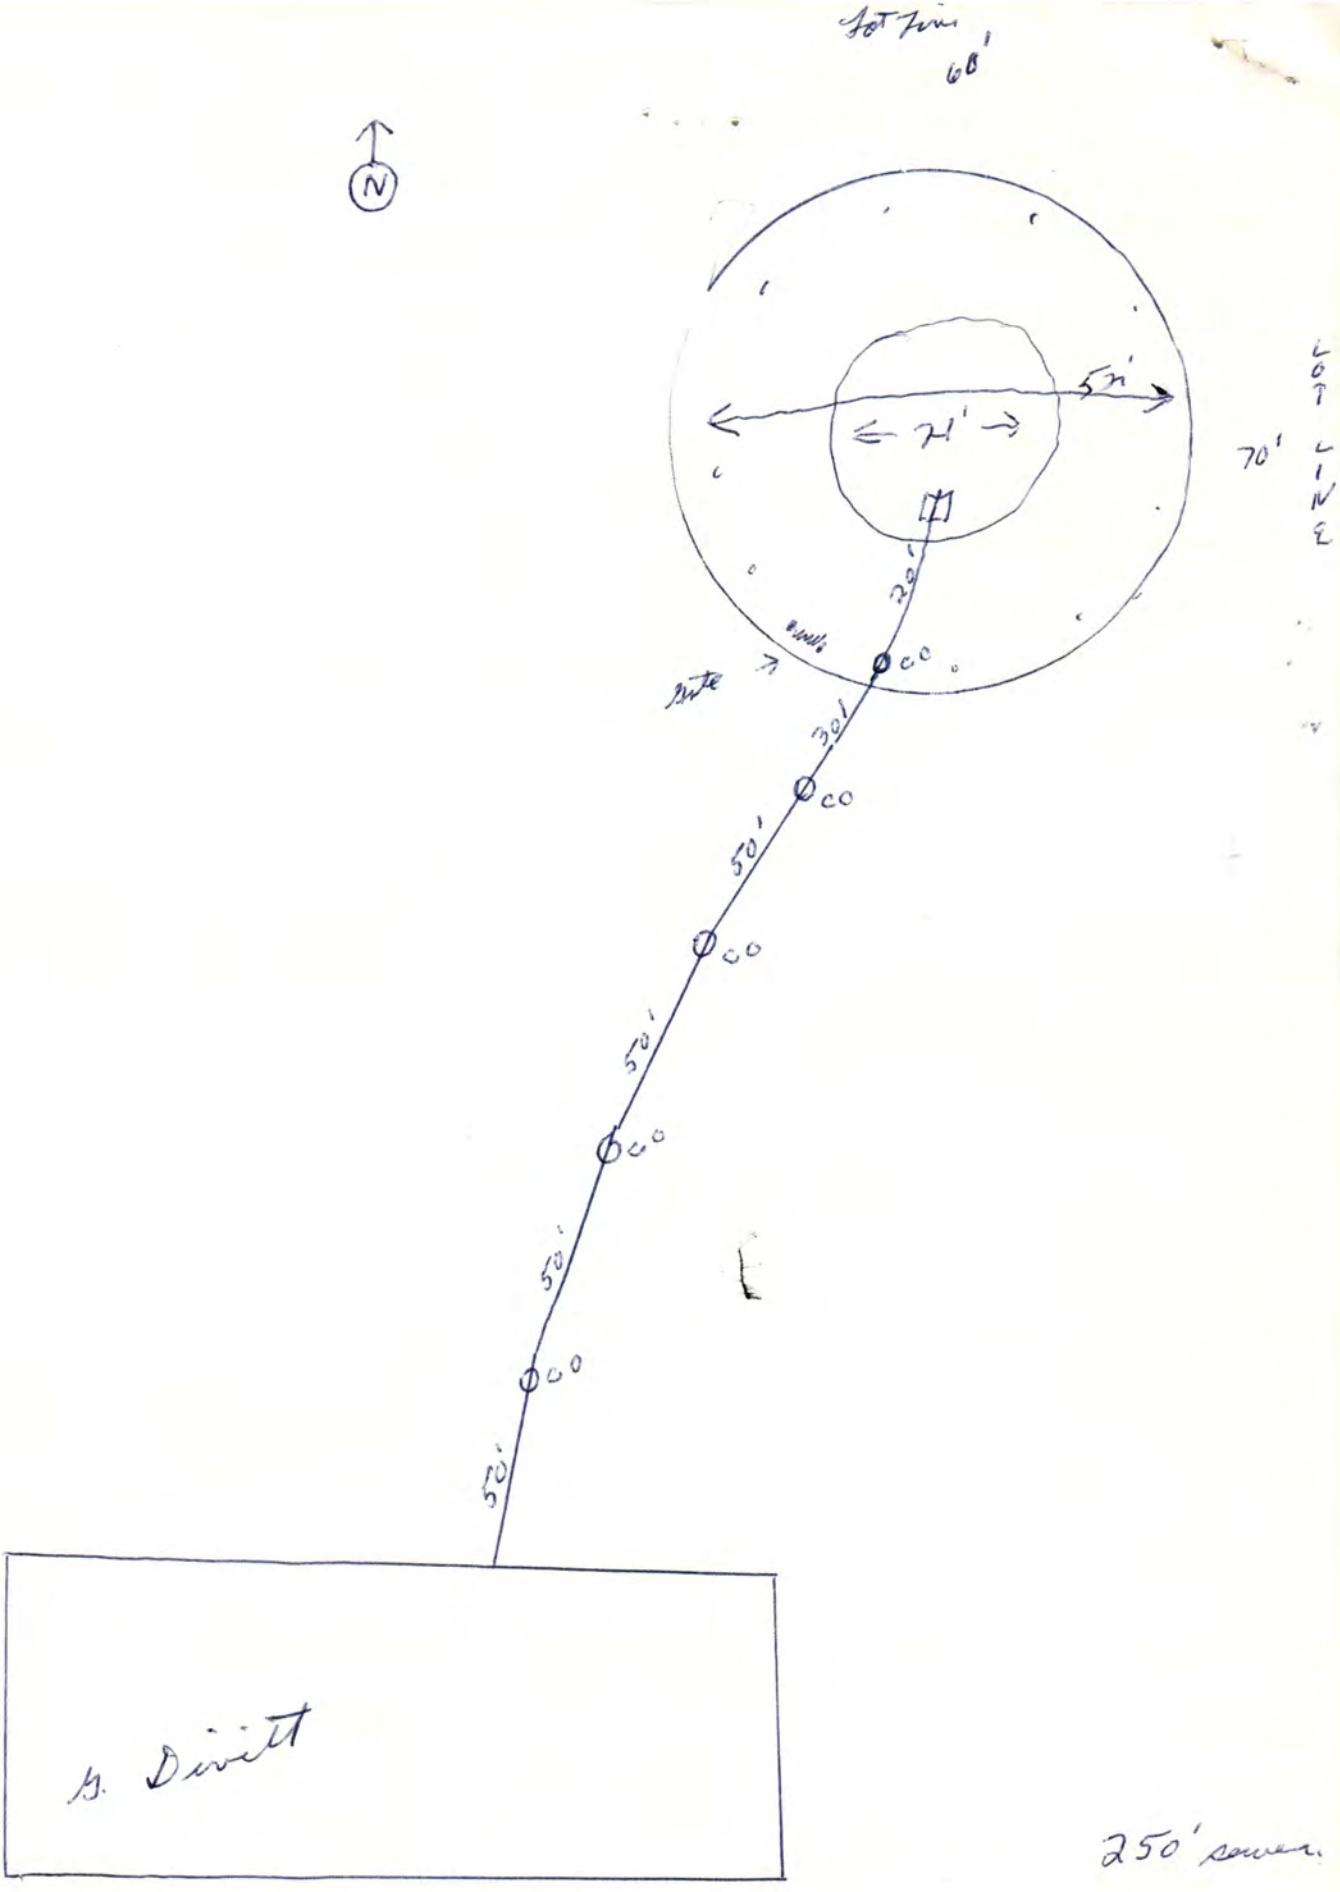
FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☒ Provisional Approval: ☐

Approved by Jerrold C. Hood R.E.H.S. Date 6/11/93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

123


Lot Line
60'
N
52'
74'
70'
LOT LINE
20'
well
site
30'
50'
50'
50'
50'
G. Divitt
250' canal