FILE NO. 469

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

December 24, 1974 — THIS LICENSE OR PERMIT EXPIRES

Wesley N Durst — LICENSEE OR PERMITTEE

4340 South 46th — ADDRESS

T9N; R7E; Sec. 22; Bl. 2; Lot 2; Clarendon Hills 1st Add. — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$30.00	$	$	$	$30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
62411035	110.16	148.14	6-2	

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 469

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 24 June 74

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 22
Block 2 ; Lot 2 ; Addition Clarendon Hills 1st Addition
Street Address approx 7401 Badger drive.

2. Property Use: Residential ✓ ☒ ; Commercial ☐
No. of Bedrooms 3. Describe:

Other Use ☐
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: ft.

Wesley N Durst
Signature of Applicant (Owner or Lessee)

4340 So 46
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 6/24/74. Date Frwd. 6/24/74.
ACTION: Approved ☒ Disapproved ☐
Signature: Jerrold C. Wood

2. Supt. Bldg. Insp.: Date Rec'd. 6/24/74. Date Frwd. 6/24/74.
ACTION: Approved ☒ Disapproved ☐
Signature: Chas Hall by Bob Stamm

3. City or County Engineer: Date Rec'd. 6/24/74. Date Frwd. .
ACTION: Approved ☒ Disapproved ☐
Signature:

REMARKS OR REASONS FOR DISAPPROVAL

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

New.

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO._____

DATE: 24 June 74

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 22 ; Block 2 ; Lot 2 ; Addition Clarendon Hills 1st Add
Street Address approx 7401 Badger drive.

2. Property Use: Residential _____ [V]; Commercial _____ [ ]
No. of Bedrooms 3
Describe: _____
Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Wesley W Durst
Signature of Applicant (owner or lessee)

4340 So 46
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;_____
Filing Fee: $ 30.00

2. Site Visits:
Date: 8-1-75 by: jwdrm
Date:_____ by:_____
Date:_____ by:_____

3. Date: Approved [X]; Disapproved [ ] 6/24/74
by: Jerrold E. Hoob

4. INSTALLATION-FINAL WRITTEN APPROVAL
Date: 8-1-75 by: James Nivelka

OK.

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. _____

PROPERTY WHERE SOIL TESTED: Lot 2 Block 2 Owner: Wesley N Durst
Location: Township Clarendon Hills First Addition
Section & ¼ Sect. _____ Address 4340 So 46 Lincoln
Property Dimensions: 360 ft. x 365 ft.
Area: _____ acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☑

Dates of Tests: 6 June to 7 June. Weather: Precip. .35 Temp. 65 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	24	6/6	1000	6/7	1000	6/7	1000	18"	1100	18 ¼	60	.25	240
2	30	6/6	1000	6/7	1000	6/7	1000	18"	1100	18 ½	60	.5	120
3	32	6/6	1000	6/7	1000	6/7	1000	18"	1100	18 5/8	60	.625	100
4	32	6/6	1000	6/7	1000	6/7	1000	18"	1100	18 ½	60	.5	120
5	30	6/6	1000	6/7	1000	6/7	1000	18"	1100	18 ½	60	.5	120
6	30	6/6	1000	6/7	1000	6/7	1000	18"	1100	18 ¾	60	.75	90

Dr Wesley N Durst
Signature of Person Conducting Test

from top of hole

Sum of Percolation Rates 790
Average of Rates: 133
Mean of Rates: 120

Address 4340 So 46
Phone: 489-7777

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

DATE: _____

_____
Signature of Reviewing Official

CK

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. _____

SPECIFICATIONS

DATE: _____

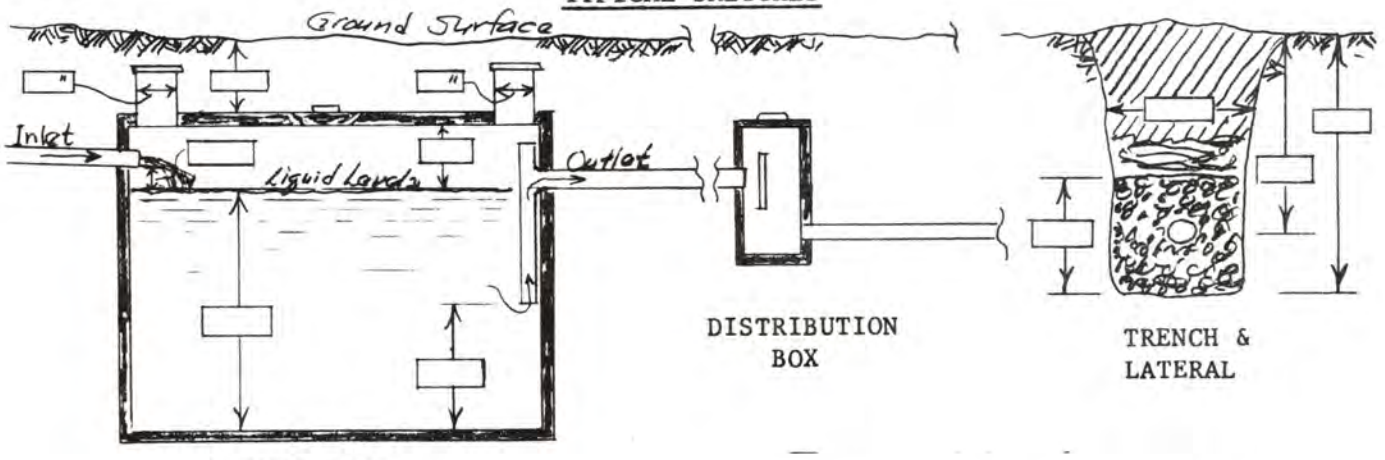
A. BUILDING SEWER:
1. Material Cast Iron; Diameter 4" in.
2. Distance above basement floor ___ in.; or below basement floor 20 in.
3. Distance between dwelling and septic tank 40 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line 120 ft.;
Stream 100 ft.; Pressure Line 120 ft.;
Property Line 100 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments _____.
2. Capacity 1000 gals.; Liquid depth ___ in.
3. Factory Built: Yes ☑ (Company Prestress) No ☐
4. Manholes: Over Inlet; diam. ___ in.
Over Outlet; diam. ___ in.
Below Grade _____ in.
5. Inlet: Baffle ☑; or Tee ☐
6. Outlet: Baffle ☑; or Tee ☐
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 20 in.
8. Distances To:
Well or Suction Line 120 ft.;
Stream 180 ft.; Pressure Line 120 ft.;
Property Line 150 ft.

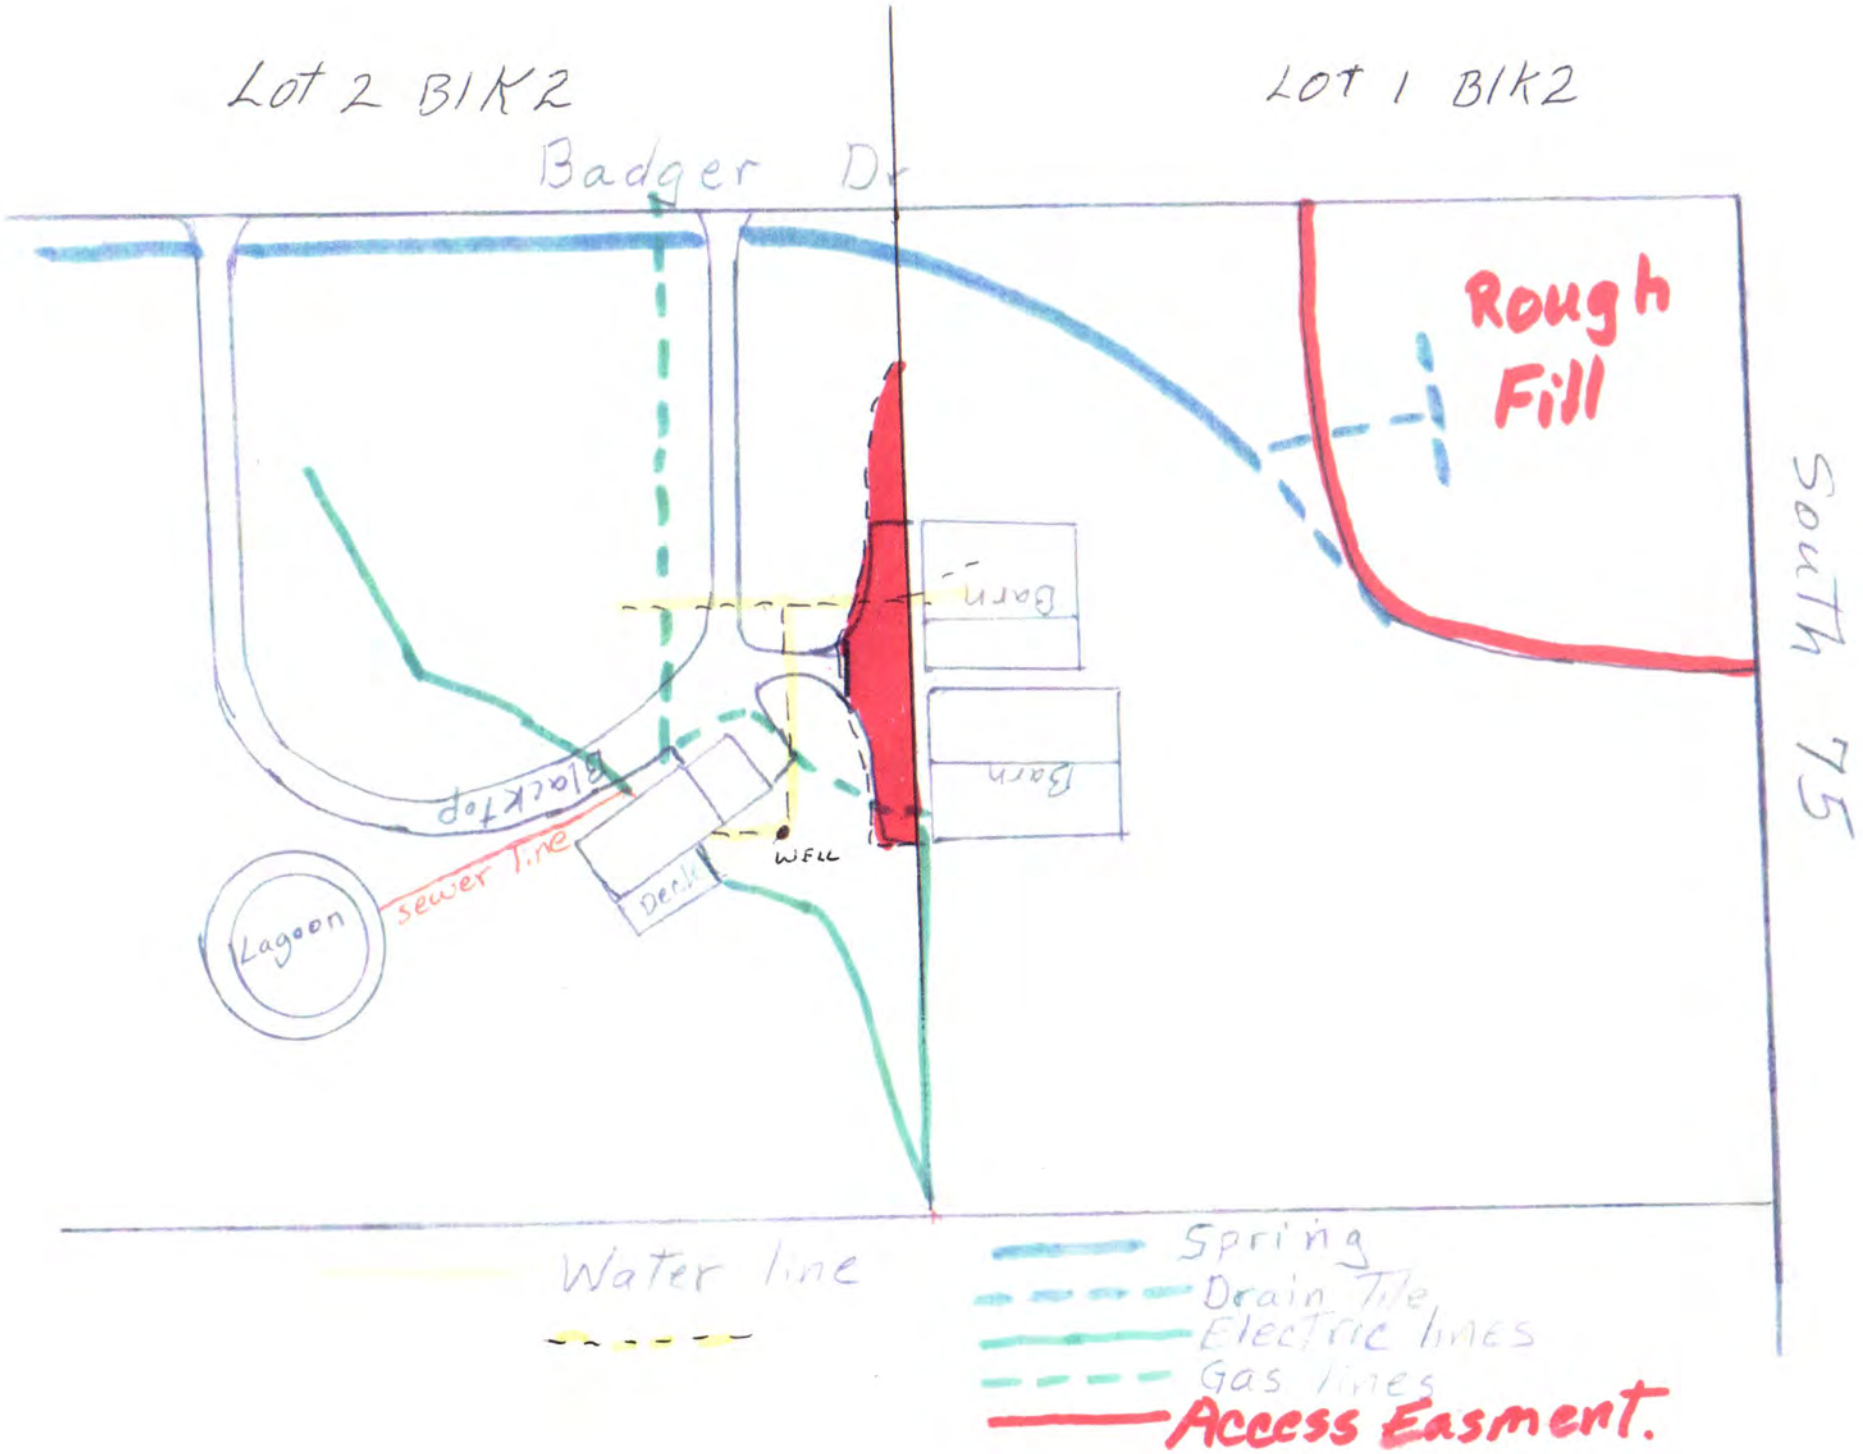
C. DISTRIBUTION BOX
1. Material Cone; No. available outlets 3.
2. Factory Built: Yes ☑, (Company Rushton) No ☐
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank 30 ft.
5. Serial Distribution: Yes ☑, No ☐ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: _____
2. Lateral Lines: Depth below grade 16 in. Number 6; Length of each line 50 ft Total length of Laterals 300 ft.; Slope 6 in/100 ft. Diameter of pipe ___ in.; Shape Half Round Material: concrete ☑; fiber asbestos ☐; clay ☐; other _____ Distance between lateral lines 30 ft.
3. Trench Dimensions: Depth 32 in.; Width 60 in.
4. Filter Material: Coarse Gravel. Depth of material from trench bottom 14 in.
5. Distances To:
Well or Suction Line 160 ft.;
Stream 100 ft.; Pressure Line 160 ft.
Property Line 100 ft.
6. Percolation Rate: 120 minutes/inch

TYPICAL SKETCHES



_____
Signature of Applicant


Lot 2 Blk 2
Lot 1 Blk 2
Badger Dr
Rough Fill
South 75
Barn
Barn
Blacktop
Well
Deck
Lagoon
sewer Line
Water line
Spring
Drain Tile
Electric lines
Gas lines
Access Easment.

P23041-46 COLI 6/3/03

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

RECEIVED MAY 6 2003

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☐ Enclosed is $200.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 7301 BADGER DRIVE LINCOLN NE

Parcel ID 16-22-103-002-000 (i.e. 99-99-999-999-999)

Twp 9N Range 7E Section 22 1/4 ___ 1/4 ___ Block 2 Lot 42 Addition ___

Directions to Property SOUTH ON 70TH ST PAST PINE LAKE ROAD – LEFT ON BADGER DRIVE TO 7301

Location of Well SEE ATTACHED Tap Location: Inside ☒ Outside ☒

Location of Sewage System SEE ATTACHED Year Installed 1975 1976

Site Hazards (dogs, etc.) CALL OWNER AND/OR Gaylord Becker TO ACCESS PROPERTY

	NAME	ADDRESS	PHONE
Present Owner:	WESLEY N & JANIS L DURST	7301 BADGER DRIVE LINCOLN NE 68516	416-6187
Tenant/Buyer:	Terry & Sheryl Dodds	5325 STARLING CT LINCOLN NE 68516	420-1678
Return to:	Gaylord Becker - Woods Bros	7100 SO. 29 LINCOLN NE 68516	432-5589 434-3666 434-3605 (Fax)

Signature of Applicant Sheryl D. Dodds (Buyers) Address 5325 Starling Ct. Lincoln NE 68516 Date 04/30/03

HEALTH DEPARTMENT USE ONLY

RECEIVED Date 5/6/03 Amount $200.00 ✓ Check No. 7287 ✓ Initials MS

DATA ENTRY Date ___/___/___ Case No. ___ Initials ___

PRELIMINARY STATUS--By Jerrold C. Hood **DATE:** 5/7/03

WATER SYSTEM:	Approved	Disapproved
Construction	☐	☒
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ 0.0 ppm	☐ ___ ppm

SEWAGE SYSTEM	
Approved	☐
Provisional	☐
Disapproved	☒

Additional Site Visits

Date 6/3/03 by J.C.H.

Date ___/___/___ by ___

Date ___/___/___ by ___

Comments: NEED WATER PROOF CAP ON WELL, NEED WARNING SIGNS + LOCK ON GATE OF LAGOON. 6/3/03 all Corrected. J.C.H.

See Attached Letter ☐

FINAL STATUS

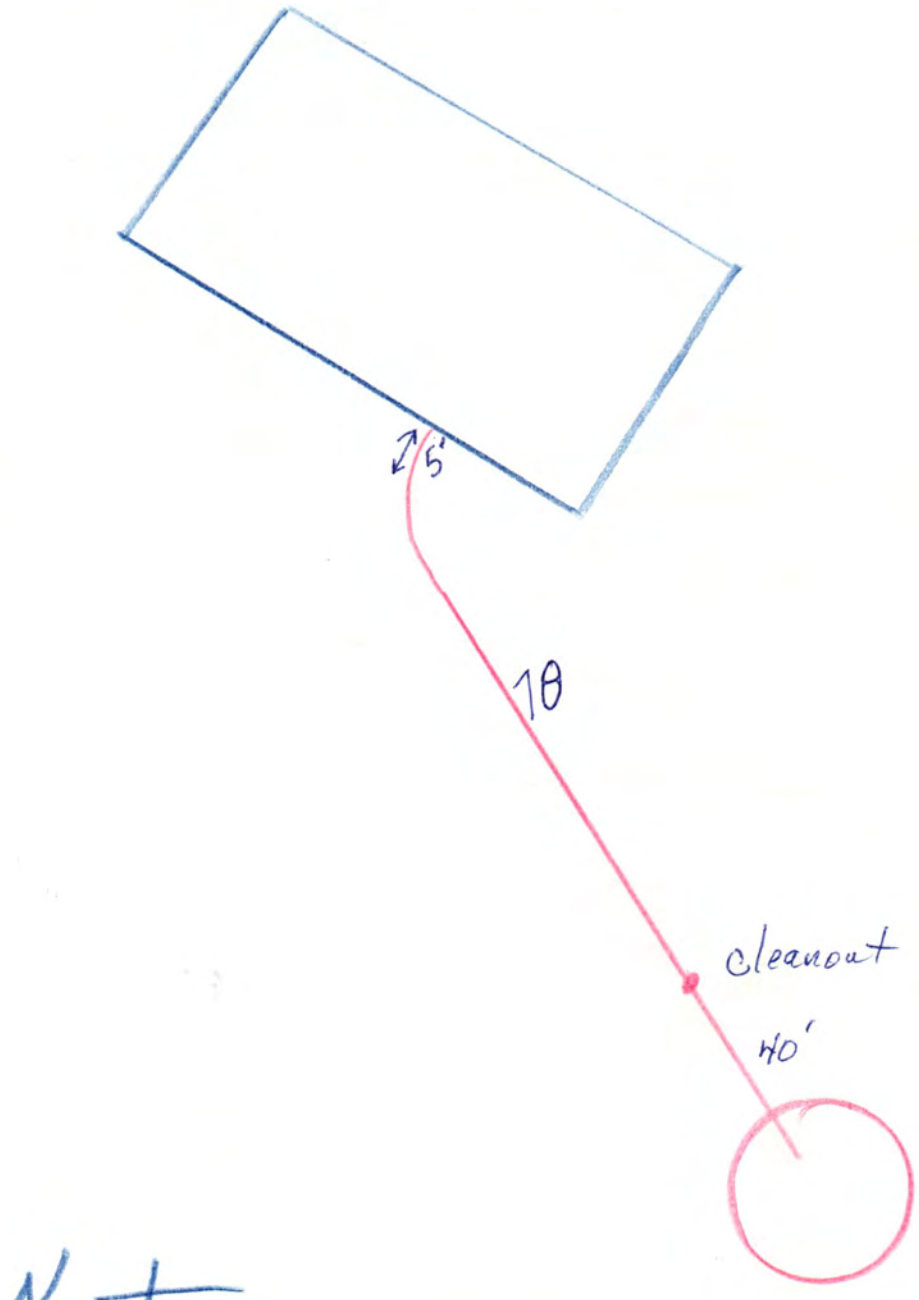
WATER SYSTEM: Approved ☒ **SEWAGE DISPOSAL SYSTEM:** Approved ☒ Provisional Approval ☐

Approved by Jerrold C. Hood R.E.H.S. Date 6/4/03

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 9-00


5'
18
cleanout
40'
N