FILE NO. 456

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

December 11, 1970 — THIS LICENSE OR PERMIT EXPIRES

Willis Rap — LICENSEE OR PERMITTEE

5335 Benton — ADDRESS

T 9N; R 7E; Sect. 22; Block 2; Lot 8; Clarendon Hills First Add. — NAME OF ESTABLISHMENT, IF ANY

Legal Description — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
143-1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-32(67) APPLICATION FOR PERMIT
TO CONSTRUCT INDIVIDUAL SEWAGE
DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 156

DATE: 6-11-70

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N; Range 7E; Section 22;
Block 3; Lot 8; Addition ____;
Street Address Clarendon Hills First addn.

2. Property Use: Residential ____ [X]; Commercial ____ [ ]
No. of Bed Rooms 3
Describe: ____

Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Willis Rapp
Signature of Applicant (owner or lessee)

6335 Benton
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: ____
Filing Fee: $30.00 ____

2. Date Site Clearance ____

3. Site Visits:
Date: 8/31/70 by: J.C.H.
Date: 8/4/70 by: J.C.H.
Date: ____ by: ____

4. Date: Approved [X]; Disapproved [ ]: 6/11/70
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: ____
Date Issued: ____ Serial ____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 8/4/70 by: ~~Jerrold~~ Jerrold C. Hood

*Note: Two tanks collapsed on this job as of 9/29/70. J.C.H.

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 156

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 7E; Section 22;
Block 2; Lot 8; Addition Clarendon Hills First addn
Street Address _____.

2. Property Use: Residential ____ ☒; Commercial ____ ☐
No. of Bedrooms 3. Describe: _____
Other Use ____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: _____ ft.

Willis Rapp
Signature of Applicant (owner or lessee)

6335 Benton St
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 6/11/70. Date Frwd. 6/11/70.
ACTION: Approved ☒ Disapproved ☐
Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 6-11-70. Date Frwd. 6-11-70.
ACTION: Approved ☒ Disapproved ☐
Signature: Chas Leake By Bob Klasinas

3. City Engineer: Date Rec'd. 6-11-70. Date Frwd. 6-11-70.
ACTION: Approved ☒ Disapproved ☐
Signature: J Blessing

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: _____ Signature _____

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 156

PROPERTY WHERE SOIL TESTED:
Location: ~~Township~~ LOT 8 Blk 2 Clarendon Hills
Section & ¼ Sect. _____ Firstaddn
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Owner: Russel Kriesling
Address Rt 8 Lincoln
Soil Type: Silty Clay [X]; Silty Clay Loam [ ]; Sandy Loam [ ]
Silty Loam [ ]; Clay Loam [ ]; Sandy Clay [ ]

Dates of Tests: 6-9-70 to 6-10-70. Weather: Precip. ½" Rain Temp. 75° F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	36	6-9	8:00	6-10	8:00	6-10	8:00	12	9:00	10	30	2	
2	36					6-10		12		10	30	2	
3	36					6-10		12		10¼	30	1¾	
4	36					6-10		12		10	30	2	
5	36					6-10		12		9	30	3	
6	36					6-10		12		10	30	2	

Sum of Percolation Rates 15/1
Average of Rates:
Mean of Rates:

Willis Rapp
Signature of Person Conducting Test

Address 6335 Benton
Phone: 475-1559

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 15 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: June 11, 1970

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 156

SPECIFICATIONS

DATE: 6-11-70


A. BUILDING SEWER:
1. Material Clay; Diameter 4 in.
2. Distance above basement floor ___in.; or below basement floor 8 in.
3. Distance between dwelling and septic tank 100 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material FIBERGLAS; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ___in.
3. Factory Built: Yes [X] (Company Corrugated Fiberglass Co)
No [ ]
4. Manholes: Over Inlet; diam. ___in.
Over Outlet; diam. ___in.
Below Grade ___in.
5. Inlet: Baffle [ ]; or Tee [ ]
6. Outlet: Baffle [ ]; or Tee [ ]
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade 16 in.
8. Distances To:
Well or Suction Line 100 ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line 80 ft.


C. DISTRIBUTION BOX
1. Material Conc; No. available outlets 5.
2. Factory Built: Yes [X], (Company Precast Co) No [ ]
3. Dimension: Length ___in.; Width ___in. Depth ___in.
4. Distance from Septic Tank 4 ft.
5. Serial Distribution: Yes [ ], No [X] (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: FIBERGLASS HALF MOON
2. Lateral Lines: Depth below grade ___in. Number 2; Length of each line 100 ft Total length of Laterals 200 ft.; Slope 4 in/100 ft. Diameter of pipe 16 in.; Shape O
Material: concrete [X]; fiber glas asbestos [ ]; clay [ ]; other ___
Distance between lateral lines 25 ft.
3. Trench Dimensions: Depth ___in.; Width ___in.
4. Filter Material: Road Gravel.
Depth of material from trench bottom ___in.
5. Distances To:
Well or Suction Line 120 ft.;
Stream ___ft.; Pressure Line ___ft.
Property Line 80 ft.
6. Percolation Rate: ___minutes/inch

TYPICAL SKETCHES

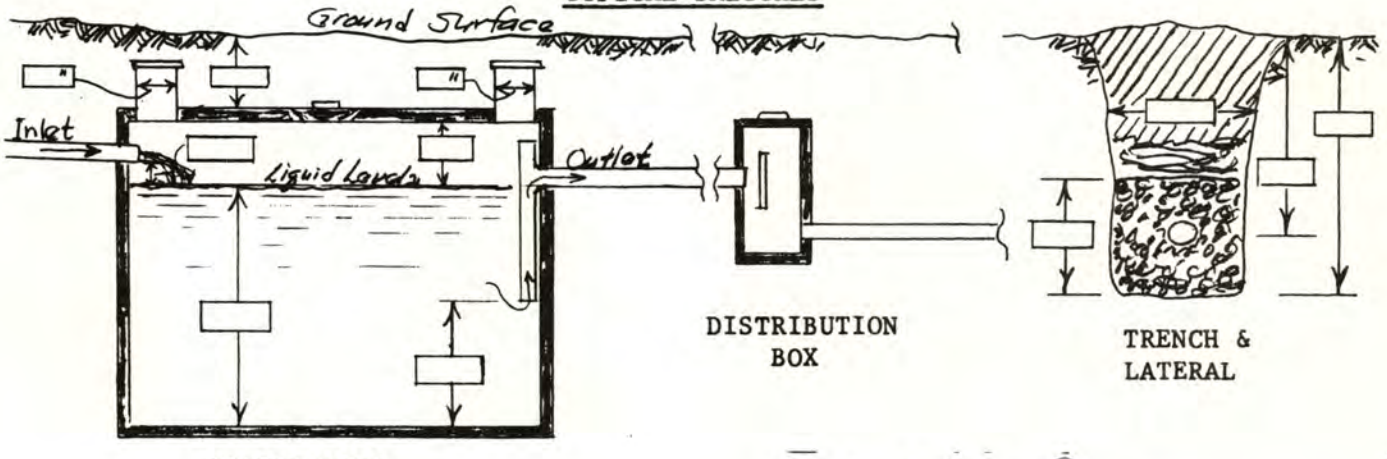

Willis Rapp
Signature of Applicant

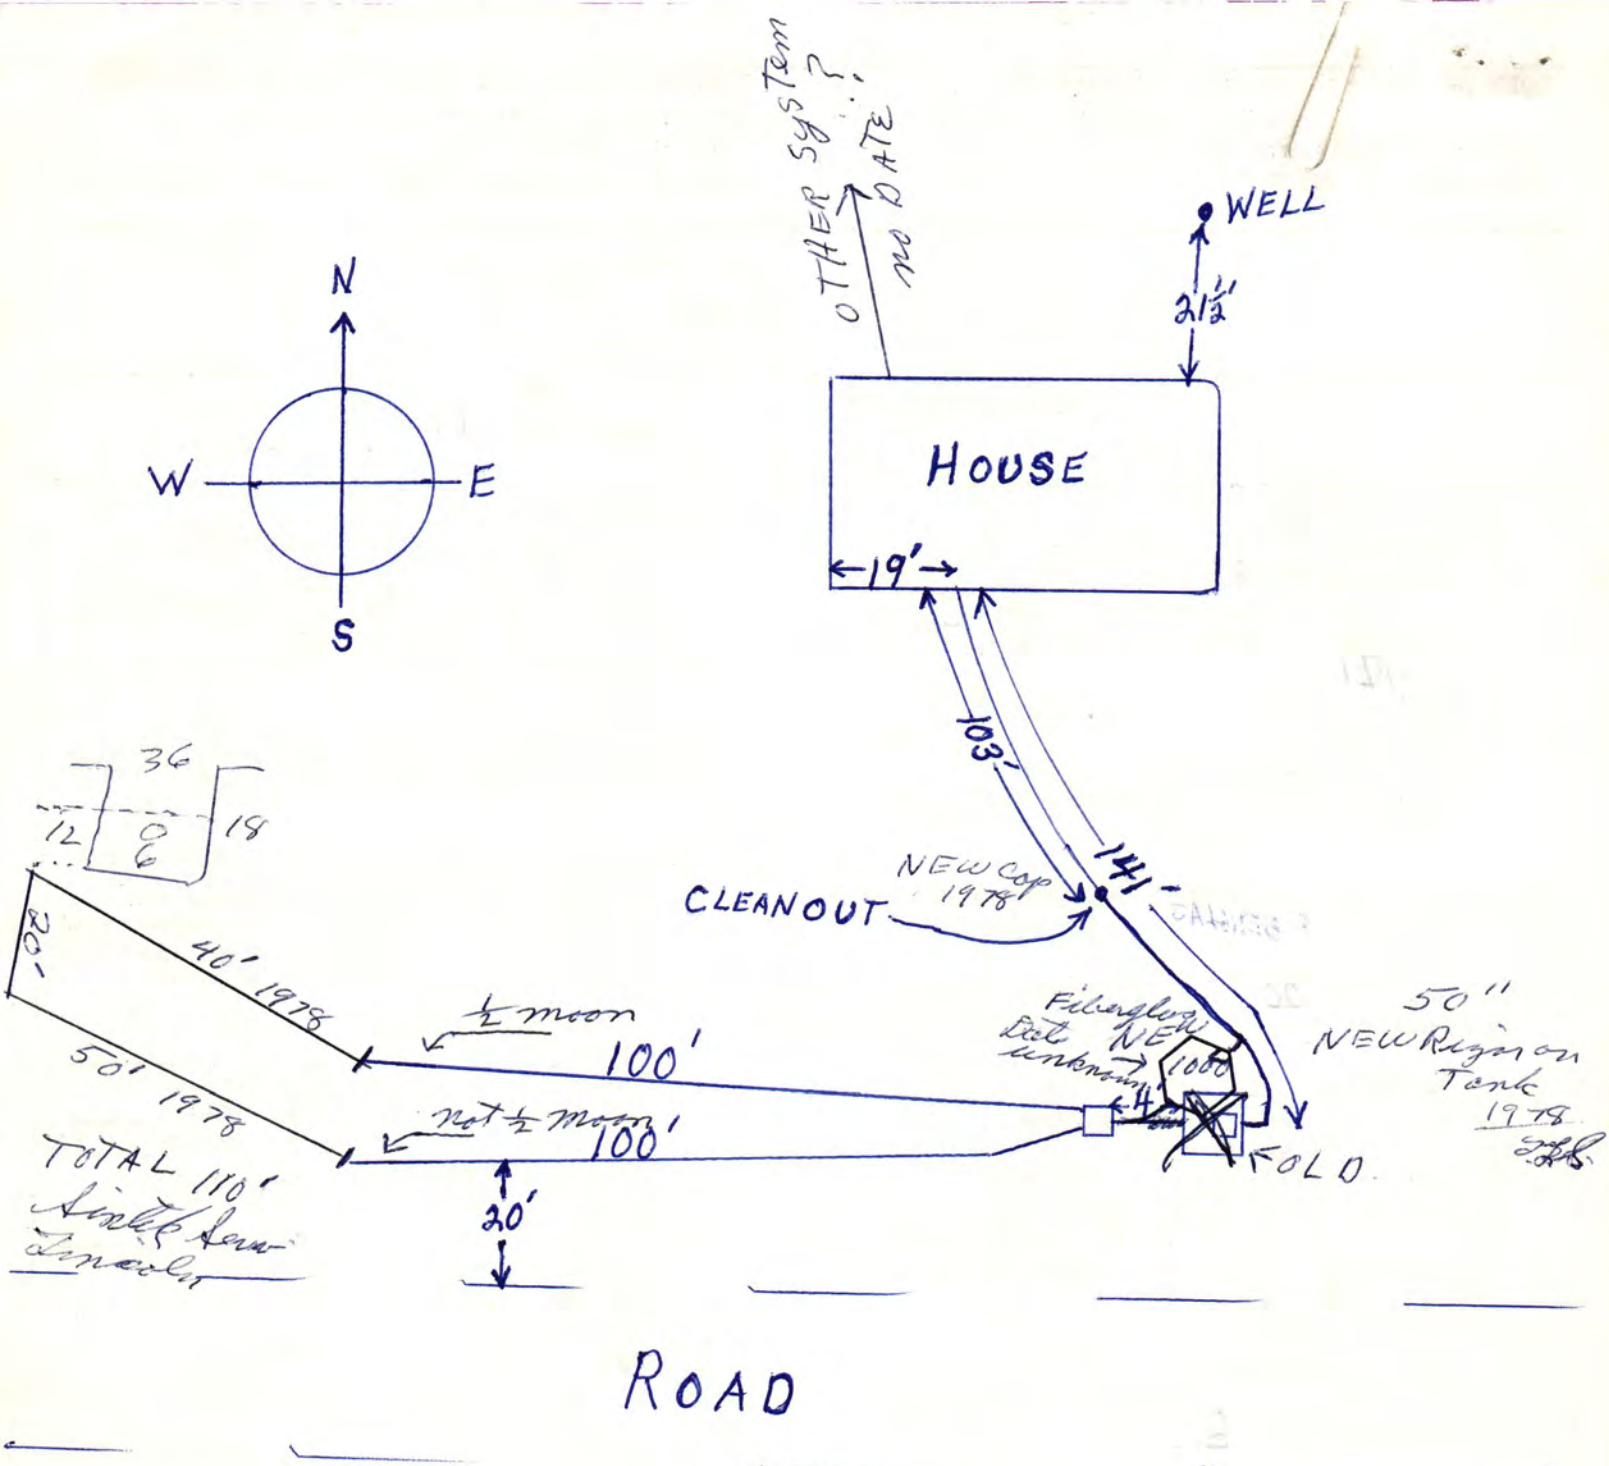
OTHER SYSTEM ? ! no DATE
WELL
21½'
N
W
E
S
HOUSE
19'
103'
141'
NEW cap 1978
CLEANOUT
36
12
0
6
18
20'
40' 1978
½ moon
100'
50' 1978
not ½ moon
100'
TOTAL 110'
20'
Fiberglass Dist NEW unknown
1000
4'
50"
NEW Rigid on Tank 1978
FOLD
ROAD