CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 827

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — November 15, 1976

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

~~T9N~~ Bob Gilliam — Route #7

LICENSEE OR PERMITTEE — ADDRESS

T9N; R7E; Sec. 22; Bl. 3; Lot 3; Clarendon Hills 1st Add.

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
110.15	110.16	148.14	6-2	
SERIAL NO. 624-1535	DATE	AMOUNT		

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION
HEALTH DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 827

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 5-18-76

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9 N ; Range 7E ; Section 22
Block 3 ; Lot 3 ; Addition Clarendon Hills 1st Addition
Street Address _____

2. Property Use: Residential _____ ☒ ; Commercial _____ ☐
No. of Bedrooms 3 . Describe: _____
Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☐

4. Distance to public sewer: _____ ft.

Mrs. Bob Gilliam
Signature of Applicant (Owner or Lessee)

Rt. #7 Lincoln
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 5/18/76 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5/18/75 . Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. _____ . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5-18-76 . Signature: Ernest H. Lemmon

3. City ~~or County~~ Engineer: Date Rec'd. 5-18-76 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 5-18-76 . Signature: Al Long

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 827

DATE: 5-18-76

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9 N ; Range 7E ; Section 22 ; Block ; Lot ; Addition Clarendon Hills 1st Addition.
   Street Address .

2. Property Use: Residential [X]; Commercial [ ]
   No. of Bedrooms 3
   Describe:
   Other Use
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [ ]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Mrs. Bob Gilliam
Signature of Applicant (owner or lessee)

Rt #7 Lincoln
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
   Filing Fee: $ 30.00

2. Site Visits:
   Date: 9-14-76 by: mm
   Date: by:
   Date: by:

3. Date: 5/18/76 Approved [X]; Disapproved [ ]
   by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: 9-14-76 by: Ron Mayfield

9-7-76 7201 Carson Ld Blk 3 Lot 3

1	22	25	27 1/4	28 1/4	29 3/4	31	31 1/2
				1 1/4	1 1/4	1 1/4	1/2
2	20	23	25	26 1/4	27 1/4	28 1/2	29 1/4
				1 1/4	1	1 1/4	3/4
3	19	20 1/2	23 3/4	24 1/2	23	24 1/4	25
				3/4	3/4	1 1/4	3/4
4	13	15 1/2	17 1/4	18 1/4	19	19 3/4	20 1/4
				1	3/4	3/4	1/2
5	15 1/2	17 1/2	19	20	20 3/4	21 3/4	22 1/2
				1	3/4	1	3/4
6	14 1/2	16 1/2	18 1/4	19 1/2	20 1/2	21 1/2	22
				1 1/2	1	1	1/2

$$6\overline{)3.75} = .625$$

48 min / 1 in

9-1-76 Blk 3 Lot 3

7201 Carson Rd (Failed)

1	17½	18¼	19	19¼ (¼)	19½ (¾)	20¼ (0)	20¼
2	15½	16¼	16¾	17¼ (¼)	17½ (¾)	18¼ (0)	18¼
3	16½	17¼	18	18¼ (¼)	18½ (¼)	18¾	
4	21	21¾	22½	22¾ (¾)	23½ (0)	23½	
5	22¾	23¾	24½	24¾ (½)	25¼ (½)	25¾	
6	19¾	20¾	21½	22 (¾)	22¾ (¼)	23	

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. _____

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PVC; Diameter 4 in.
2. Distance above basement floor ___in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 160 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material CoN; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth ___in.
3. Factory Built: Yes ☐ (Company PRECAST
No ☐
4. Manholes: Over Inlet; diam. ___in.
Over Outlet; diam. ___in.
Below Grade ___in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade 6 in.
8. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.


C. DISTRIBUTION BOX
1. Material CoN; No. available outlets 5.
2. Factory Built: Yes ☐, (Company ___
PRE CAST No ☐
3. Dimension: Length 24 in.; Width 12 in. Depth 12 in.
4. Distance from Septic Tank 3 ft.
5. Serial Distribution: Yes ☐, No ☐
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: 4" Plastic
2. Lateral Lines: Depth below grade 18 in.
Number 4; Length of each line 100 ft
Total length of Laterals 310 ft.; 100
Slope 0 in/100 ft. Diameter of pipe 4 in.; Shape Round
Material: concrete ☐; fiber asbestos ☐; clay ☐; other Plastic
Distance between lateral lines ___ft.
3. Trench Dimensions: Depth 30 in.; Width 36 in.
4. Filter Material: Gravel.
Depth of material from trench bottom 14 in.
5. Distances To:
Well or Suction Line ___ft.;
Stream ___ft.; Pressure Line ___ft.
Property Line ___ft.
6. Percolation Rate: ___minutes/inch

TYPICAL SKETCHES

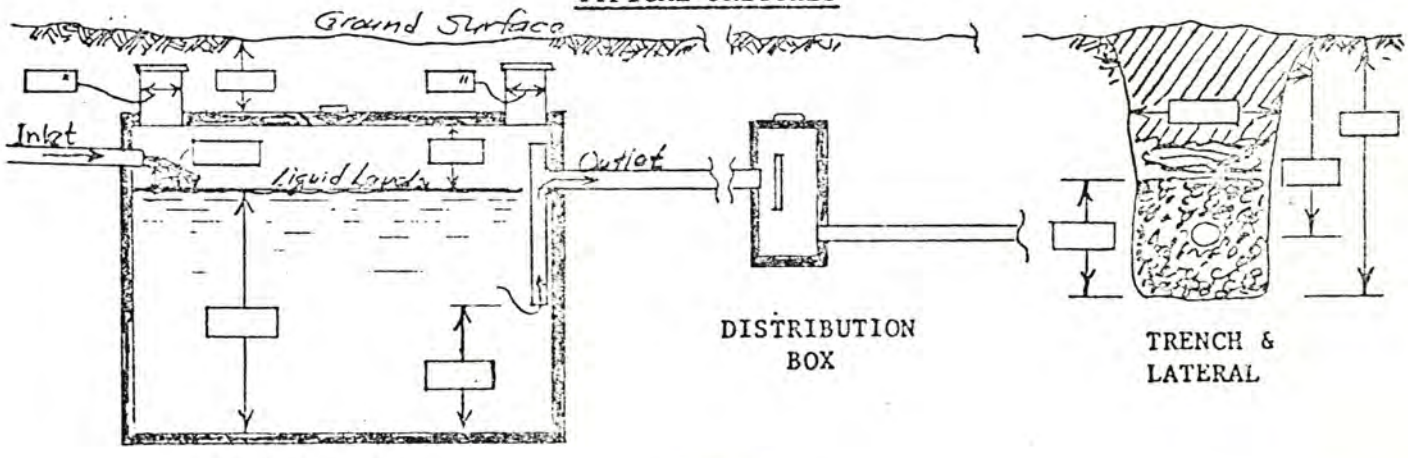

Signature of Applicant

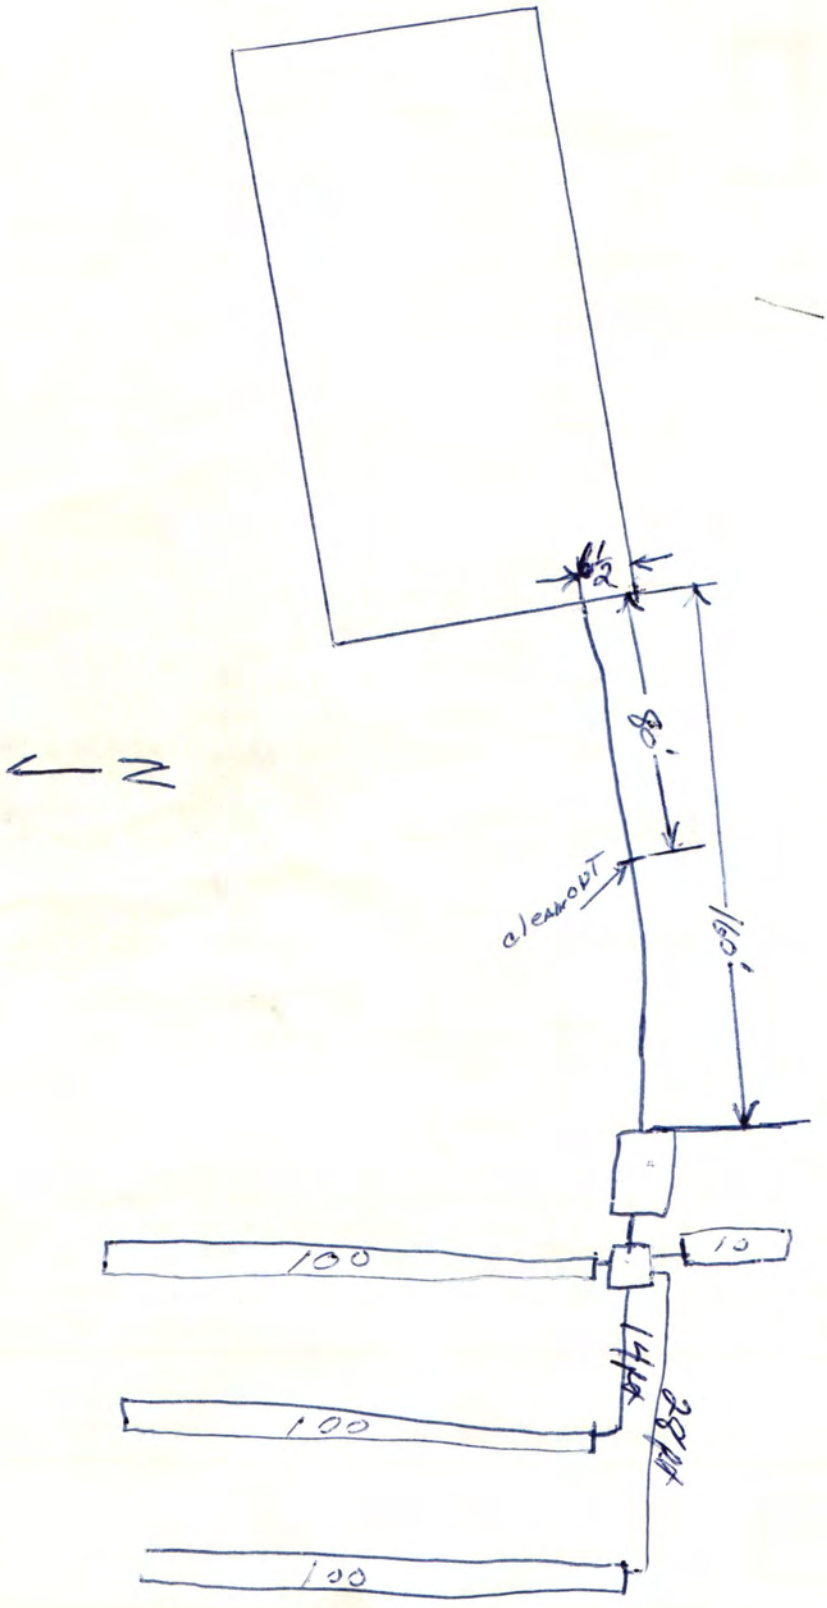

9-11-76

Harold Clement