CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 191

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — October 27, 1971

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Larry Allgood — 1534 South 23rd Street

LICENSEE OR PERMITTEE — ADDRESS

T9N; R7E; Sec. 22; Bl. 4; Lot 2; Clarendon Hills First Addition

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 191

DATE: 4-27-71

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 22 ;
Block 4 ; Lot 2 ; Addition CL Rendow Hills First Addition
Street Address _____.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 3 Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Larry D. Allgood
Signature of Applicant (owner or lessee)

1534 South 23rd
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $30.00 _____

2. Date Site Clearance _____

3. Site Visits:
Date: 7/26/71 by: J.C.H.
Date: 7/27/71 by: J.C.H.
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 4/27/71
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL *
Date: 7/27/71 by: Jerrold C. Hood

* PROVISIONAL EXPERIMENTAL SYSTEM

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 191

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 7E; Section 22;
Block 4; Lot 2; Addition CLARENDON HILLS 1ST ADDITION
Street Address _____.

2. Property Use: Residential ____ ☒; Commercial ____ ☐
No. of Bedrooms 3. Describe: _____
Other Use ____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: _____ft.

Larry S. Allgood
Signature of Applicant (owner or lessee)

1534 South 23rd
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 4/27/71. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 4/27/71. Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 4-27-71. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 4-27-71. Signature: Chas Seals BI.

3. City Engineer: Date Rec'd. _____. ACTION: Approved ☑ Disapproved ☐
Date Frwd. 4-28-71. Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: _____ Signature _____

FORM HD-33(67) SOIL ABSORPTION
TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 191

PROPERTY WHERE SOIL TESTED:
Location: Township _____
Section & ¼ Sect. _____
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: _____
Address _____

Dates of Tests: 4-22-71 to 4-23-71. Weather: Precip. PC Temp. 60 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Start Time (Hr. Min.)	End Date (Mo. Day)	End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Start Time (Hr. Min.)	Start Water Level (in.)	End Time (Hr. Min.)	End Water Level (in.)	Results Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	29	4/22	6:30	4/23	6:30	4/23	6:30	25	10:30	23	4 hr	2	30 - 1/8
2	29	″	″	″	″	″	″	23	″	23½	″	1½	30 - 1/4
3	28	″	″	″	″	″	″	24	″	22	″	2	30 - 1/4
4	29	″	″	″	″	″	″	24	″	22	″	2	30 - 1/8
5	27	″	″	″	″	″	″	23	″	21	″	1	30 - 1/4
6	28	″	″	″	″	″	″	24	″	22½	″	1½	30 - 1/4

D. Tanner
Signature of Person Conducting Test

Address 4142 Adams
Phone: 434-0738

Sum of Percolation Rates
Average of Rates:
Mean of Rates:

(Do not write below this line)

REVIEWING ACTION

REMARKS: Too slow for regular system. System will have to be modified.

DATE: April 26, 1971

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 191

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank 50 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material CON; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 47 in.
3. Factory Built: Yes ☒ (Company PRE-CAST STEP) No ☐
4. Manholes: Over Inlet; diam. 6 in.
Over Outlet; diam. 6 in.
Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.


C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length 20 in.; Width 14 in. Depth 12 in.
4. Distance from Septic Tank ____ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: C-CRETE
2. Lateral Lines: Depth below grade ___in. Number 3; Length of each line 100 ft Total length of Laterals 300 ft.; Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape O
Material: concrete ☒; fiber asbestos ☐; clay ☐; other _____
Distance between lateral lines ____ft.
3. Trench Dimensions: Depth 36 in.; Width 72 in.
4. Filter Material: GRAVEL.
Depth of material from trench bottom _____in.
5. Distances To:
Well or Suction Line ____ft.;
Stream _____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

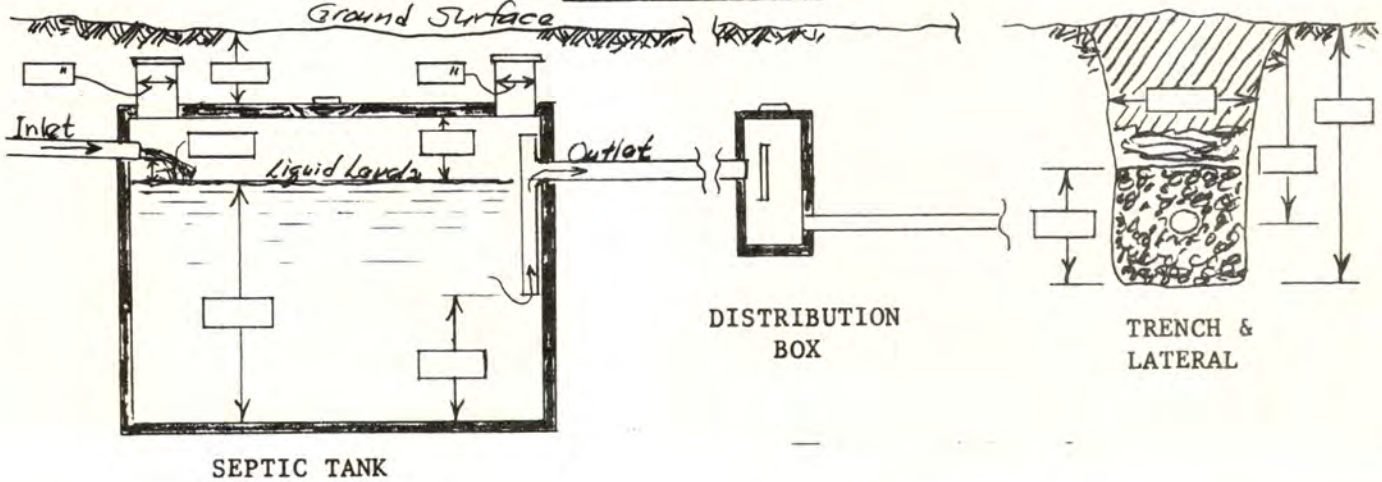

Signature of Applicant

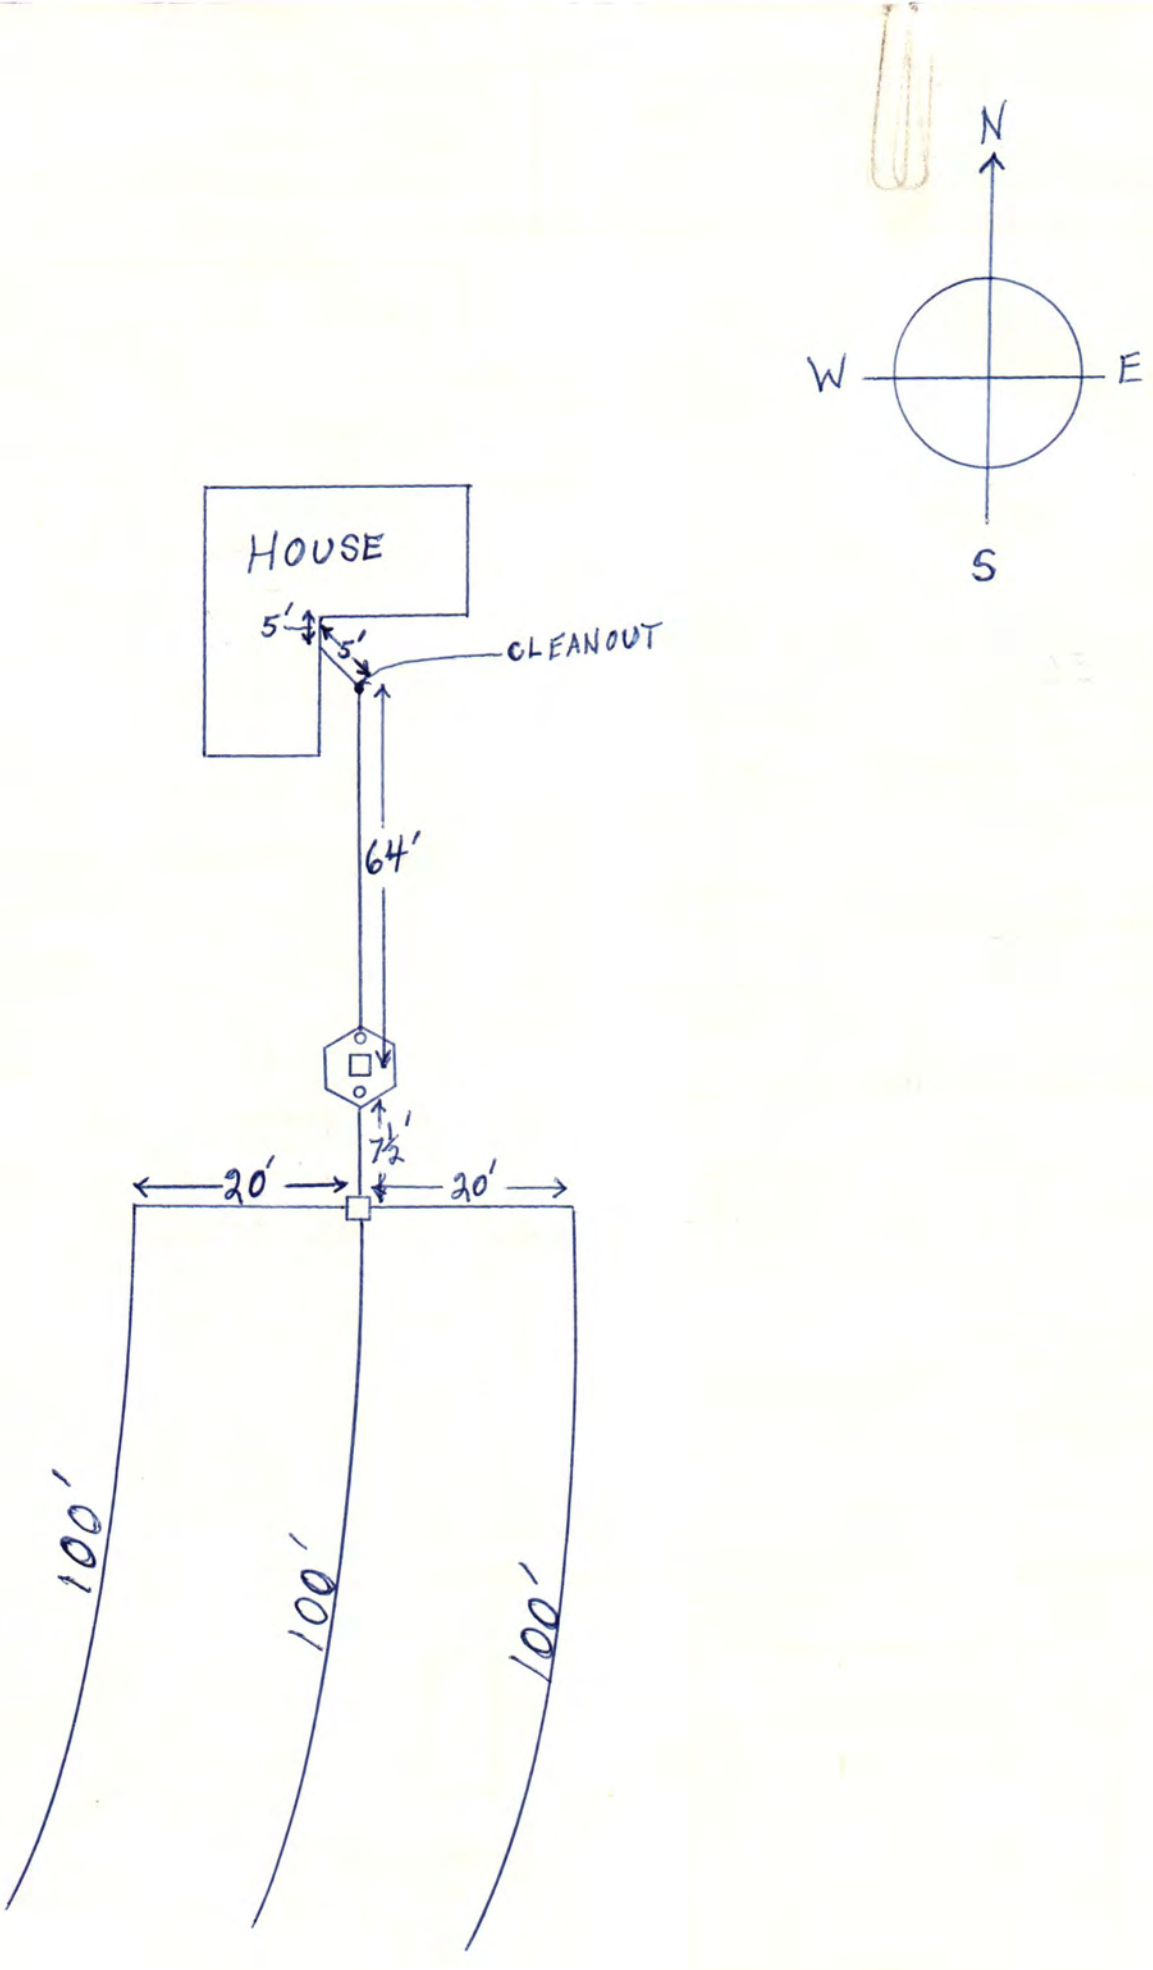
N
W
E
S
HOUSE
5'
5'
CLEANOUT
64'
7½'
20'
20'
100'
100'
100'

001

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☑ Evaluation of the Individual Water System Date: 9-15-92

☑ Evaluation of the Sewage Disposal System ☑ Enclosed is $150.00

Legal Description of Property: TWP. 9N ; RANGE 7E ; SECTION 22 ; BLOCK 4

LOT 2 ; ADDITION CLARENDON HILLS 1ST LINCOLN ; Street Address 7600 SOUTH 75TH LINCOLN NE

Directions to Property HWY 2 TO PINE LAKE RD., SOUTHWEST TO 75TH THEN SOUTH ON 75TH TO 7600 So. 75TH (HOUSE ON SE CORNER)

Location of Well NORTH OF HOUSE (SEE SKETCH) Tap Location: Inside ☐ Outside ☑

Location of Sewage System SOUTH OF HOUSE (SEE SKETCH) Year Installed 1971 ±

	NAME	ADDRESS	PHONE
Present Owner:	DEAN EDEN (G.V. COUNTRYMAN) DECEASED:	7600 So. 75TH LINCOLN NE	479-8013 (MOBILE)
~~Tenant~~/Buyer:	DICK & JAN BERGT	3848 SWEETBRIAR LA. 68516	423-1927 (H)
Return to:	DICK BERGT	3848 SWEETBRIAR LA. 68516	486-3232 (W)

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Dick Bergt Address 3848 SWEETBRIAR LA. LINCOLN NE 68516

==========

HEALTH DEPARTMENT USE ONLY

Date Received SEPTEMBER 17, 1992 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 9/18/92

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☐	Date 9/18/92 by J.C.H
Bacteria	☒	☐	Provisional:	☒	Date _____ by _____
Nitrate <0.1PPM	☒	☐	Disapproved:	☐	Date _____ by _____

Comments: SEWAGE SYSTEM IS CONSIDERED EXPERIMENTAL HENCE APPROVAL IS PROVISIONAL. CENTER LATERAL APPEARS TO BE RIGHT AT CAPACITY. IF THE SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY THEN IT SHOULD BE CHECKED TO SEE IF IT IS NEEDED. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☐	Provisional Approval: ☒

APPROVED BY Donald C. Hood R.E.H.D. DATE SEPTEMBER 23, 1992

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

RECEIVED SEP 1 0 1992

RECEIVED SEP 1 0 1992

To: Jerry Hood

Septic field info. is from a Mar 11, 1986 inspection by your office (File no. 191)

Dean Eden is hard to reach – he leaves the house by 9:30 am. They have no phone other than an inexpensive mobile phone 479-8013 with low quality reception

