LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

P E R M I T

ermit
SEWAGE INSTALLATION

No. 93380105501

Issued 08/27/93
Expires 02/27/94
Revenue Code 18754

Establishment
JOHN BERRICK
T9N R7E SEC 22
PORTSCHE HEIGHTS 3RD BLK 1 LOT 3
7740 PORTSCHE LANE

FEES: $150.00

TOTAL $150.00

Permittee
JOHN BERRICK
3431 M ST
LINCOLN NE 68510

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: 8-25-93

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 22 ; 7740 Portsche Lane
   Block 1 : Lot 3 : Addition Portsche Heights, Third Add.
   Street Address 7740 Portsche Lane

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒

4. Distance to public sewer: _____ ft.

Signature of Applicant (Owner or Lessee)

3431 M. St. Lincoln, NE 68510
Address 477-3911

(Do not write below this double line)

1. Health Department: Date Rec'd. 8/25/93. Date Frwd. 8/26/93. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 8/26/93. Date Frwd. 8/26/93. ACTION: Approved ☒ Disapproved ☐ Signature: Gary Spin

3. City or County Engineer: Date Rec'd. 8-26-93. Date Frwd. 8-26-93. ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 12/10/93 by: L.C.H. ~~Need drawing, fence etc~~.
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 6/30/94 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

Nebraska State Health Department
Division of Housing & Environmental Health

SAN 1701

SOIL ABSORPTION TEST DATA REPORT

PROPERTY WHERE SOIL TESTED:
Location: Township T9N, R7E
Section & ¼ Sect. NE¼ SEC 22
Property Dimensions: 300 ft. x 435 ft.
Area: 3.0 acres. (Attach sketch of property showing hole location).

Owner: JOHN BERRICK
Address: ~~1015 S. 48TH STREET~~ 3431 M St.
LINCOLN, NE 68510

Soil Type: Silty Clay ☐ ; Silty Clay Loam ☒ ; Sandy Loam ☐
Silty Loam ☐ ; Clay Loam ☐ ; Sandy Clay ☐

Dates of Tests: 6/2/93 to 6/3/93. Weather: Precip. 0 Temp. 65° F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch
1	25	6/2	4:45P	6/3	9:05A	6/3	9:05A	33 3/4	9:35A	33 13/16	30	1/16	480
2	23	6/2	5:00	6/3	9:08A	6/3	9:08	30 7/16	9:38	30 1/2	30	1/16	480
3	25	6/2	5:15	6/3	9:10	6/3	9:10	29 15/16	9:40	29 31/32	30	1/32	960
4	25	6/2	5:25	6/3	9:12	6/3	9:12	29 1/2	9:42	29 5/8	30	1/8	240
5	27	6/2	5:55	6/3	9:13	6/3	9:13	30 1/16	9:43	30 1/8	30	1/16	480
6	25	6/2	6:10	6/3	9:15	6/3	9:15	30 11/16	9:45	30 3/4	30	1/16	480
7	23	6/2	6:30	6/3	9:20	6/3	9:20	28 15/16	9:50	29 1/16	30	1/8	240

Sum of Percolation Rates 3360
Average of Rates: 480
Inches per minute: 0.002

Stephen A. Merkel, P.E.
Signature of Person Conducting Test

Address 7941 PORTSCHE LANE, LINCOLN, NE 68516
Phone 423-0559

(Do not write below this line)

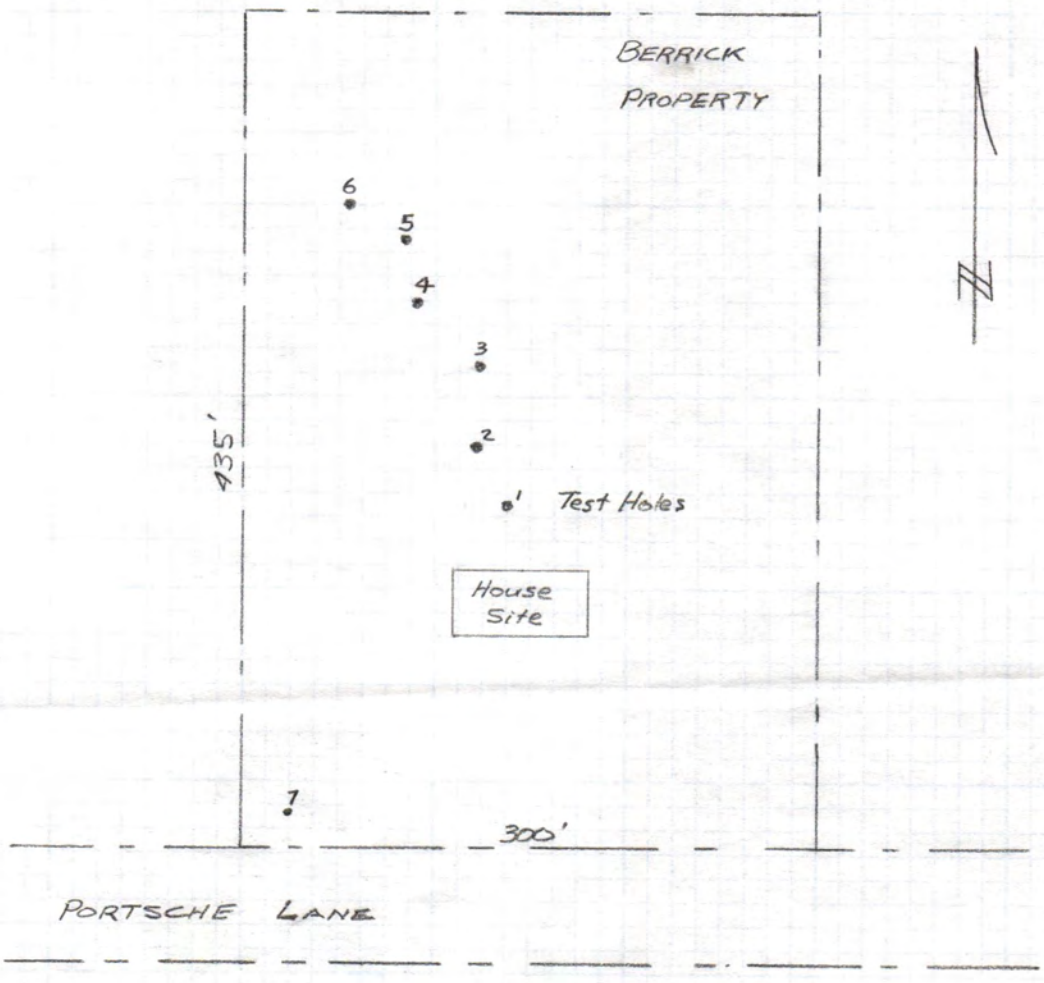
REVIEWING ACTION

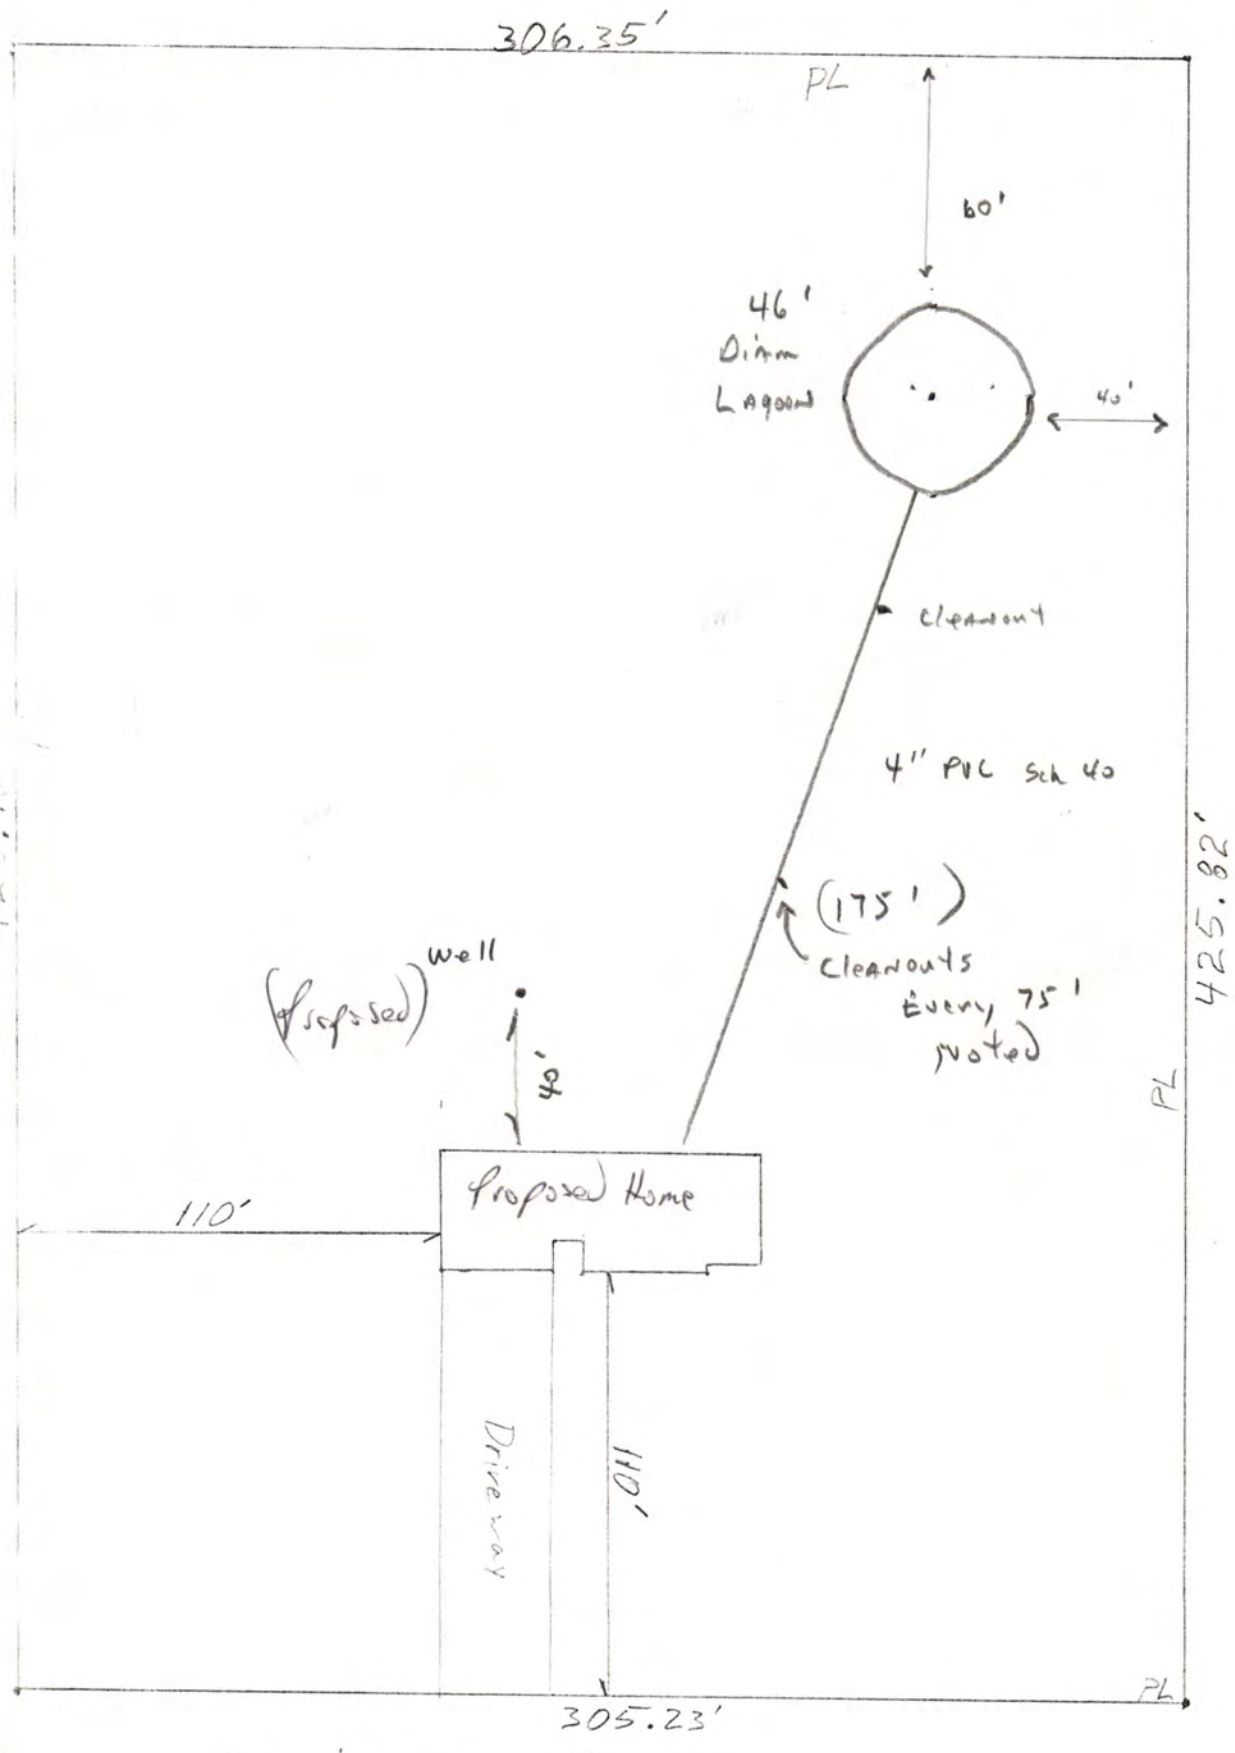
REMARKS: _____

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

DATE: _____

_____
Signature of Reviewing Official


BERRICK
PROPERTY
6
5
4
3
2
1
Test Holes
135'
House
Site
7
300'
PORTSCHE LANE


10'
0.2" = 10'
306.35'
PL
60'
46'
Diam
LAGOON
40'
cleanout
4" PVC Sch 40
(175')
Cleanouts
Every 75'
noted
(proposed) well
40'
425.82'
PL
Proposed Home
110'
Driveway
110'
PL
305.23'
Portsche Lane