FILE NO. 806

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

November 2, 1976
THIS LICENSE OR PERMIT EXPIRES

Mike Kearns
LICENSEE OR PERMITTEE

5419 Prescott
ADDRESS

T9N, R7E, Sec. 29, Lot 11 I.T.
NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
110.15	110.16	148.14	6-2	
624-1535 SERIAL NO.	DATE	AMOUNT		

APPLICATION

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 806

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: May 3, 1976

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 28
Block ____; Lot 1 I.T. ; Addition ____
Street Address RFD 8

2. Property Use: Residential ____ [X] ; Commercial ____ [ ]
No. of Bedrooms 2 . Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X] ; Other [ ]

4. Distance to public sewer: 3 miles ft.

Mike Kearns
Signature of Applicant (Owner or Lessee)

3419 PRESCOTT
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 5/4/76 . ACTION: Approved [X] Disapproved [ ]
Date Frwd. 5/4/76 . Signature: Jerrold C. Hoot

2. Supt. Bldg. Insp.: Date Rec'd. 5-5-76 . ACTION: Approved [ ] Disapproved [X]
Date Frwd. 5-5-76 . Signature: Williamsen

3. City ~~or County~~ Engineer: Date Rec'd. 5-5-76 . ACTION: Approved [X] Disapproved [ ]
Date Frwd. 5-5-76 . Signature: Al Long

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 806

DATE: MAY 3, 1976

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 28 ; Block ; Lot 11 I.T. ; Addition .
Street Address RFD 8 .

2. Property Use: Residential [X]; Commercial [ ]
No. of Bedrooms 2
Describe:
Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Mike Kears
Signature of Applicant (owner or lessee)

5419 PRESCOTT
Address

(Do not write below double line)


REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: 9-20-76 by: rm
Date: 9-30-76 by: jw
Date: by:

3. Date: Approved [X]; Disapproved [ ] 5/4/76
by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 9-30-76 by: James Weverka

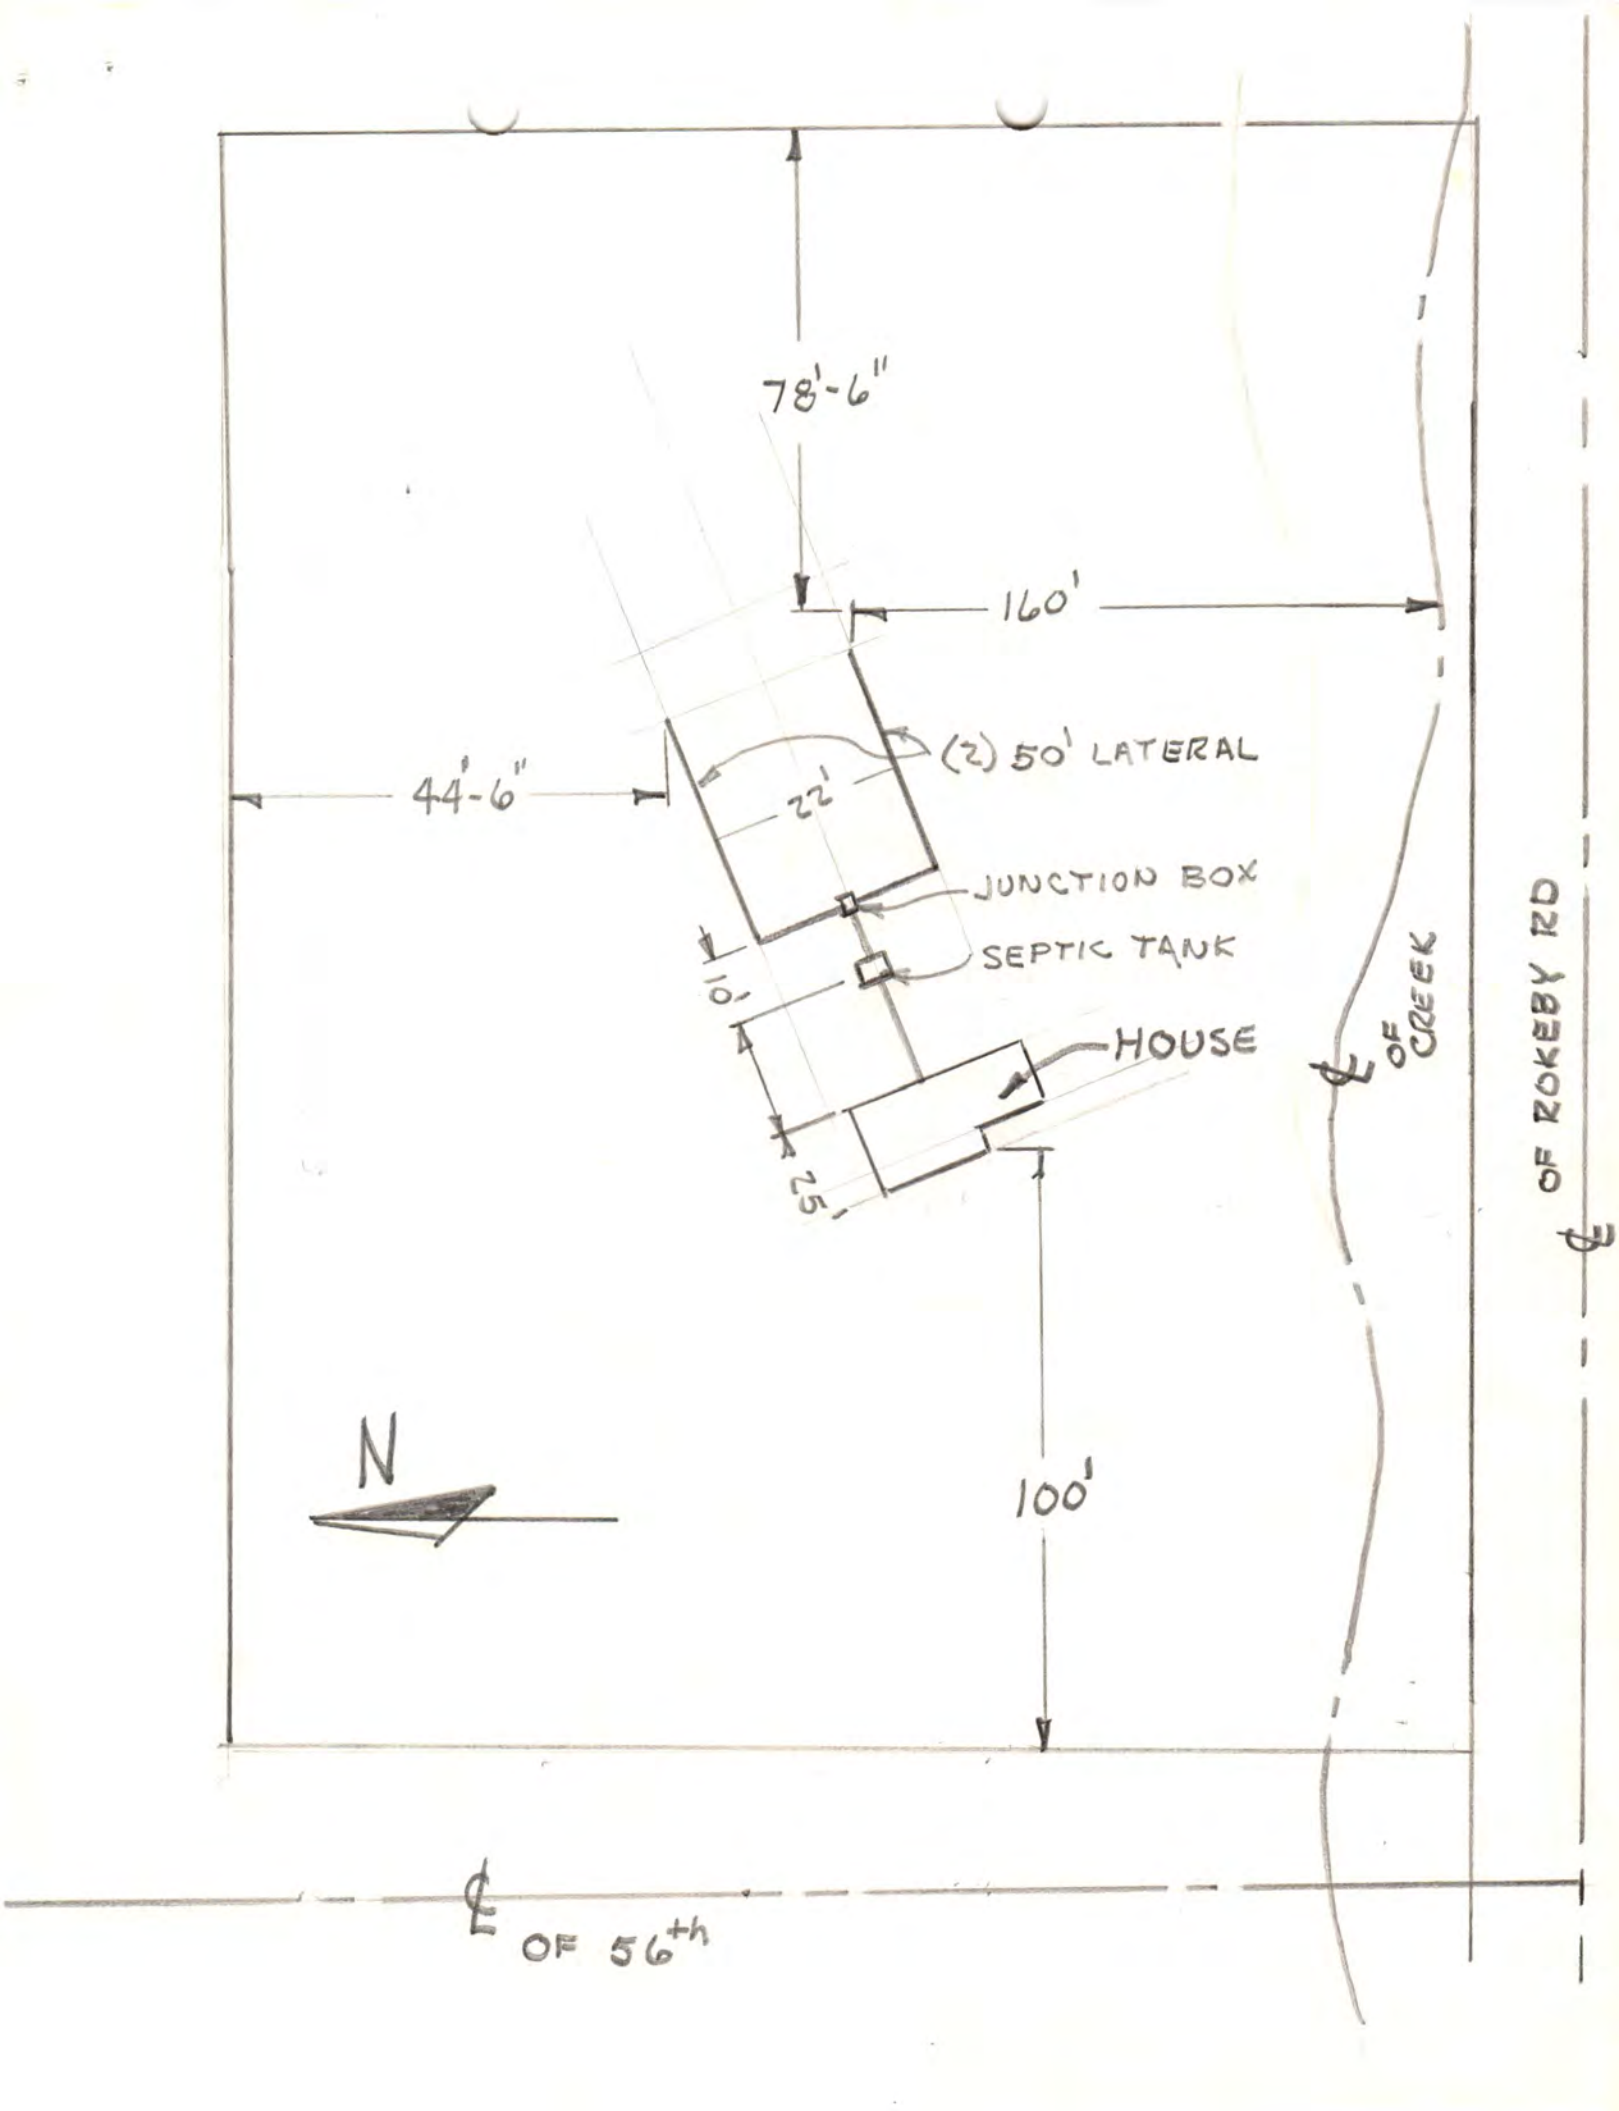
78'-6"
160'
(2) 50' LATERAL
44'-6"
22'
JUNCTION BOX
SEPTIC TANK
10'
HOUSE
25'
N
100'
℄ OF CREEK
℄ OF ROKEBY RD
℄ OF 56th

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISP[illegible]L SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division o[illegible]nvironmental Health
2200 St. Ma[illegible]ys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. _____

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material Pla ; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor 18 in.
3. Distance between dwelling and septic tank 33 ft.
4. Number of clean-outs 1 inside
5. Distances To:
Well or Suction Line 100 ft.;
Stream 80 ft.; Pressure Line 60 ft.;
Property Line 100 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Conc; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 51 in.
3. Factory Built: Yes ☒ (Company Pre)
No ☐
4. Manholes: Over Inlet; diam. 6 in.
Over Outlet; diam. 6 in. 14" center Grade
Below Grade 60 in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☒; or Tee ☐
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 62 in.
8. Distances To:
Well or Suction Line 100 ft.;
Stream 80 ft.; Pressure Line 60 ft.;
Property Line 70 ft.

C. DISTRIBUTION BOX
1. Material Conc; No. available outlets 6.
2. Factory Built: Yes ☒, (Company Pre) No ☐
3. Dimension: Length 18 in.; Width 10 in. Depth 12 in.
4. Distance from Septic Tank 7 ft.
5. Serial Distribution: Yes ☒, No ☐ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Perforated Pla
2. Lateral Lines: Depth below grade 36 in.
Number 2; Length of each line 70 ft
Total length of Laterals 133 ft.; 63
Slope 3 in/100 ft. Diameter of pipe 4 in.; Shape round
Material: concrete ☐; fiber asbestos ☐; clay ☐; other Pla
Distance between lateral lines 10 ft.
3. Trench Dimensions: Depth 36 in.; Width 36 in.
4. Filter Material: road gravel
Depth of material from trench bottom 12 in.
5. Distances To:
Well or Suction Line 100 ft.;
Stream 100 ft.; Pressure Line 80 ft.
Property Line 30 ft.
6. Percolation Rate: _____ minutes/inch

TYPICAL SKETCHES

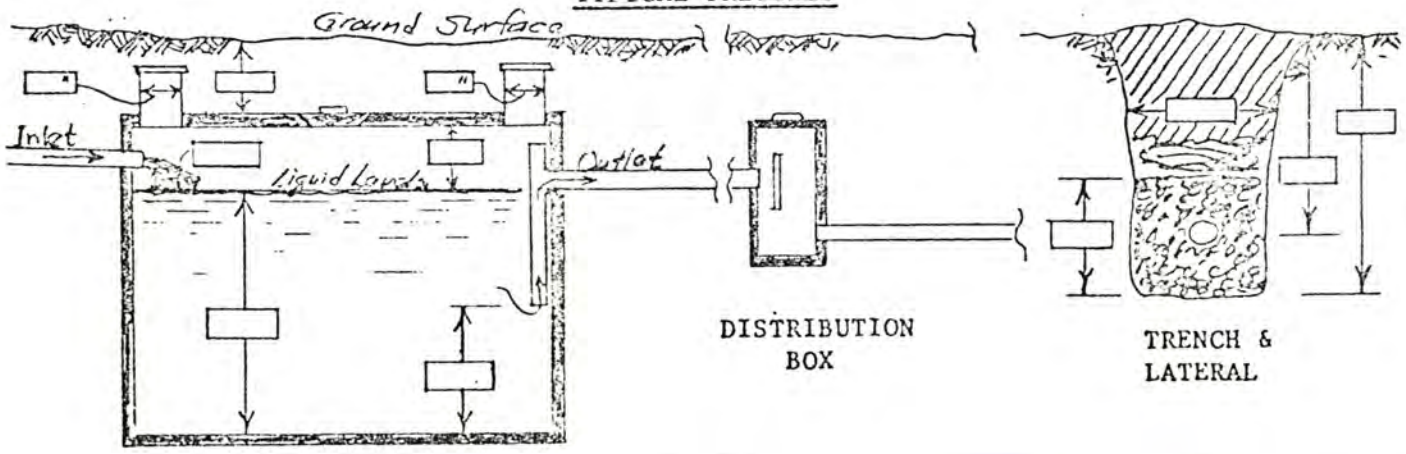

Mike Kearns
Signature of Applicant

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☒ Enclosed is $200.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 5600 Roberts Rd Firth NE

Parcel ID 16-24-300-005-000 (i.e. 99-99-999-999-999)

Twp 9N Range 7E Section 28 1/4 1/4 Block Lot Addition

Directions to Property take 56th St South approx 2.5 miles south of old Denney Rd on corner of Roberts Rd & 56th St. (east side of Rd)

Location of Well NW corner of House in circle Tap Location: Inside ☐ Outside ☐

Location of Sewage System S.E corner of House Year Installed

Site Hazards (dogs, etc.)

	NAME	ADDRESS	PHONE
Present Owner:	Richard & Linda Kearn	9800 S. 56th Lincoln, Ne 68516	
Tenant/Buyer:	Kristine Tuchsbury	3800 S. 48th St Lincoln, Ne 68506	
Return to:	Charlene Reil Why USA Harrington	107 Wellywood Dr Lincoln, Ne 68510	(Fax)

Signature of Applicant Address 3800 S. 48th Lincoln, Ne. 68506 Date 09/01/04

HEALTH DEPARTMENT USE ONLY

RECEIVED Date 9/2/04 Amount 200.00 Check No. 1058 Initials TW

DATA ENTRY Date / / Case No. Initials

PRELIMINARY STATUS--By Ron Marquart **DATE:** 9/2/04

WATER SYSTEM:	Approved	Disapproved	**SEWAGE SYSTEM**		**Additional Site Visits**
Construction	☒	☐	Approved	☒	Date / / by
Bacteria	☒ 0 /ml	☐ /ml	Provisional	☐	Date / / by
Nitrate	☒ 0.4 ppm	☐ ppm	Disapproved	☐	Date / / by

Comments: Recommend checking to see if septic tank needs pumping and that septic tank is watertight.

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved ☒ **SEWAGE DISPOSAL SYSTEM:** Approved ☒ Provisional Approval ☐

Approved by Ron Marquart R.S Date 9/6/04

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 9-00

Well

Fence

N

