FILE NO. 1029

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

October 13, 1977
THIS LICENSE OR PERMIT EXPIRES

Marlyn Schwartz
LICENSEE OR PERMITTEE

Route 8, Lincoln, NE 68506
ADDRESS

T9N, R7E, Section 28
NAME OF ESTABLISHMENT, IF ANY

legal description
ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
43648	OCT 13 77	30.00 -

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1029

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: April 11, 1977

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

SEE ATTACHED

1. Legal description of property: Twp. 9 N ; Range 7E ; Section 28
Block _____; Lot _____; Addition _____
Street Address _____

2. Property Use: Residential _____ ☒ ; Commercial _____ ☐
No. of Bedrooms 4 . Describe: _____
Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: 2 miles ft.

Marilyn Schwartz
Signature of Applicant (Owner or Lessee)

Rt 8 Lincoln, Neb.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 4/13/77 . Date Frwd. 4/13/77 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Wood

2. Supt. Bldg. Insp.: Date Rec'd. 4-13-77. Date Frwd. _____ . ACTION: Approved ☒ Disapproved ☐ Signature: Tom Baasch

3. City ~~or County~~ Engineer : Date Rec'd. 4-13-77 . Date Frwd. 4-13-77 . ACTION: Approved ☒ Disapproved ☐ Signature: M. Long

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1029

DATE: April 11, 1977

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto. SEE ATTACHED

1. Legal description of property: Twp. 9N ; Range 7E ; Section 28 ; Block ; Lot ; Addition .
   Street Address .

2. Property Use: Residential [X]; Commercial [ ]
   No. of Bedrooms 4
   Describe:
   Other Use
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Marlyn Schwartz
Signature of Applicant (owner or lessee)

Rt 8 Lincoln, Nebr.
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
   Filing Fee: $ 30.00

2. Site Visits:
   Date: 12-19-77 by: jw
   Date: by:
   Date: by:

3. Date: Approved [X]; Disapproved [ ] 12/13/77
   by: Jerold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: 12-19-77 by: James Weverka

FORM HD-43 (73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 474-1541)

FILE NO. 1029

PROPERTY WHERE SOIL TESTED:
Location: Township 9N : Range 7E
Section & ¼ Sect. 28
Property Dimensions: 305 ft. x 750 ft.
Area: 5+ acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ; Silty Clay Loam ; Sandy Loam
Silty Loam ; Clay Loam ; Sandy Clay

Owner: Marlyn Schwartz
Address: Rt 8 Lincoln

Dates of Tests: April 10 to 11. Weather: Precip. 0 Temp. 75

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36"	4/10	1 PM	4/11	12:30	4/11	12:30		4:00		30	5/8	
2	36"	4/10	1 PM	4/11	12:30	4/11	12:30		4:00		30	1/2	
3	36"	4/10	1 PM	4/11	12:30	4/11	12:30		4:00		30	3/4	
4	36"	4/10	1 PM	4/11	12:30	4/11	12:30		4:00		30	1 1/2	
5	36"	4/10	1 PM	4/11	12:30	4/11	12:30		4:00		30	7/8	
6	36"	4/10	1 PM	4/11	12:30	4/11	12:30		4:00		30	3/4	

Marlyn Schwartz
Signature of Person Conducting Test

Address Rt 8
Phone Lincoln Neb.

Sum of Percolation Rates:
Average of Rates:
Mean of Rates:

(Do not write below this line)

REVIEWING ACTION

REMARKS: Appears to Wymore Silty Clay loam

DATE: April 12, 1977

Approved Percolation Rate (a)
A. 37 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1029

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material _____; Diameter ____ in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank ____ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material FIBERGLASS; No. of compartments 1.
2. Capacity 1250 gals.; Liquid depth ____in.
3. Factory Built: Yes [X] (Company Ingles)
No [ ]
4. Manholes: Over Inlet; diam. ____in.
Over Outlet; diam. ___in.
Below Grade _____in.
5. Inlet: Baffle [ ]; or Tee [ ]
6. Outlet: Baffle [ ]; or Tee [ ]
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

C. DISTRICTION BOX
1. Material _____; No. available outlets _____.
2. Factory Built: Yes [ ], (Company _____
No [ ]
3. Dimension: Length ____in.; Width ___in. Depth ____in.
4. Distance from Septic Tank ____ft.
5. Serial Distribution: Yes [ ], No [ ] (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: _____
2. Lateral Lines: Depth below grade ___in.
Number 3; Length of each line ___ft
Total length of Laterals 27 ft.;
Slope ____in/100 ft. Diameter of pipe ____ in.; Shape _____
Material: concrete [ ]; fiber asbestos [ ]; clay [ ]; other FIBERGLASS
Distance between lateral lines ____ft.
3. Trench Dimensions: Depth ___in.; Width 48 in.
4. Filter Material: _____.
Depth of material from trench bottom _____in.
5. Distances To:
Well or Suction Line ____ft.;
Stream _____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch


TYPICAL SKETCHES

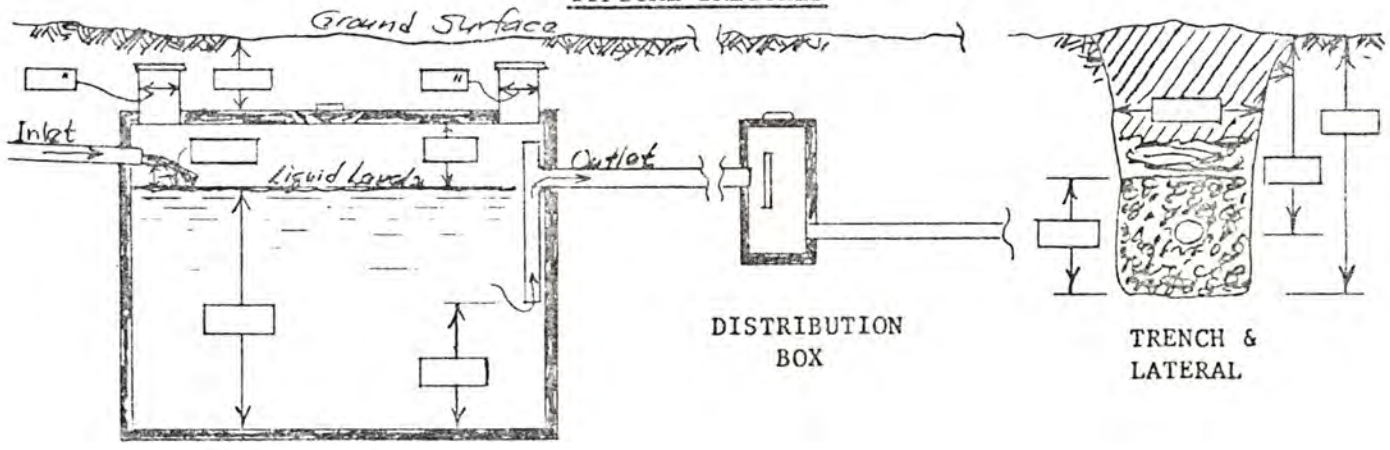

_____
Signature of Applicant

AS BUILT DRAWING OF SYSTEM

DATE DEC 19-77 INSTALLER NORM BERGHUIS

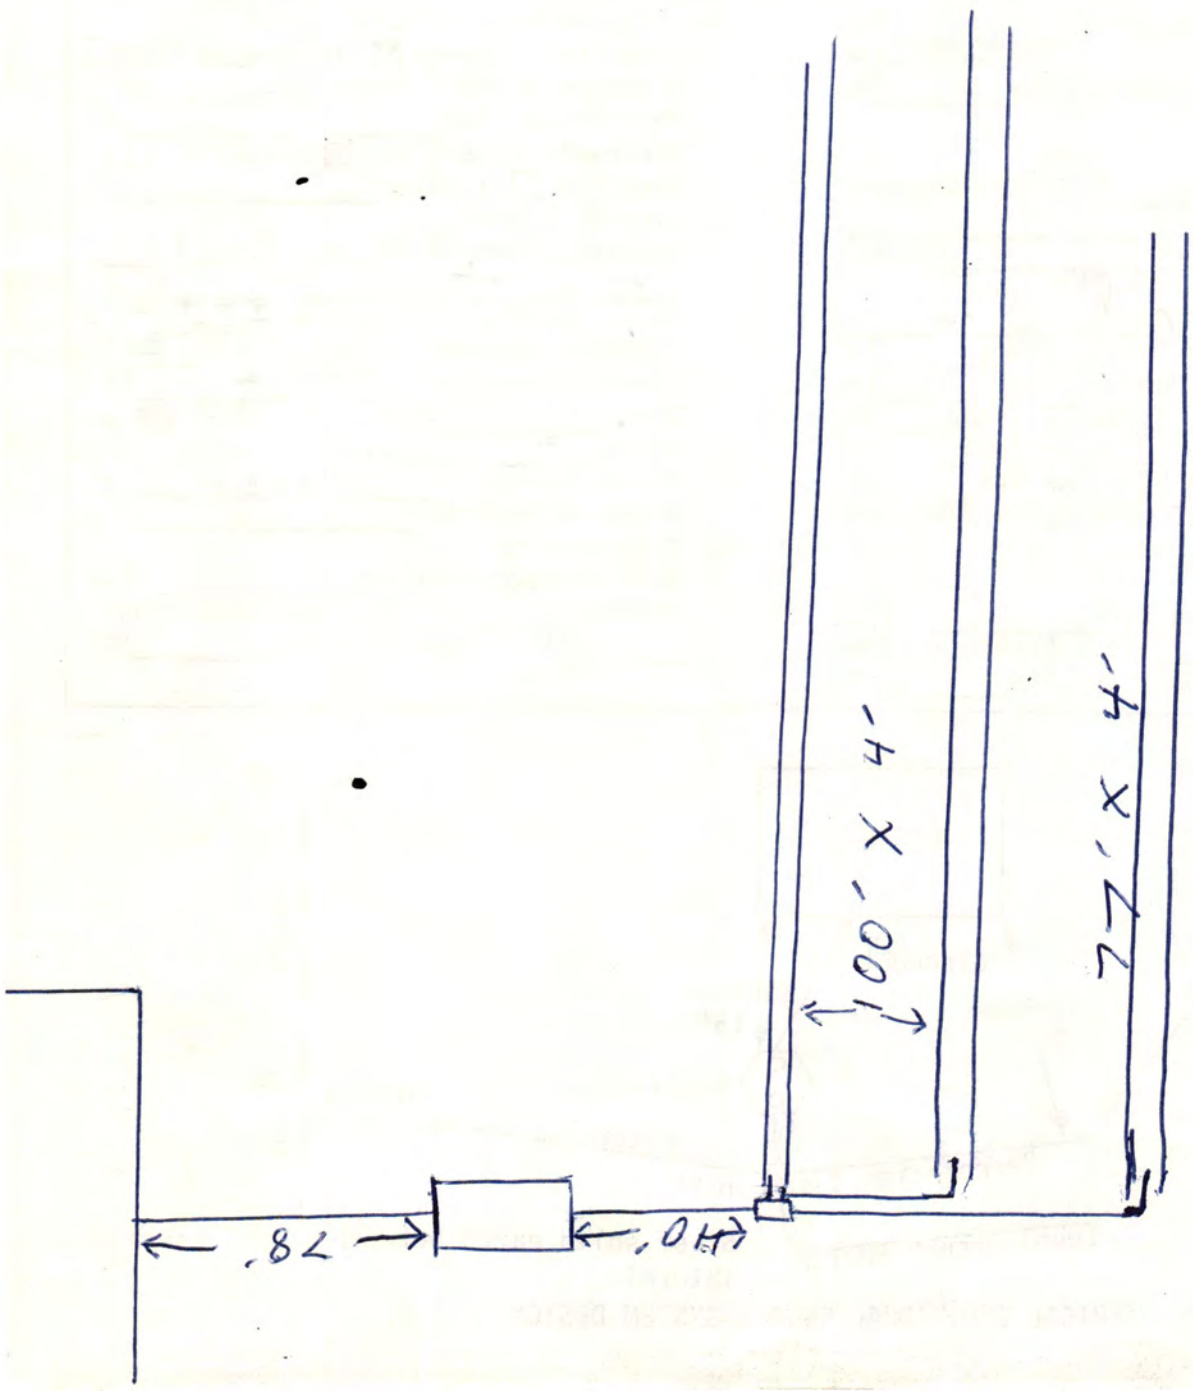

004

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: Aug 29, 1992

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 9N; RANGE 7E; SECTION 28; BLOCK ___

LOT 86; ADDITION _____; Street Address 8700 So 56th Street Lincoln

Directions to Property So South on 56th St. it is the 3rd house east side of street, just past Yankee Hill Rd.

Location of Well directly north of House 30ft Tap Location: Inside ☐ Outside ☒ Hydrant NE of House 35ft

Location of Sewage System 5ft north of deck 30yards East of House Year Installed 1978

	NAME	ADDRESS	PHONE
Present Owner:	Francis Mary Jean Blumenstock	8700 So 56	423-7964
Tenant/Buyer:	refinancing by same owner		
Return to:	Fran & Mary Jean Blumenstock	8700 So 56th	423-7964

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Mary Jean Blumenstock Address 8700 So 56th, Lincoln

We are do to close by Sept 17th.

==========

HEALTH DEPARTMENT USE ONLY

Date Received AUGUST 31, 1992 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE SEPTEMBER 1, 1992

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☒	Date 9/1/92 by J.C.H
Bacteria	☒	☐	Provisional:	☐	Date _____ by ___
Nitrate <0.1 ppm	☒	☐	Disapproved:	☐	Date _____ by ___

Comments: IF THE SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY IT SHOULD BE CHECKED TO SEE IF IT IS NEEDED. YOU MAY WANT TO FILL IN DIPS OVER THE LATERAL TO KEEP SURFACE WATER FROM STANDING IN THEM. See Attached Letter ☐

FINAL STATUS

	WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
	Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Gerald C. Hood R.E.H.S. DATE SEPTEMBER 10, 1992

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832