LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

3140 "N" STREET
NON TRANSFERABLE

ENVIRONMENTAL HEALTH DIVISION
Lincoln, NE 68510-1514
PERMIT

(402) 441-8000

Permit

SEWAGE SYSTEM REPAIR

No. 97390057001

Issued 10/30/97
Expires 04/30/98
Revenue Code 18754

FEES: $50.00

PAID

TOTAL $50.00

Establishment

JOHN STROHMYER
T9N R7E SEC 28
YANKEE RIDGE BLK 2 LOT 2
9201 S 60TH

Permittee

JOHN STROHMYER
6667 SW 48 ST
LINCOLN NE 68524-8909

Gregg Wright MO

Issued By ~~M. Jane Ford~~
Health Director

5390

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

Lincoln-Lancaster County HEALTH DEPARTMENT
3140 "N" STREET LINCOLN, NE 68510-1514

Yankee Ridge Estates

FILE NO. _____

9201 So. 60th Dave Henry

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: Oct. 22 / 1997

The undersigned hereby applies for a permit to ALTER [ ], EXTEND [✓], or REPAIR [ ] an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 18 ;
Block _____ ; Lot _____ ; Addition YANKEE RIDGE ESTATES
Street Address 9201 So. 60th

2. Property Use: Residential X [ ]; Commercial _____ [ ]
No. Bedrooms 3
Describe _____
Other Use [ ]
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Description of proposed alteration, extension or repair: Install new dist. Box and add 100' x 4' wide equalizer lateral

5. Work to be done by: Owner [ ] ; or Contractor [✓], John Strohmeyer
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	1500 00

John Strohmeyer
Signature of Applicant (owner or lessee)

16667 NW 48th LNK 68524
Address

(Do not write below this line)

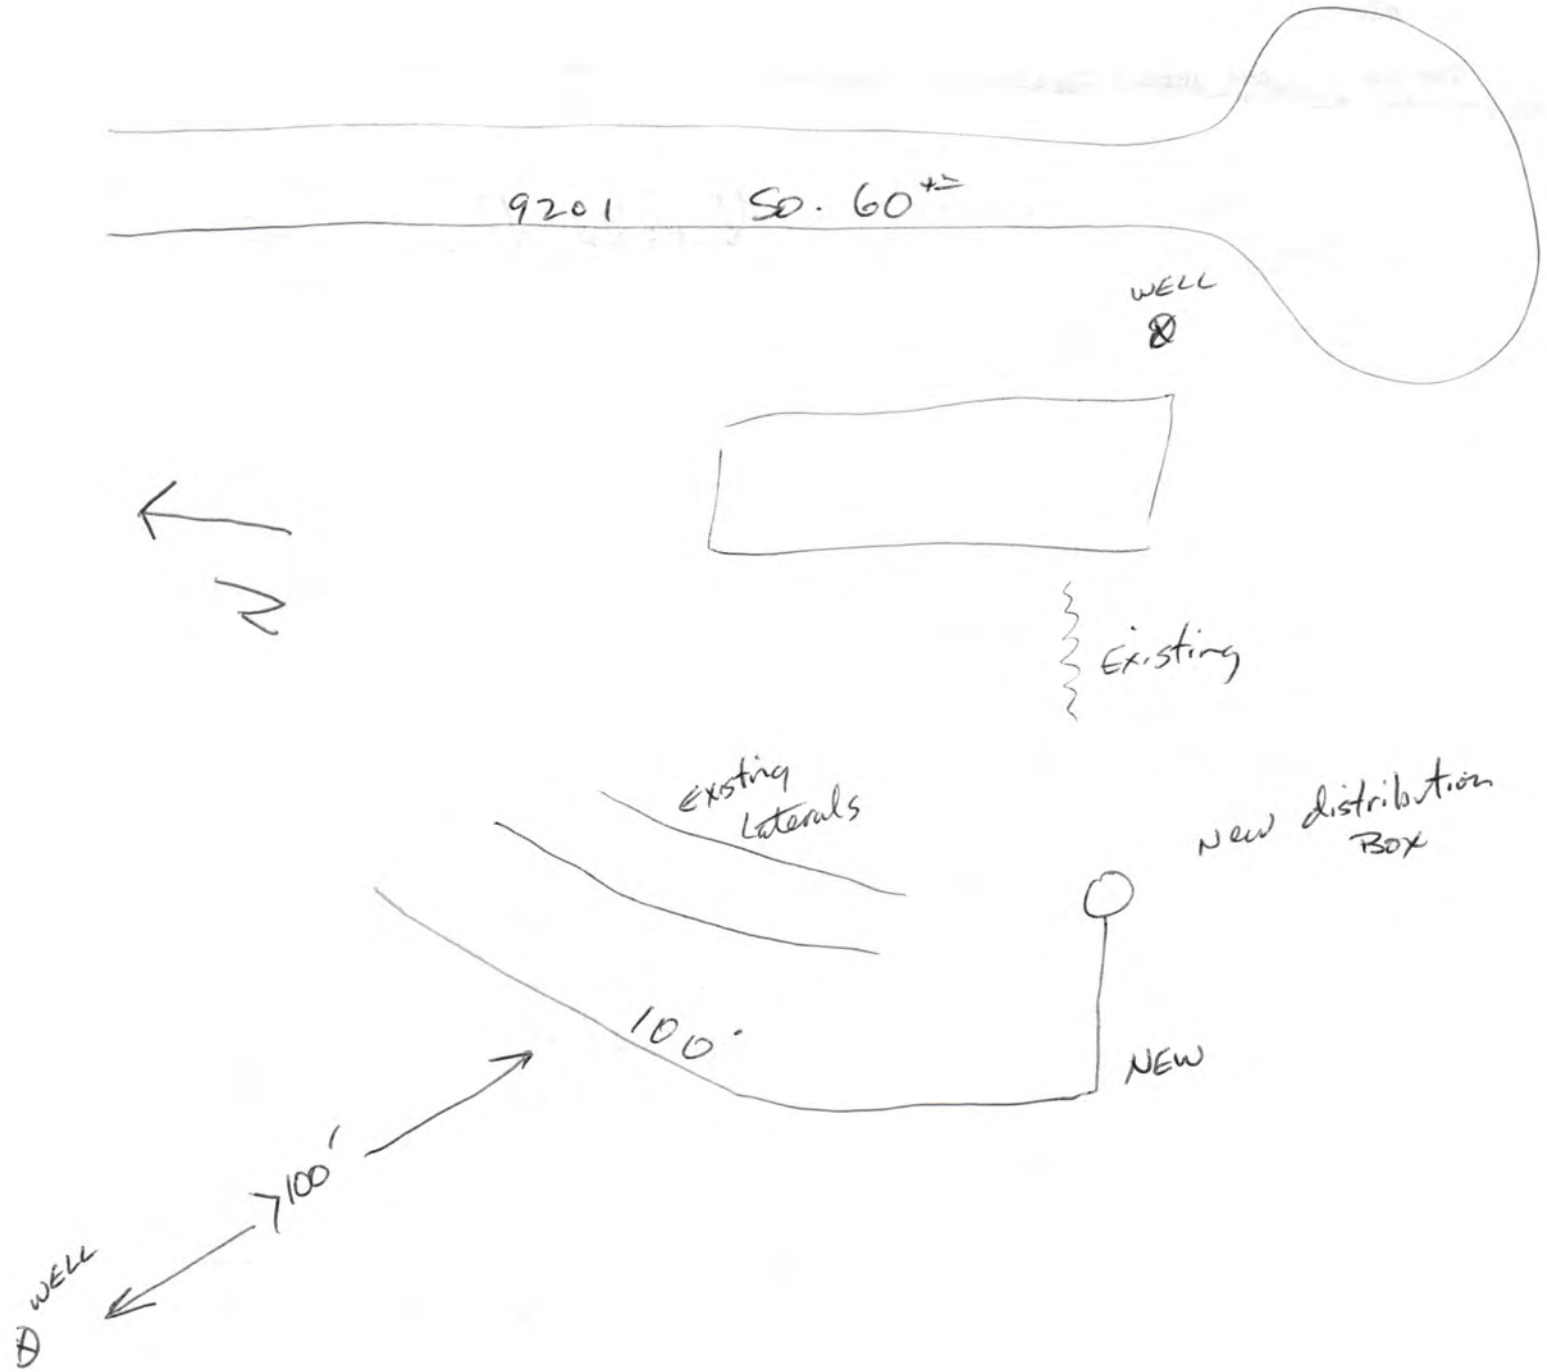
REVIEWING ACTION

1. Date Rec'd: 10/22/97 LO
Filing Fee: $ 50.00 # 8725

2. Site Visits:
Date: 10-22-97 by: P.D
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved [X]; Disapproved [ ]
by: Paul Protzmann

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 10-22-97 by: Paul Protzmann


9201
SD. 60 +/-
WELL
Existing
Existing Laterals
New distribution Box
100'
NEW
7100'
WELL

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

B

Permit Number:

Sewage Disposal System

Soil Absorption Test Data Report

Annex to Application

13.5
= 2.25

PLEASE PRINT OR TYPE

System Location (Indicate correct number and street)

Address 9201 So. 60th (no rural route) City Lincoln NE, Zip

Owner Dave Henry Addresss 9201 S. 60th

Soil Type (SCS): Silty Loam Percolation Rate: 13.44 min./inch

Date of Tests 10/21 to 10/22 Weather: Precipitation dry Temperature 60°

Percolation Test Data Table

A.	B.	C. D. E. F. Pre-Saturation Period				G. H. I. J. K. Percolation Readings					L. M. N. Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Date (Mo/Da)	Time (Hr/Min)	Water Lev (in.)	Date (Mo/Da)	Time (Hr/Min)	Elapsed Time (Min)	Water Level Drop (in)	Percolation Rates (Min/in)
1	24"	10/20	8:00	10/21	11:00	10/21	1:00	6	10/21	1:30	30	2¼	13 MIN/IN
2	22"	10/20	8:00	10/21	11:00	10/21	1:00	6	10/21	1:30	30	2½	12 MIN/IN
3	26"	10/20	8:00	10/21	11:00	10/21	1:00	6	10/21	1:30	30	2	15 MIN/IN
4	24"	10/20	8:00	10/21	11:00	10/21	1:00	6	10/21	1:30	30	2¼	13 MIN/IN
5	26"	10/20	8:00	10/21	11:00	10/21	1:00	6	10/21	1:30	30	2	15 MIN/IN
6	24"	10/20	8:00	10/21	11:00	10/21	1:00	6	10/21	1:30	30	2½	12 MIN/IN

Sum of Percolation Rates: 13.5 80.66

Average of Rates: 2.25 13.44

Rate Used for Calculation: 30 min

Person Conducting Percolation Tests

Name: John Strohmeyer

Phone: 430-6023

Address 6667 N.W. 48th

DO NOT WRITE BELOW THIS LINE

Reviewing Action

Remarks

Signature of Reviewing Official Date

FORM 23-101 10-96

97/12 1001 pd 2.

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 9201 S. 60th

CR000036 Twp 9N Range 7E Section 28 1/4 ___ 1/4 ___ Block 2 Lot 2 Addition Yankee Ridge

Directions to Property South on 56th Street past Yankee Hill Rd. to Rebel Dr. East on Rebel Dr. to 60th St. South on 60th St. one block to 9201.

Location of Well To west side of House Tap Location: Inside ☐ Outside ☐

Location of Sewage System just replaced - spaces would be close Year Installed 1997

	NAME	ADDRESS	PHONE
NCR 2916 Present Owner:	David + Diane Henry	9201 S. 60th Lincoln, NE 68516 ACR 58770	H-423-0788 W-467-4307 David before 2pm
Tenant/Buyer:	Bradley D. + Kristi D. Larson	5910 Drake Cr. Lincoln NE 68516	H-421-7466 W-473-3469-Brad
Return to:	Bradley D Larson	5910 Drake Cr. Lincoln, NE 68516	H-421-7466

Signature of Applicant Bradley D. Larson Address 5910 Drake Cr. Lincoln NE 68516 Date 11/3/97

HEALTH DEPARTMENT USE ONLY

Date Received 11/3/97 Received $150.00 Check ☑ #10642 Cash ☐

PRELIMINARY STATUS--By John Chen **DATE:** 11/06/97

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	☐	☑	Approved ☐	Date 11/18/97 by JC
Bacteria	☑ 0 /ml	☐ ____ /ml	Provisional ☐	Date ___/___/___ by ___
Nitrate	☑ <1 ppm	☐ ____ ppm	Disapproved ☐	Date ___/___/___ by ___

Comments: Sand depressions next to well casing. Electrical conduit needs to be covered / re attached. IF THE SEPTIC TANK HAS NOT BEEN PUMPED RECENTLY, IT should be checked to see if it needs pumped. 11/18/97 - Conduit has been repaired sand depression filled in. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☑ **SEWAGE DISPOSAL SYSTEM** Approved: ☑ Provisional Approval: ☐

Approved by John J Chen Date 11/20/97

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

- Verbal report