LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE INSTALLATION

No. 94380112201

Issued 03/01/94
Expires 09/01/94
Revenue Code 18754

Establishment
DENNIS FREY
T9N R7E SEC 29
KENSINGTON 1ST BLK 2 LOT 6

FEES: $150.00

TOTAL $150.00

Permittee
DENNIS FREY
RR0001
BOX 0088A
HICKMAN NE 68372

RECEIVED MAR 0 1 1994

Issued By M. Jane Ford
Health Director

3238
7

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: _____

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 29 ;
   Block 2 : Lot 6 : Addition Kensington First ADDITION
   Street Address 9400 S. 53rd ST.

2. Property Use: Residential ☑ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☑ ; Other ☐

4. Distance to public sewer: _____ ft. WILL INSTALL WHATEVER SOIL PERCOLATION TEST INDICATES

Dennis Yoy
Signature of Applicant (Owner or Lessee)

RT 1 Box 88A Nickman 68430
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 2/28/94. Date Frwd. 2/28/94. ACTION: Approved ☒ Disapproved ☐ Signature: Jerold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 2/28/94. Date Frwd. 2/28/94. ACTION: Approved ☒ Disapproved ☐ Signature: Kay Spu

3. City or County Engineer: Date Rec'd. 2-28-94. Date Frwd. 2-28-94. ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 5-18-94 by: P.D.
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 5-18-94 By: Paul Drotzmann

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 9 N ; Range 7 E ; Section & ¼ Section 29 .
Property Dimensions: _____ ft. x _____ ft. Area: 3 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☒ ; Clay Loam ☐ .
Dates of Tests: 4-12 to 4-13 . Weather: Precip. — Temp. 69° .

OWNER: B & F Builders Inc

Address: 9400 S. 53rd

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	32"	4-12	9:00	4-13	9:00	4-13	11:00	6"	11:30	4½	30	1½	
2	32"	"	"	"	"	"	"	"	"	4½	"	1½	
3	32"	"	"	"	"	"	"	"	"	4⅜	"	1⅝	
4	32"	"	"	"	"	"	"	"	"	4½	"	1½	
5	32"	"	"	"	"	"	"	"	"	4¼	"	1¾	
6	32"	"	"	"	"	"	"	"	"	4½	"	1½	

Signature of Person Conducting Test

Address Box 181 Elmwood, NE Phone 994-2225

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____

Soil Type (SCS): _____

Date: May 18, 1994

Approved Percolation Rate (a)
A. 18 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO. _____


SPECIFICATIONS AS BUILT

A. BUILDING SEWER:
1. Material PVC ; Diameter 4 in.
2. Distance above basement floor _____ in., or below basement floor 16 in.
3. Distance between dwelling and septic tank 58 ft.
4. Number of clean-outs ① Inside Wall.
5. Distances to: Well or Suction Line 120+ ft.; Stream NA ft.; Pressure Line 30+ ft.; Property Line 20+ ft.

B. SEPTIC TANK:
1. Material Concrete ; No. of compartments 1.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☒ No ☐ (Company Pre-Cast)
4. Manholes: Over Inlet; diam. _____ in. Over Outlet; diam. _____ in. Riser Above ☐ Below ☐ Grade ___ in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 14 in.
8. Distances to: Well or Suction Line 100+ ft.; Stream NA ft.; Pressure Line 50+ ft.; Property Line 50+ ft.

C. DISTRIBUTION BOX:
1. Material Concrete ; Number available outlets _____.
2. Factory Built: Yes ☒ No ☐ (Company Pre-Cast)
3. Distance from Septic Tank 20 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☒ Perforated Pipe ☐ Diameter of Half Round 22" or Perforated Pipe _____. Material: fiberglass ☐ ; plastic ☐ ; concrete ☒ ; other _____.
2. Lateral Lines: Number 2 ; Length of each line 80, 76, _____, _____, _____ ft.; Total length of laterals 156 ft.; Distance between lateral lines 10 ft.
3. Trench dimensions: Width 4 ft.; Slope 2 in/100 ft.; Average Depth 36 in.
4. Filter Material: Gravel Depth of Material 24 in.
5. Distances to: Well or Suction Line 150+ ft.; Stream NA ft.; Pressure Line 80+ ft.; Property Line 20+ ft.

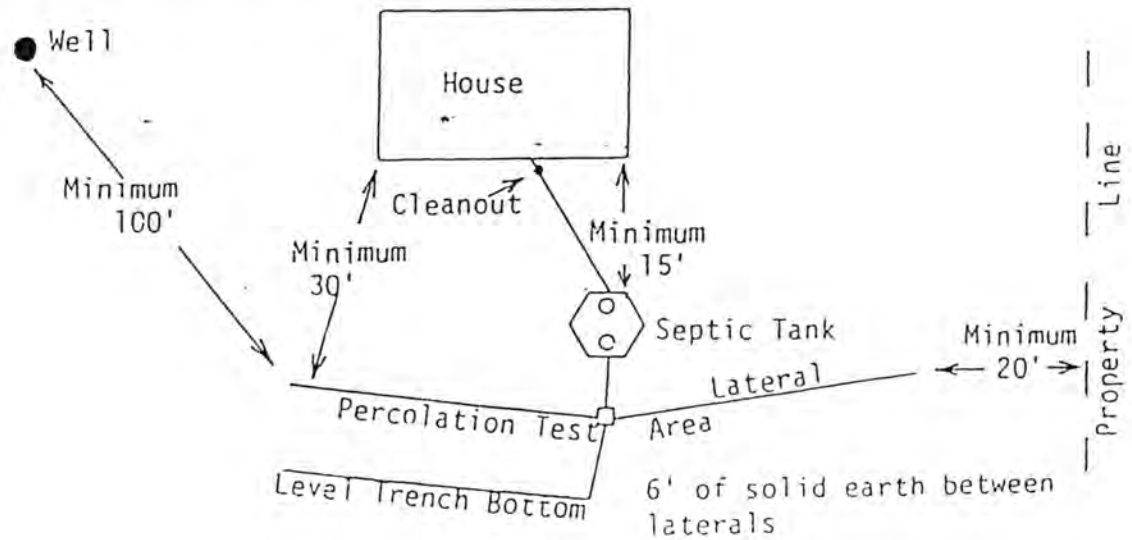

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

B&F Builders

Installed By Vogt T&T Excavating
5-17-94

