CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 1056

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — November 16, 1977

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

Bernie Aaen — 5220 South 48 St., Lincoln, NE 68506

LICENSEE OR PERMITTEE — ADDRESS

T9N, R7E, Section 29, Lot 3, Addition Tower Acres, 1st Addition

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
44110	NV 16 77	30.00 -

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

HEALTH APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1056

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 5-16-77

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 7E ; Section 29
   Block ____ ; Lot 3 ; Addition Tower Acres 1st addition
   Street Address ____ S.W. ¼ of N.E. ¼

2. Property Use: Residential ____ ☒ ; Commercial ____ ☐
   No. of Bedrooms 3 . Describe: ____
   Other Use ____ ☐
   Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: ____ ft.

Bernie Aaen
Signature of Applicant (Owner or Lessee)

5220 So 48th
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 5/16/77. Date Frwd. 5/16/77. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 5-16-77. Date Frwd. ____. ACTION: Approved ☒ Disapproved ☐ Signature: Tom Kraack

3. City ~~or County~~ Engineer: Date Rec'd. 5-16-77. Date Frwd. 5-16-77. ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1056

DATE: 5-16-77

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 29 ; Block ; Lot 3 ; Addition Tower Acres 1st addition SW¼ of NE¼.
Street Address .

2. Property Use: Residential [X]; Commercial [ ]
No. of Bedrooms 3
Other Use
Describe:
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Bernie Aaen
Signature of Applicant (owner or lessee)

5220 So 48th
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: 7-28-77 by: gw
Date: 7-28-77 by: gw
Date: by:

3. Date: Approved [X]; Disapproved [ ] 5/16/77
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 7-28-77 by: James Woodka

FORM HD-43 (73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 474-1541)

FILE NO. 1056

PROPERTY WHERE SOIL TESTED:
Location: Township 9N : Range 7E
Section & ¼ Sect. 29
Property Dimensions: ____ ft. x ____ ft.
Area: 3 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ; Silty Clay Loam ; Sandy Loam
Silty Loam ; Clay Loam ; Sandy Clay

Owner: Bernie Aden
Address: 5220 to 48th Lot 3 Tower Acres

Dates of Tests: 5-12-77 to 5-13-77. Weather: Precip. NO Temp. 80

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	24"	5-12	1230	5-12	4:30	5-13	3:30	6	4:30	4½	60	1½	
2	↓	↓	↓	↓	↓	↓	↓	↓	↓	5	↓	1	
3										5		1	
4										5⅛		⅛	
5										5		1	
6										5		1	

Sum of Percolation Rates:
Average of Rates:
Mean of Rates:

Signature of Person Conducting Test Smith Service Co. Frank Sloan Jr.

Address 2425 Lo St

Phone 475-1486

(Do not write below this line)

REVIEWING ACTION

REMARKS: Sharpsburg Silty Clay Loam (S.C.L.)

DATE: May 16, 1977

Approved Percolation Rate (a)
A. 56 min./inch
B. ____ min./inch
C. ____ min./inch

Gerald C. Hood
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1056

SPECIFICATIONS

DATE: 5-16-77


A. BUILDING SEWER:
1. Material Pla ; Diameter 4 in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank 40 ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Conc ; No. of compartments 2 1.
2. Capacity _____gals.; Liquid depth ____in.
3. Factory Built: Yes ☒ (Company _____)
No ☐
4. Manholes: Over Inlet; diam. ____in.
Over Outlet; diam. ____in.
Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ____in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.


C. DISTRIBUTION BOX
1. Material Pla ; No. available outlets 4 each
2. Factory Built: Yes ☒, (Company Hand Cone No ☐
3. Dimension: Length 26 in.; Width 26 in. Depth 36 in.
4. Distance from Septic Tank 10 ft.
5. Serial Distribution: Yes ☒, No ☐ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Perforated Pipe
2. Lateral Lines: Depth below grade 24 in. Number ____; Length of each line 100 ft Total length of Laterals 318 ft.; 477 Slope 6 in/100 ft. Diameter of pipe 4 in.; Shape round Material: concrete ☐; fiber asbestos ☐; clay ☐; other Pla Distance between lateral lines 10 ft.
3. Trench Dimensions: Depth ___in.; Width ___in.
4. Filter Material: roadgravel Depth of material from trench bottom _____in.
5. Distances To:
Well or Suction Line ____ft.;
Stream _____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

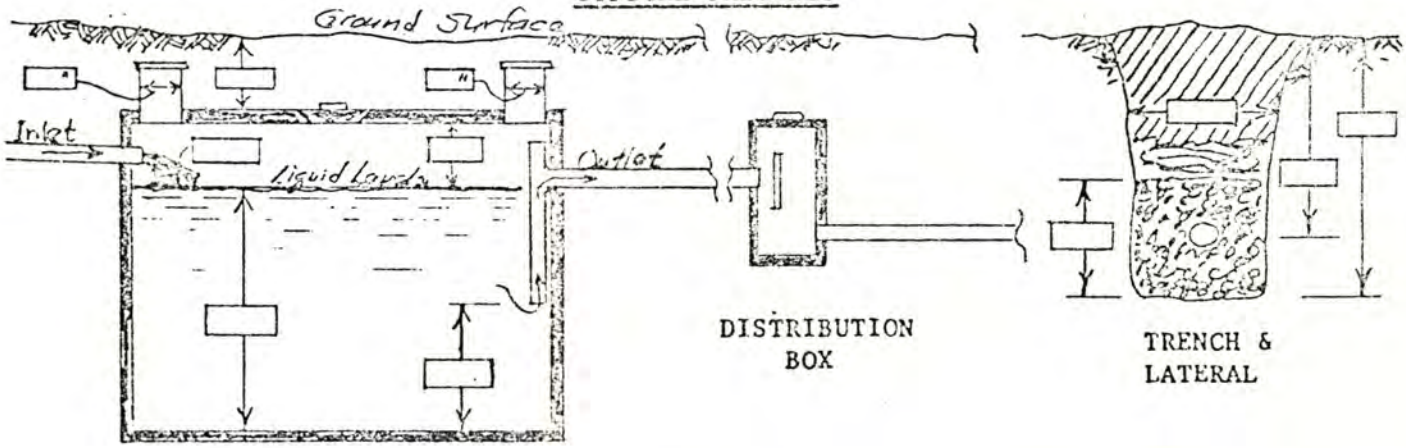

Bernie Aaen
Signature of Applicant

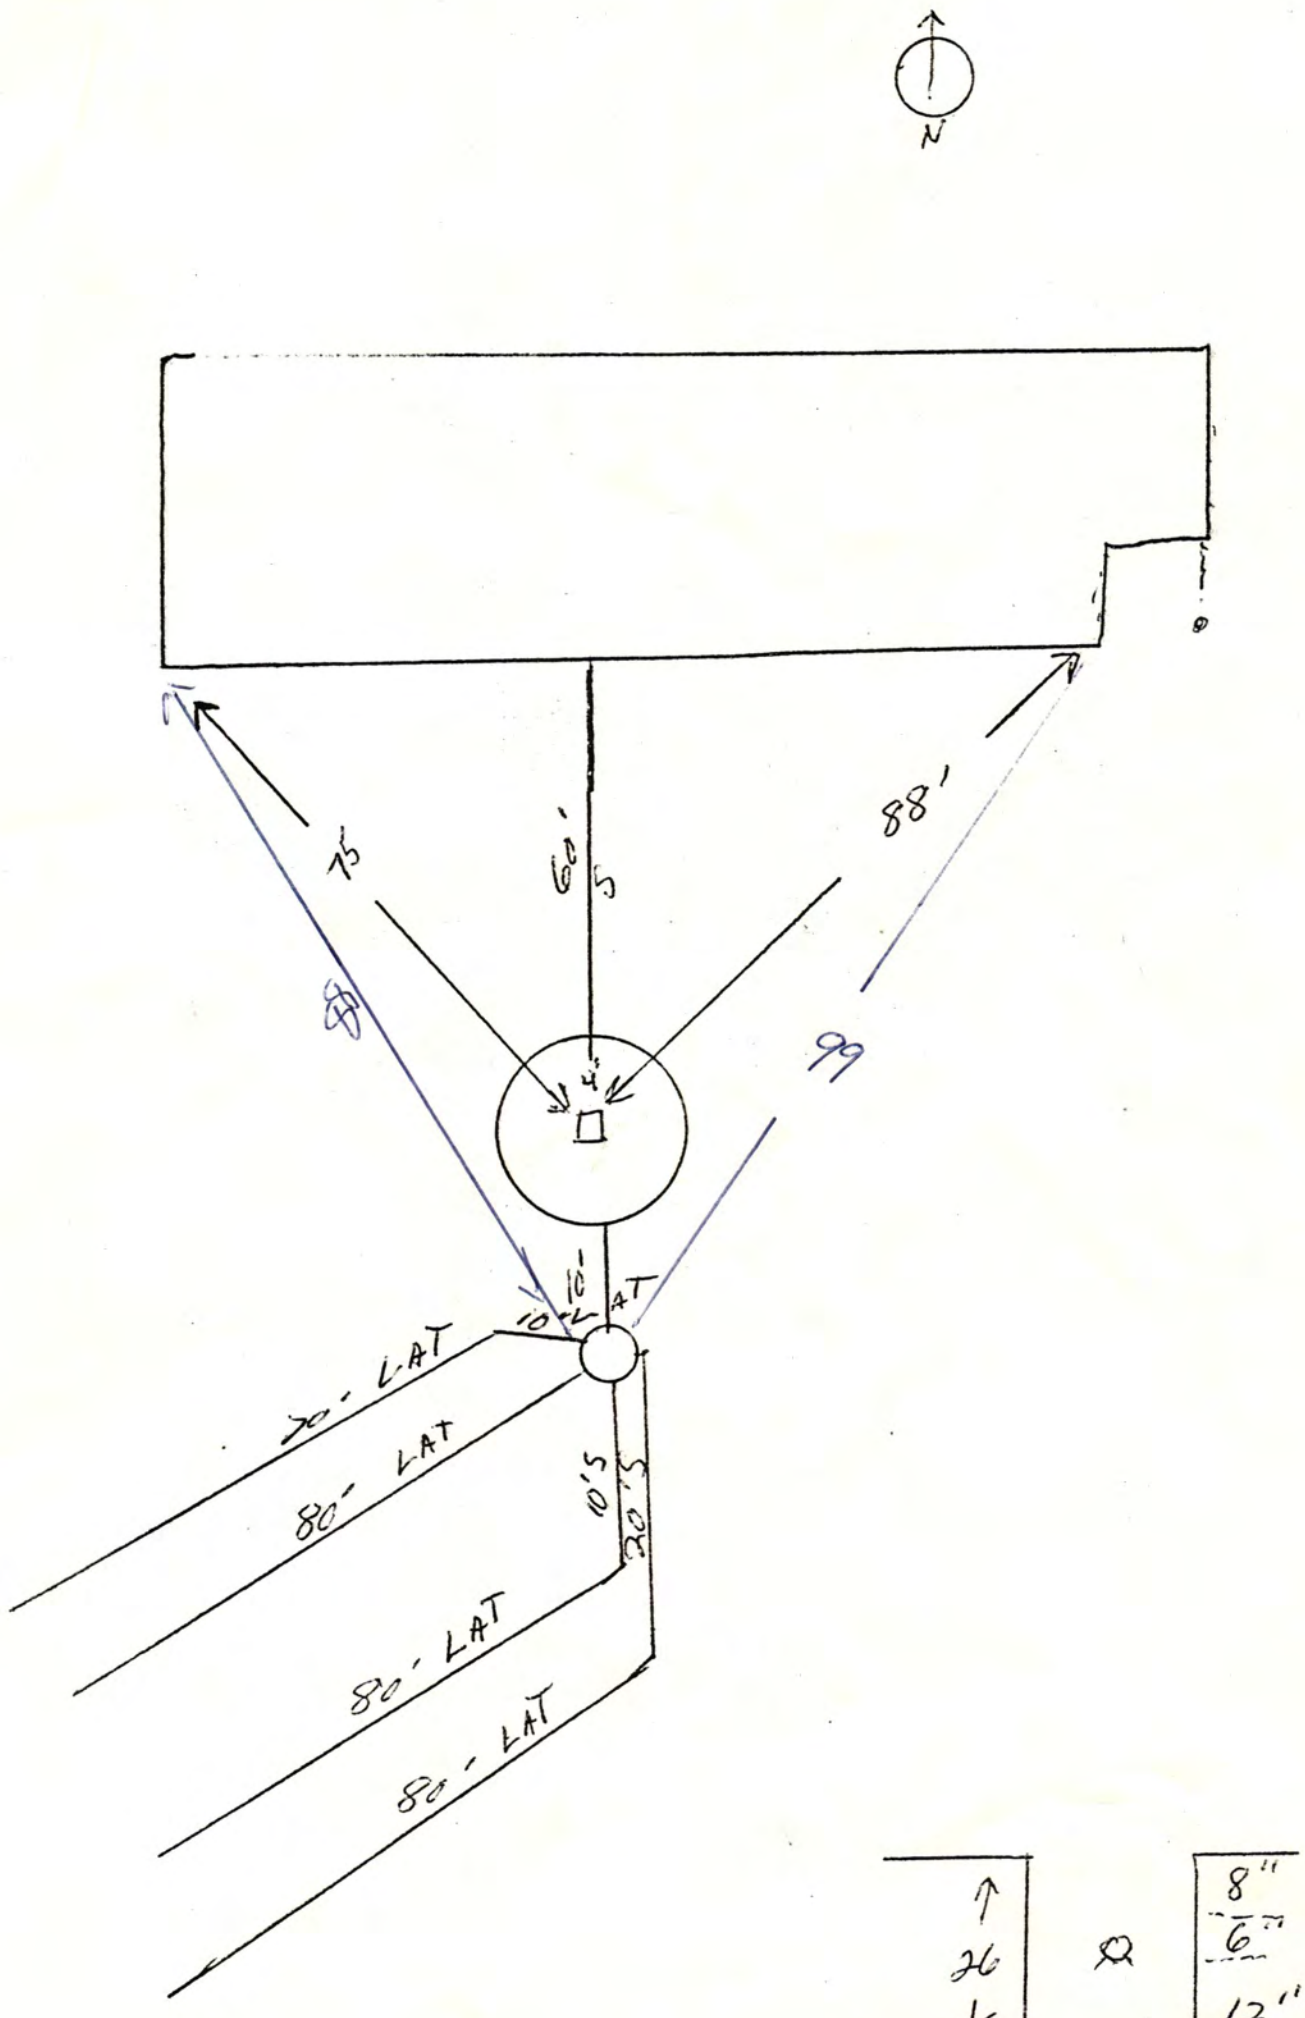
N
15'
60'
88'
99
4'
10'
10'
10'
20' - LAT
80' - LAT
80' - LAT
80' - LAT
10'5
20'5
26
8"
6"
12"
36"

920409007

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St. Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 3-13-93

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 9N ; RANGE 7E ; SECTION 29 ; BLOCK ___

LOT 3 ; ADDITION Tower Acres 1st. addition ; Street Address 9111 Swing Circle 68516

Directions to Property 56 & Yankee Hill Rd West to 52nd South ON 52 to Music Lane West ON Music Lane to Swing Circle

Location of Well North of Barn Tap Location: Inside ☒ Outside ☐

Location of Sewage System South of House into Field Year Installed ? 84 1977

	NAME	ADDRESS	PHONE
Present Owner:	Dean Hillhouse	9111 Swing Circle	423-1975 477-4181
Tenant/Buyer:	Same		
Return to:	Sue Rockman	American Charter, 7930 South	

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Dean D. Hillhouse Address 9111 Swing Circle 68516

==========

HEALTH DEPARTMENT USE ONLY

Date Received MARCH 19, 1992 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE MARCH 24, 1992

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:	SITE VISIT:
Construction	☒	☐	Approved: ☐	Date 3/24/92 by L.G.H.
Bacteria	☒	☐	Provisional: ☐	Date _____ by ___
Nitrate <0.1 PPM	☒	☐	Disapproved: ☒	Date _____ by ___

Comments: SEWAGE SYSTEM WAS ADDED ONTO WITHOUT BENEFIT OF INSPECTION OR PERMIT term it taken out 4/6/92

See Attached Letter ☐

FINAL STATUS

	WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
	Approved: ☒	Approved: ☒	Provisional Approval: ☒

APPROVED BY Jerold C. Hood R.E.H.S. DATE APRIL 6, 1992

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832