FILE NO. 746

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION

TYPE OF LICENSE OR PERMIT

June 15, 1976

THIS LICENSE OR PERMIT EXPIRES

C. E. VanLaudingham

LICENSEE OR PERMITTEE

6800 South 14th

ADDRESS

T9N; R6E; Sec. 13: Lot 13;

NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
110.15	110.16	148.14	6-2

624-1535

SERIAL NO. | DATE | AMOUNT

APPLICATION

38506 MC1-5-75 30.00 r

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 746

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: October 30, 1975

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9N ; Range 6E ; Section 13
Block ____ ; Lot 13 ; Addition ____
Street Address 6800 South 14th Street

2. Property Use: Residential ____ / / ; Commercial ____ / /
No. of Bedrooms ____. Describe: ____
Other Use ____ /xx/
Describe: Mausoleum

3. Type of Individual Sewage Disposal System: Septic Tank /x/ ; Other / /

4. Distance to public sewer: 3960 ft.

C. E. Van Landingham
Signature of Applicant (Owner or Lessee)

6800 South 14th Street
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 11/3/75. Date Frwd. 12/15/75. ACTION: Approved ☒ Disapproved ☐ Signature: Jerold C. Wood

2. Supt. Bldg. Insp.: Date Rec'd. 12-15-75. Date Frwd. 12-15-75. ACTION: Approved ☒ Disapproved ☐ Signature: Chase Lute Williamson

3. City or County Engineer: Date Rec'd. ____. Date Frwd. 12-15-75. ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 746

DATE: October 30, 1975

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 6E ; Section 13 ; Block ; Lot 13 ; Addition .
Street Address 6800 South 14th Street .

2. Property Use: Residential [ ]; Commercial [ ]
No. of Bedrooms
Describe:
Other Use
Describe: Mausoleum

3. Type of Individual Sewage Disposal System: Septic Tank [XX]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

C. E. Van Landuyt Jr.
Signature of Applicant (owner or lessee)

Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: Dec-12-75 by: mm
Date: by:
Date: by:

3. Date: Approved [X]; Disapproved [ ] 12/15/75
by: Gerald E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: Dec-12-75 by: Ronald Magnant

AM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Location: Township 9; Range 6
Section & ¼ Sect. 13
Property Dimensions: ___ ft. x ___ ft.
Area: _____ acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☒; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☒; Sandy Clay ☐

Owner: Lincoln Memorial Park Cemetery c/o Mr. Frank Karnes
Address 6800 So. 14TH

Dates of Tests: 5-18-74 to 5-19-74. Weather: Precip. 3/4" Temp. 80°F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36"	5/18	6 PM	5/19	5 PM	5/19	5 PM	12"	7 AM	9	30	½	60
2	"	"	"	"	"	"	"	"	"	8	"	¾	80
3	"	"	"	"	"	"	"	"	"	7	"	1	120
4	"	"	"	"	"	"	"	"	"	2	"	3¾	8
5	"	"	"	"	"	"	"	"	"	7½	"	¼	30
6	"	"	"	"	"	"	"	"	"	9	"	½	60

Sum of Percolation Rates _____
Average of Rates: 44
Mean of Rates: _____

Robert D. Johnson
Signature of Person Conducting Test

Address 2618 No. 32nd
Phone: 432 3593

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

DATE: _____

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 746

SPECIFICATIONS

DATE: October 30, 1975


A. BUILDING SEWER:
1. Material clay; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 150 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line 350 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material * ; No. of compartments 1. *Fiberglass
2. Capacity 500 gals.; Liquid depth 42 in.
3. Factory Built: Yes [XX] (Company **) No [ ] **Corr-A-Glass
4. Manholes: Over Inlet; diam. 10 in.
Over Outlet; diam. 10 in.
Below Grade ___ in.
5. Inlet: Baffle [XX]; or Tee [ ]
6. Outlet: Baffle [XX]; or Tee [ ]
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 42 in.
8. Distances To:
Well or Suction Line 350 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.


C. DISTRICTION BOX
1. Material ___; No. available outlets ___.
2. Factory Built: Yes [ ], (Company ___) No [ ]
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank ___ ft.
5. Serial Distribution: Yes [ ], No [ ] (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Corrugated fiberglass
2. Lateral Lines: Depth below grade *** in. Number 1; Length of each line 100 ft Total length of Laterals 100 ft.; Slope 0 in/100 ft. Diameter of pipe 16 in.; Shape ½ circle Material: concrete [ ]; fiber asbestos [XX]; clay [ ]; other ___ Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth 29 in.; Width 36 in.
4. Filter Material: sand gravel. Depth of material from trench bottom 17 in.
5. Distances To:
Well or Suction Line 350 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.
6. Percolation Rate: 44 minutes/inch
*** See detail


TYPICAL SKETCHES

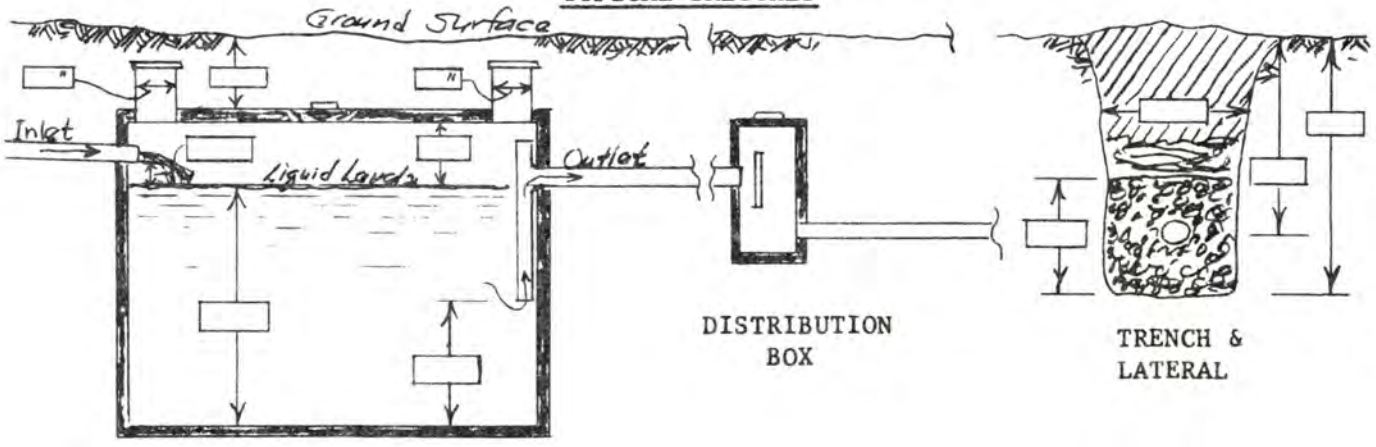

Signature of Applicant

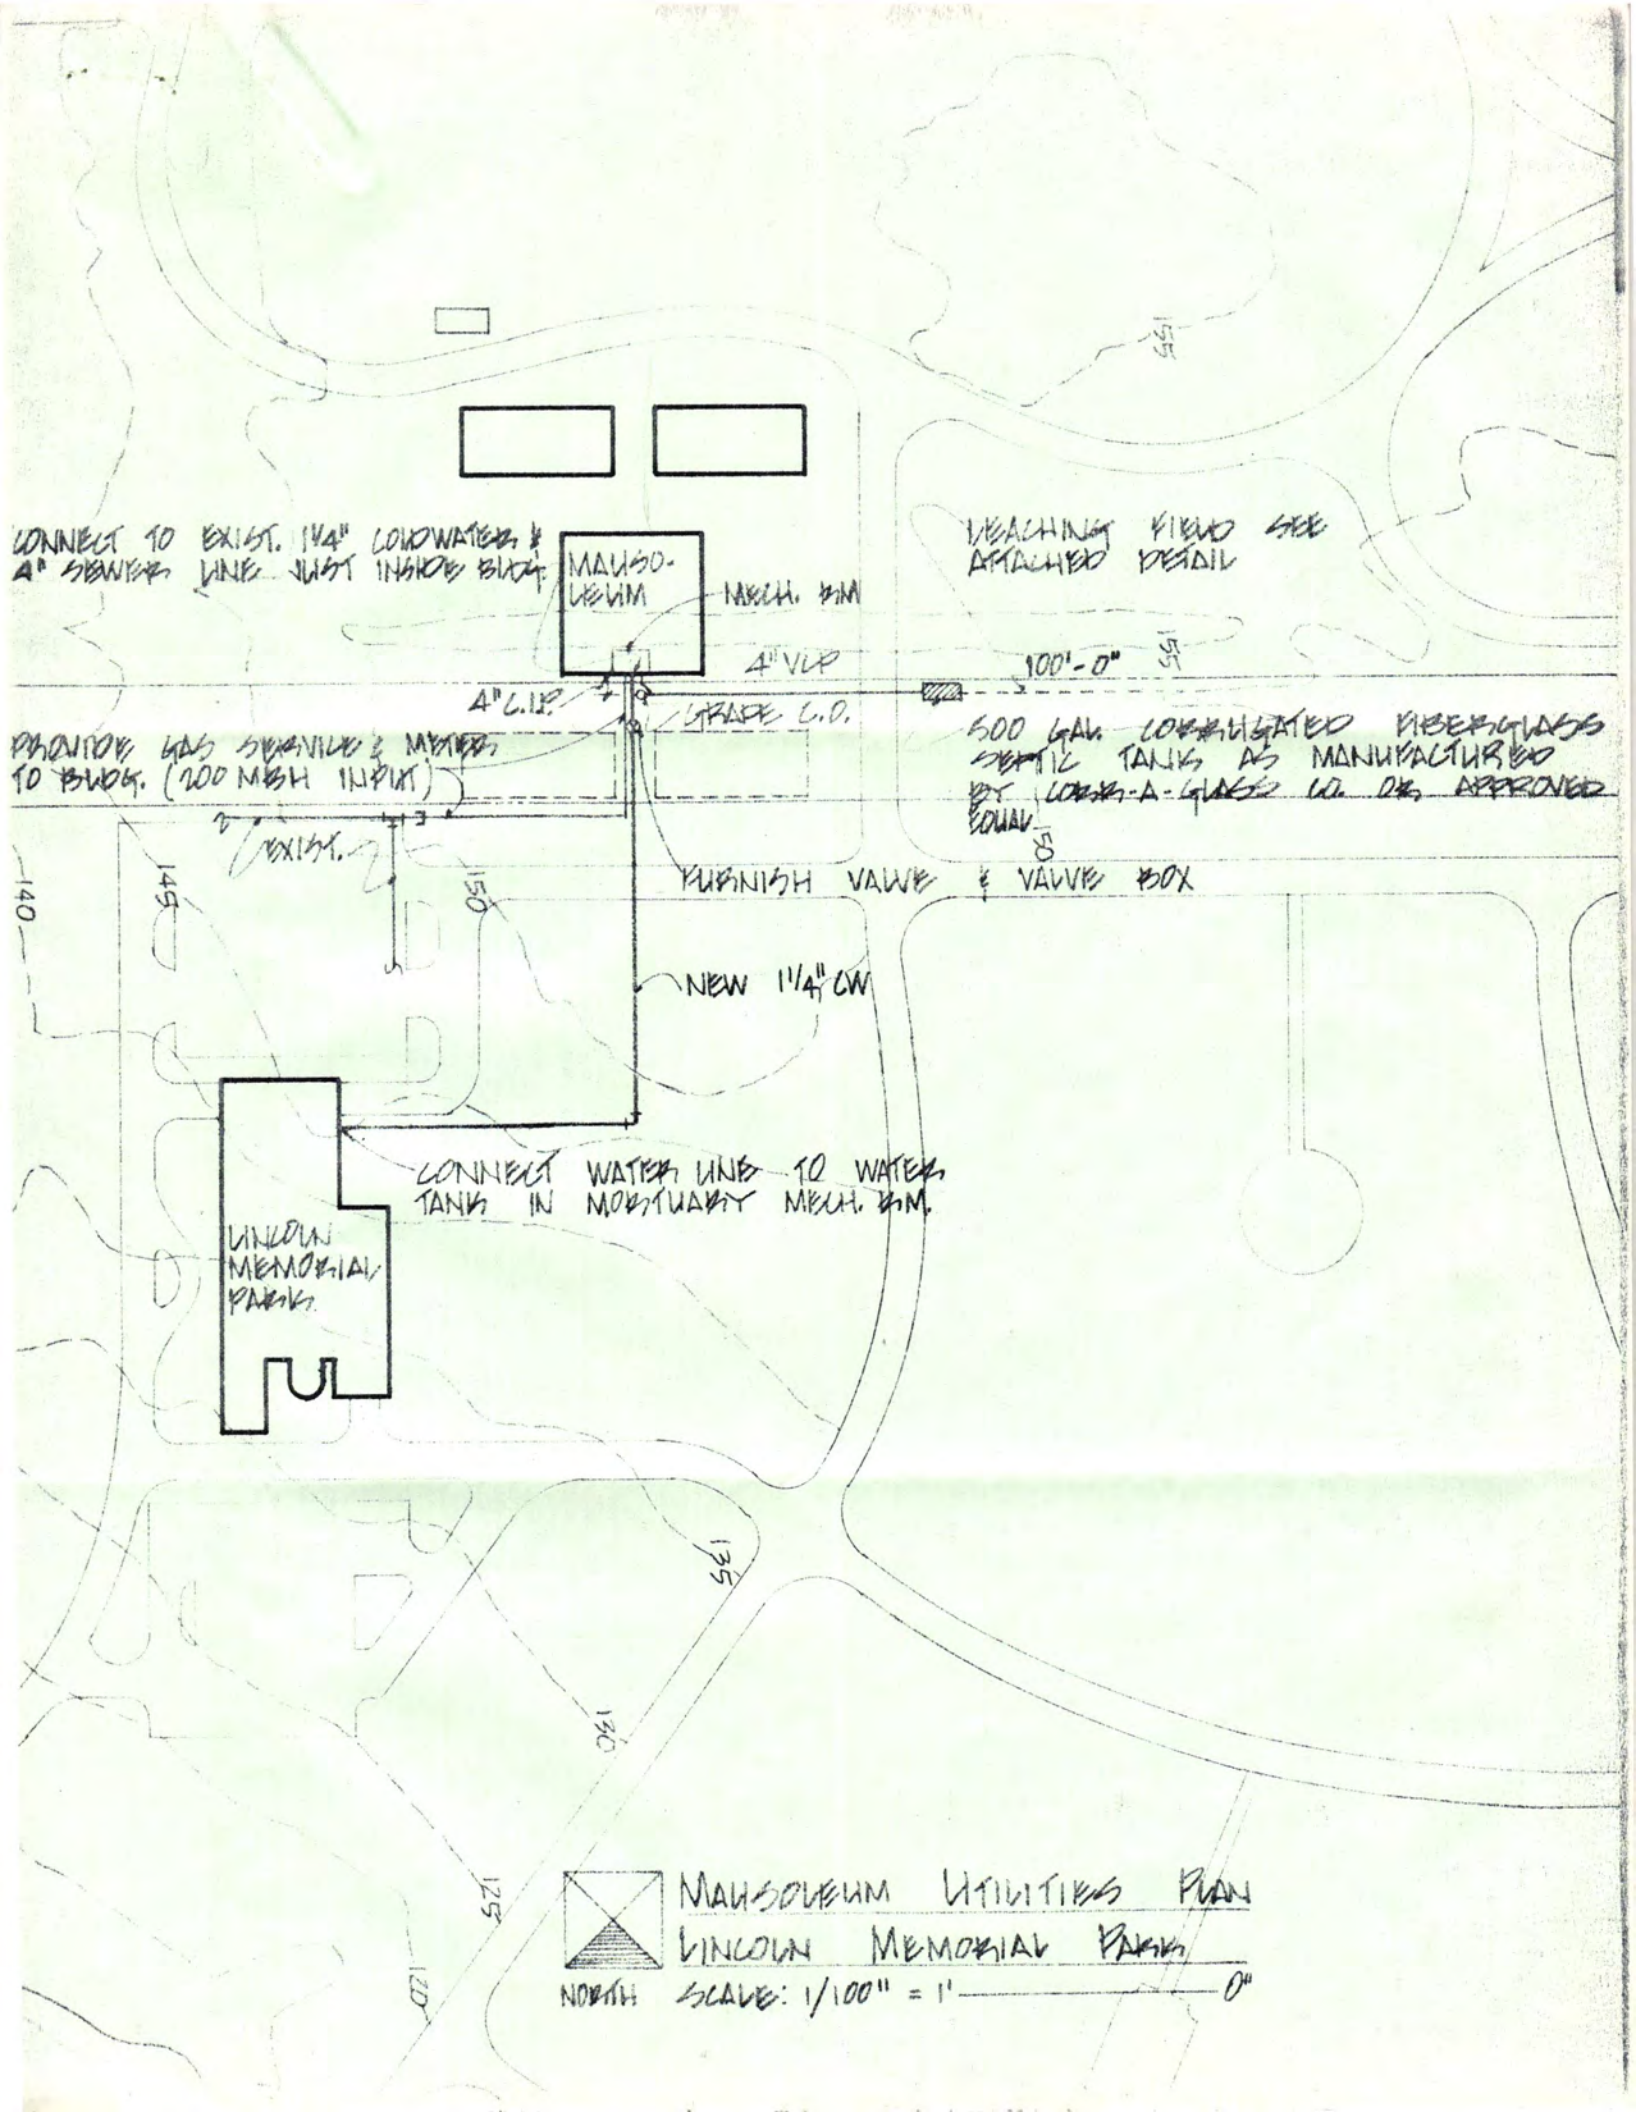


MAUSOLEUM UTILITIES PLAN
LINCOLN MEMORIAL PARK

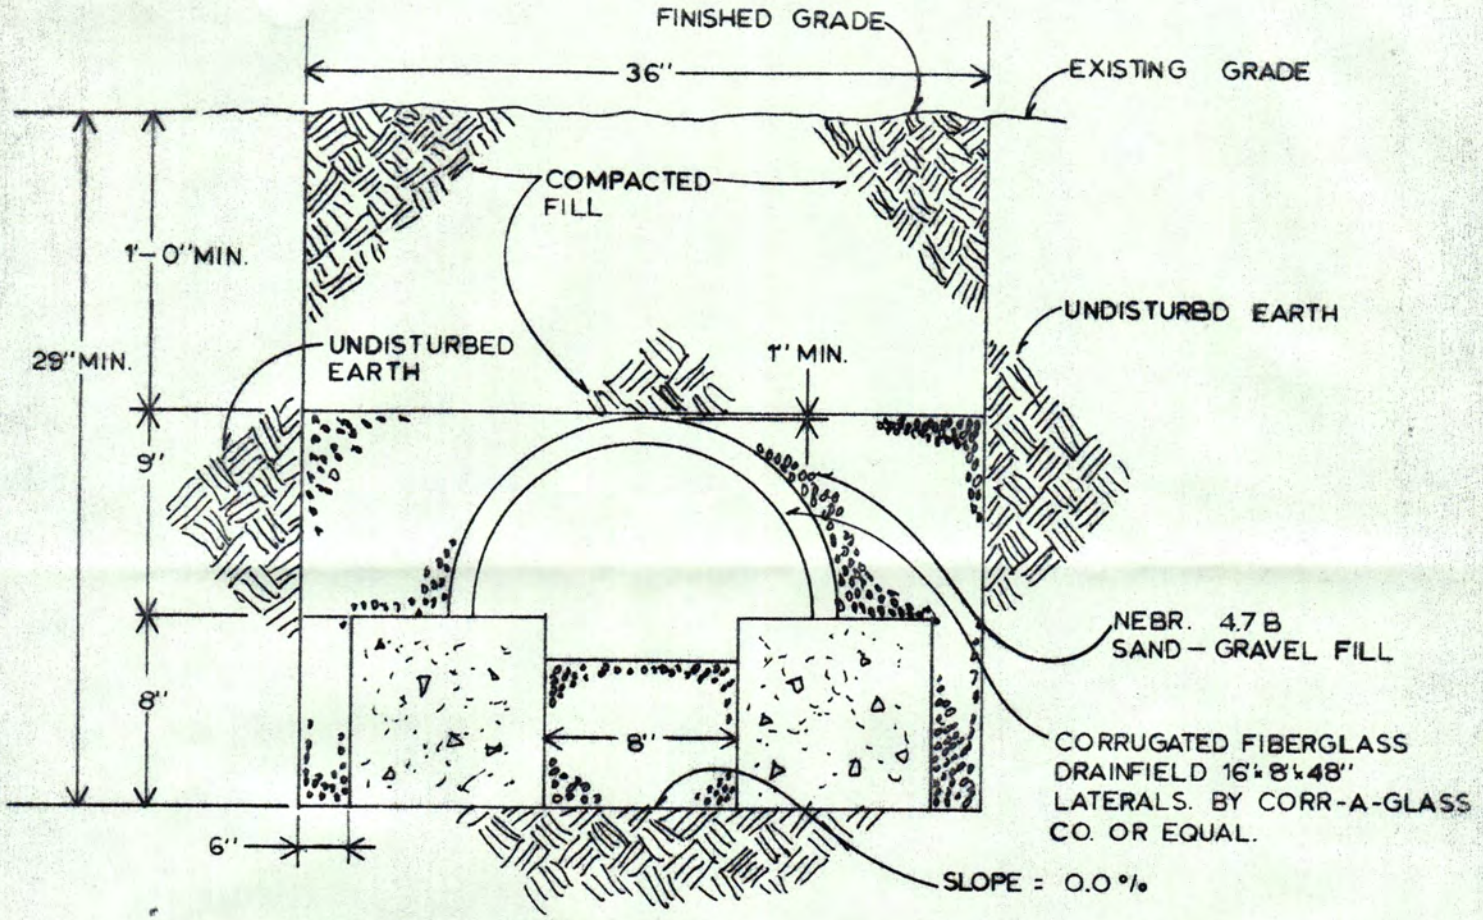

typical drainfield section

S no scale

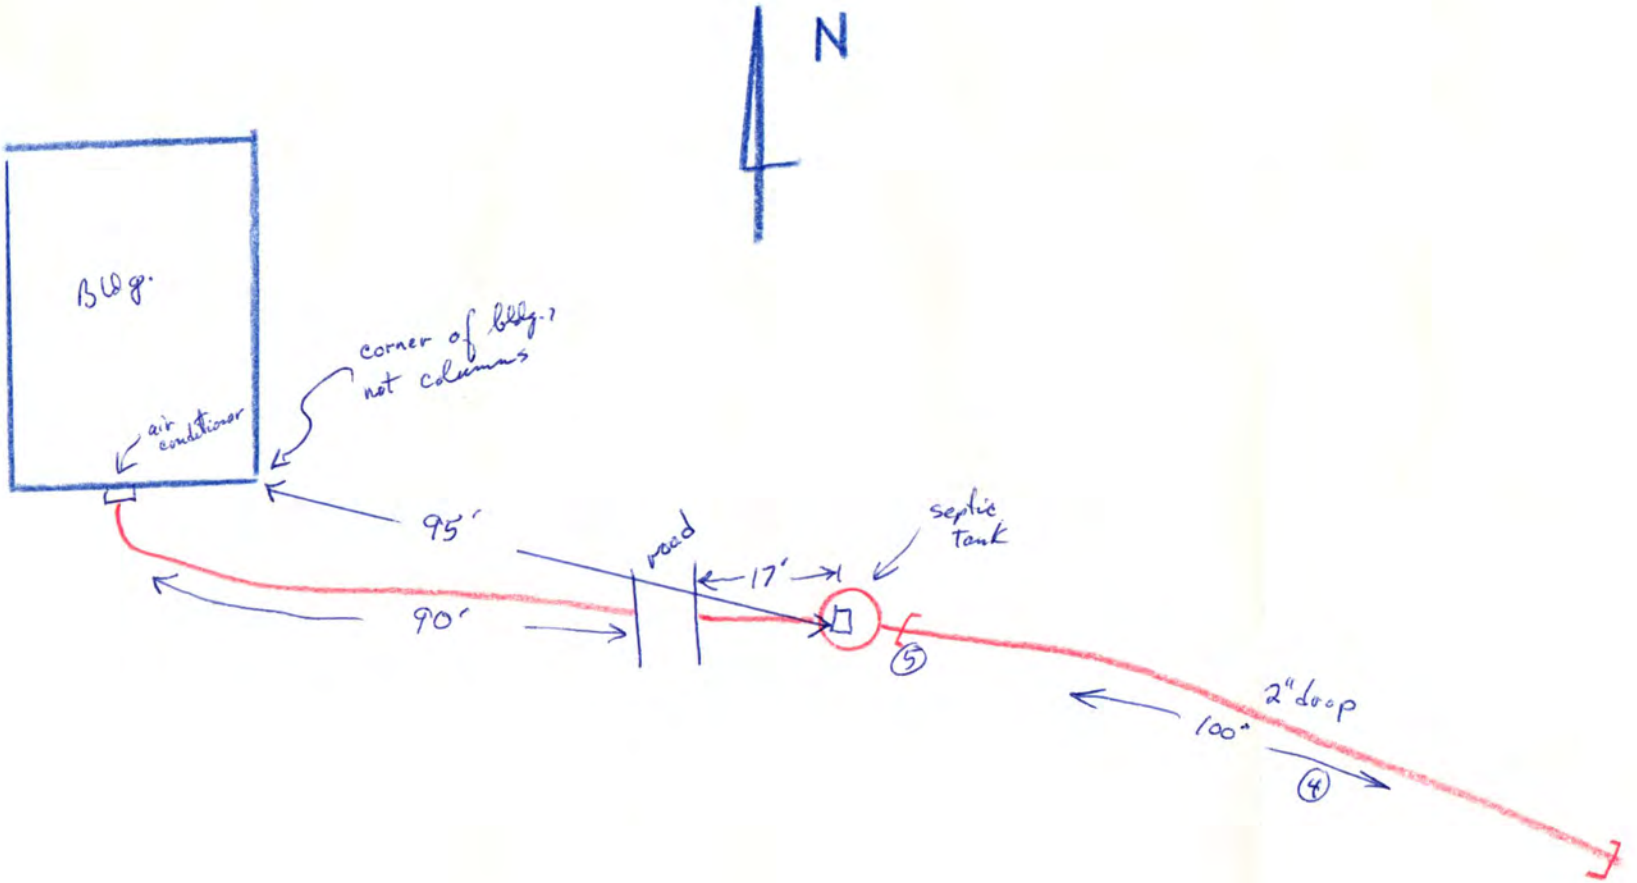
N
Bldg.
corner of bldg.? not columns
air conditioner
95'
pad
17'
septic Tank
90'
5
2" deep
100'
4

Dec-12-75

sm