LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

Division of Environmental Health
2200 St. Marys Ave Lincoln, NE 68502 (402) 471-8000

NON TRANSFERABLE

PERMIT

WATER WELL

No. 90400019501

Issued 09/05/90
Expires 03/05/91

ESTABLISHMENT

CRAIG PRANGE
T9N R7E SEC 32
LOT 49
10901 S 56 STREET

FEES: Permit 019851 $75.00

Total $75.00

PERMITTEE

CRAIG PRANGE
4300 SOUTH ST
APT 2
LINCOLN NE 68506

Issued By COUNTY HEALTH

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

DATE	AMOUNT
9/7/90	PAID

RECEIVED AUG 2 0 1990

FORM: 20222-0483
REQUEST FOR SITE CLEARANCE AND PERMIT FOR INDIVIDUAL WATER WELL

LINCOLN LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN, NEBRASKA 68502
PHONE: 471-7800

FILING FEE $ _____

FILE NO. 9040 00 195

DATE: 8-15-90

The undersigned hereby requests: Site Clearance and Permit to construct a new individual water well ☒ ; Permit existing well ☐ ; well repair or alteration involving opening of well ☐ ; in conformance with appropriate ordinance, as described herein:

1. Legal description of property: Twp. 9N : Range 7E : Section 32
   Block _____ : Lot 49 I.T. : Addition 10901 So 56th St
2. Well use: Residential ☒ ; Commerical ☐ ; Other Use ☐
   Describe _____
3. Distance to Public Water Supply: _____ Ft.
4. Intended use of well exact address

Craig Prange Keith Muenchau
Signature of Applicant (owner or lessee)
4300 South St #2 7331 Vine Lincoln, Ne 68505
Address
Lincoln, Ne 68506

Sewage Permit Applied For Yes ☐ No ☒ Not Applicable ☐

1. Health Department: Date Rec'd 9/5/90. Date Frwd. 9/6/90. Action: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: Date Rec'd 9/6/90. Date Frwd. 9/6/90. Action: Approved ☒ Disapproved ☐ Signature: Mel Goldman
3. City or County Engineers: Date Rec'd 9/6/90. Date Frwd. 9/6/90. Action: Approved ☒ Disapproved ☐ Signature: John D. Brumm

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 5-24-91 by PAUL DROTZMANN
Date: 6-6-91 by Paul Drotzmann
Date: _____ by _____

Nitrate Level < 0.1 PPM
Bacteriological Analysis Satisfactory
Yes ☒ No ☐

INSTALLATION FINAL WRITTEN APPROVAL
Date: 6-11-91 By: Paul D. Drotzmann

Health Department copy: White
Engineers Copy: Light Green
Building Inspectors Copy: Light Blue

FORM 23-13

RECEIVED FEB - 5 1991

FORM: 20223-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL
CITY ORDINANCE NO. 13558
FILE NO. _____

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN NE 68502
Phone: 471-7300

DATA SHEET FOR WATER WELLS

Legal Description: Sec 32 T. 9N R. 7E Block ___ Lot 49 Addition 1090 / 5056 Th St
Owner Craig Prange Address 4300 So 56 St #2
Lincoln, Ne 68506

LOG OF WELL	
	Description
Depth Ft.	Top Soil
1-45	yellow clay
45-58	gray clay
58-68	Pink, yellow & lt gray
68-79	Sandstone
79-85	white clay
85-92	Sandstone
92-115	gray clay
115-138	white & red layers
138-219	75% Sandstone
219-223	white Clay

WELL COMPLETION RECORD

Drilling Method: Rotary
Depth (from ground level), Ft. 219
Date Completed 2-20-91

Casing: Length, Ft. 214; Dia. In. 4
Wall Thickness, Inc 140; type PVC

Screen: Length, Ft. 40 Dia. In. 4
Type PVC, slot Size .016

Drop Pipe: Length, Ft. 70 Dia. In. 1

Water Level, Surface to top of water, Ft.:
Static 146, Pumping 155

Yield: 20 ggm, Measured ☒, Est. ☐
Chlorination Completed Yes ☒ No ☐

The above information including "Log of Well" is a true record of the job performed by me.

Driller Kirk Muenchau
(Signed)

REMARKS NITRATE NITROGEN < 0.1 PPM
BACTERIOLOGICAL O.K.

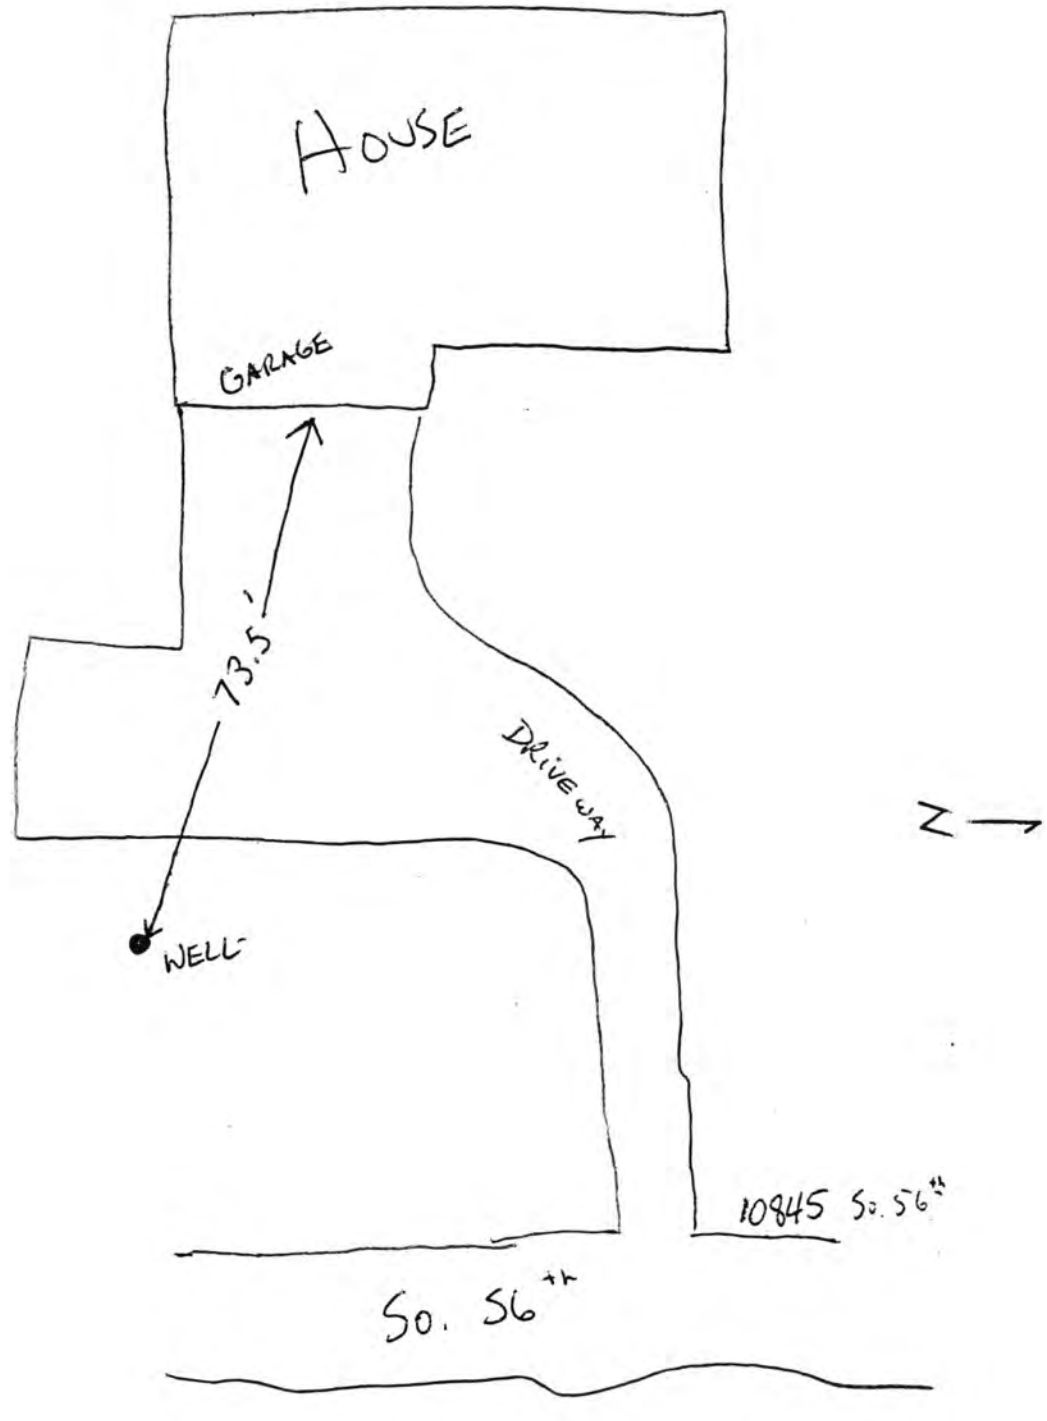
Address 2331 Vine St

Date 2-22-91

DO NOT WRITE BELOW THIS DOUBLE LINE

Health Department forwarded copy of record to Nebraska Conservation and Survey Department for Scientific Record ☒

FORM 23-4


HOUSE
GARAGE
73.5'
DRIVEWAY
WELL
N
10845 So. 56th
So. 56th