LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 94390043101

Issued 12/28/94
Expires 06/28/95
Revenue Code 18754

Establishment
ROBERT SCHROEDER
T9N R7E SEC 32
HIGHLANDS SOUTH BLK 4 LOT 3
5141 BRAEMER ROAD

FEES: $50.00

TOTAL $50.00

Permittee
ROBERT SCHROEDER
5141 BRAEMER RD
LINCOLN NE 68516

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-29-94

The undersigned hereby applies for a permit to ALTER [X], EXTEND [X], or REPAIR [ ] an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 32 ;
Block 1 ; Lot 4 ; Addition Highlands South
Street Address 5141 Braemer

2. Property Use: Residential [X]; Commercial [ ]
No. Bedrooms 3
Describe _____
Other Use [ ]
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Description of proposed alteration, extension or repair: add 160' of protected pipe laterals

5. Work to be done by: Owner [ ] ; or Contractor [X], Southwick Sewer & Drain
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL >	$	400.00

Robert Schroeder by Brad Southwick
Signature of Applicant (owner or lessee)

site visit 9-29-94

5141 Braemer
Address

17201 S. 72
Hickman, Ne 68372

(Do not write below this line)

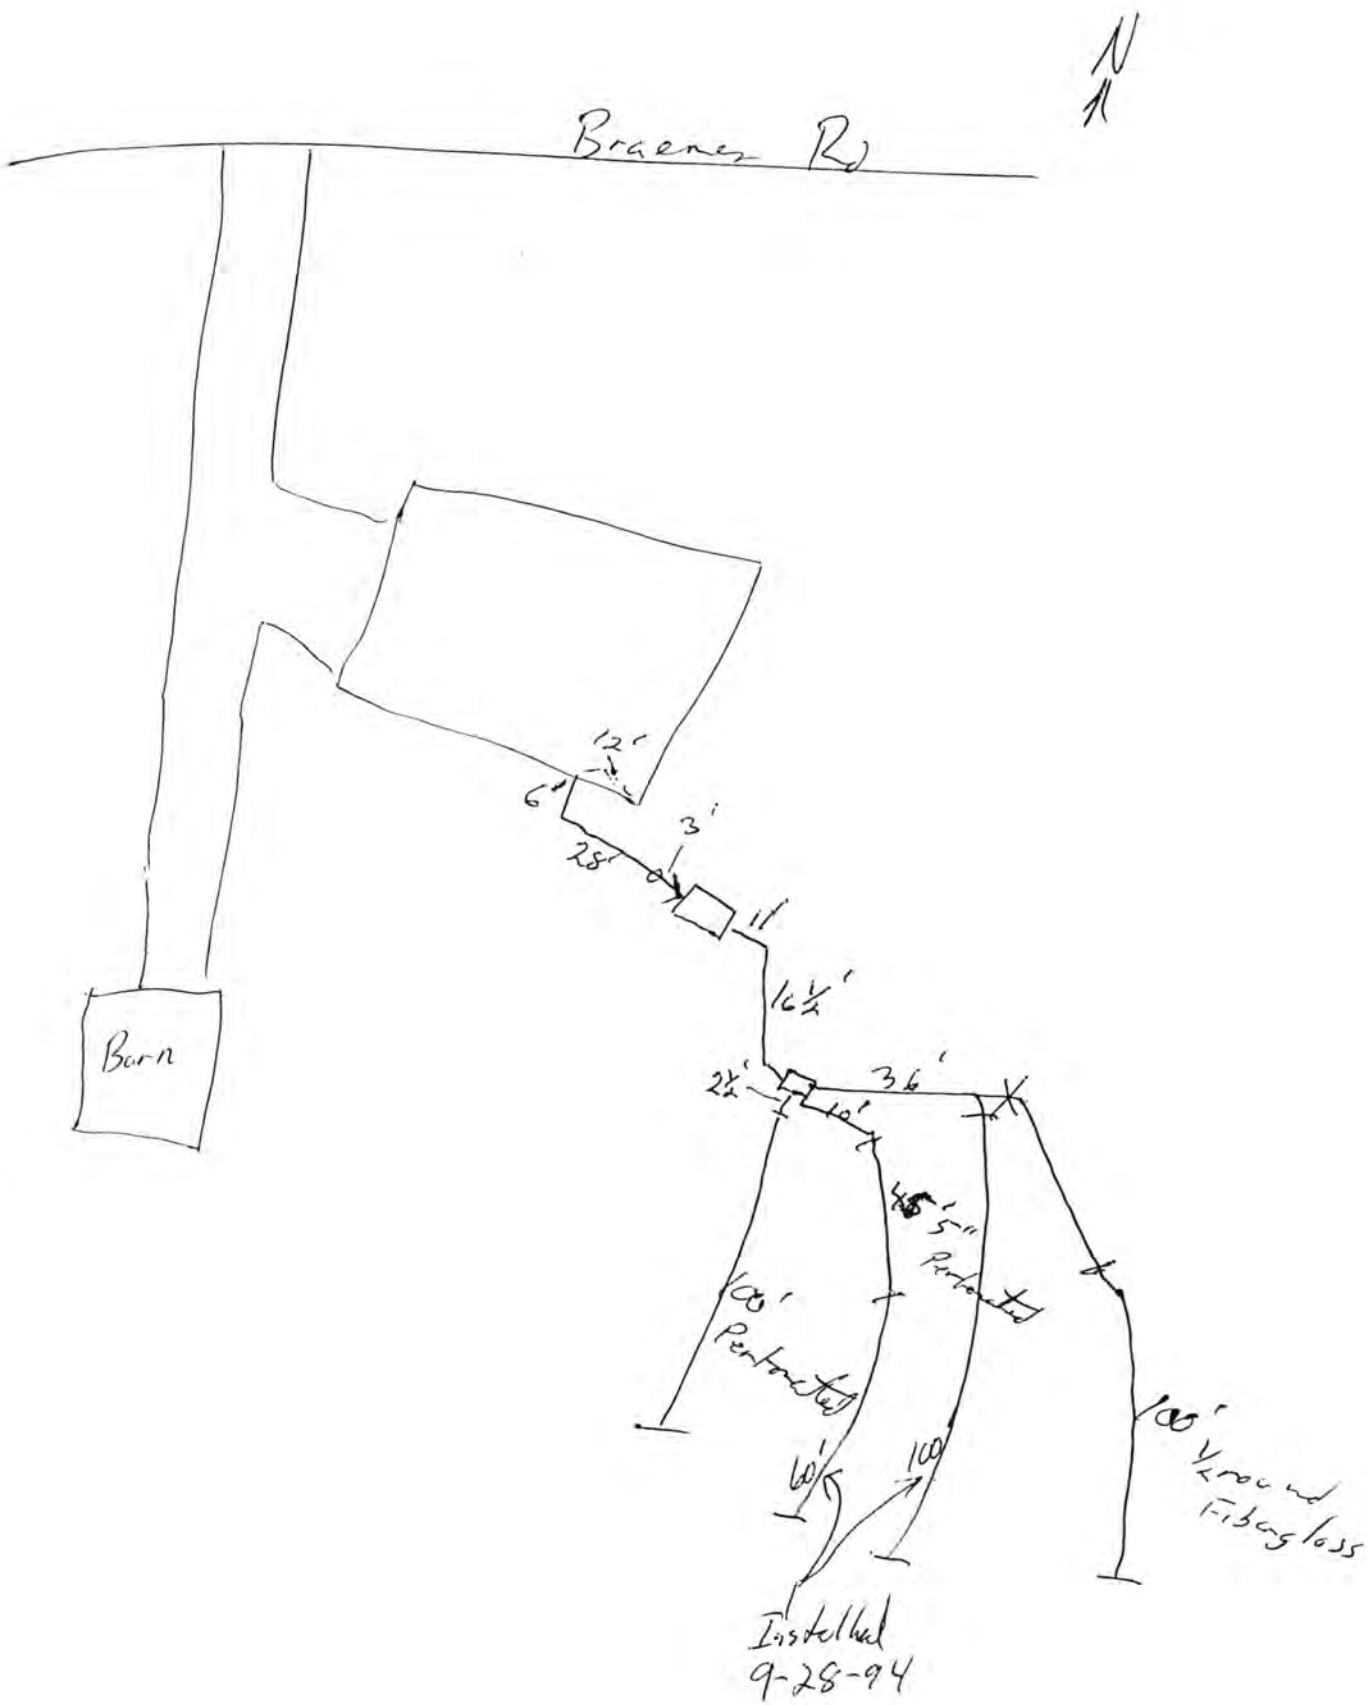
REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ _____

2. Site Visits:
Date: 9/29/94 by: L.C.H.
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved [X]; Disapproved [ ]
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 1/10/94 by: J. C. Hood


N
Braemer Rd
Barn
12'
6'
3'
28'
11'
16½'
2½'
36'
10'
48'
5" Perforated
100' Perforated
60'
100'
100' ½ round fiberglass
Installed 9-28-94

009

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 5141 BRAEMER ROAD

Twp 9N Range 7E Section 32 1/4 ___ 1/4 ___ Block 1 Lot 4 Addition HIGHLANDS SOUTH

Directions to Property So 56th So. to Braemer Rd West on Braemer to 5141 WEST OF FRONT PORCH

Location of Well 86' No. of Front Porch Tap Location: Inside ☒ Outside ☒

Location of Sewage System 125/30' SE of SE corner of house Year Installed 1972

	NAME	ADDRESS	PHONE
Present Owner:	MARTIN E DYE	110th and Saltillo Rd.	782-2919
Tenant/Buyer:	ROBERT J. SCHROEDER	2519 'E' Street Lincoln NE 68510	438-6619
Return to:	ROBERT J. SCHROEDER	2519 'E' Street Lincoln NE 68510	438-6619

Signature of Applicant Robert J. Schroeder Address 2519 'E' Street Lincoln NE 68510 Date 5/20/93

HEALTH DEPARTMENT USE ONLY

Date Received 5/26/93 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--By Gerrald C Hood **DATE:** 6/1/93

WATER SYSTEM:	Approved	Disapproved
Construction	☐	☐
Bacteria	☒ 0 /ml	☐ ___ /ml
Nitrate	☒ <0.1 ppm	☐ ___ ppm

SEWAGE SYSTEM

Approved ☐

Provisional ☐

Disapproved ☒

Additional Site Visits

Date 6/28/93 by G.C.H.

Date 8/12/93 by G.C.H.

Date 8/13/93 by G.C.H. Received 8/20/93

Comments: TOP OF WELL IS FLUSH WITH GROUND LEVEL. THE SEPTIC SYSTEM HAS LEAKED TO THE SURFACE OF THE GROUND SOME TIME IN THE PAST. Corrected 8/13/93 G.C.H. See Attached Letter ☐

PROVISIONAL APPROVAL IS GIVEN ON THE SEPTIC SYSTEM SINCE PORTIONS OF IT PREDATE REGULATIONS.

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Gerrald C. Hood R.E.H.S. Date 8/13/93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

136