CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 231

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

May 10, 1972
THIS LICENSE OR PERMIT EXPIRES

Peterson Construction — 1501 North 61st Street
LICENSEE OR PERMITTEE — ADDRESS

T9N; Range 7E; Section 33; Block 2; Lot 3; Nealrene Acres 1st Add.
NAME OF ESTABLISHMENT, IF ANY — LEGAL DESCRIPTION — ADDRESS

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 ~~110.15~~ 1535	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 231

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 9N; Range 7E; Section 33;
Block 2; Lot 3; Addition 1;
Street Address Pleasure Acres.

2. Property Use: Residential ____ [X]; Commercial ____ [ ]
No. of Bedrooms 3. Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: ____ ft.

James & Peterson Const.
Signature of Applicant (owner or lessee)

1501 N 61
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 11-10-71. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 11-10-71. Signature: James H Waverka

2. Supt. Bldg. Insp.: Date Rec'd. 11-10-71. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 11-10-71. Signature: Chas Seale By Bob Skinner

3. City Engineer: Date Rec'd. ____. ACTION: Approved ___ [✓] Disapproved [ ]
Date Frwd. 11-10-71. Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 231

DATE: Nov 10, 1971

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 7E ; Section 33 ;
Block 2 ; Lot 3 ; Addition 1 ;
Street Address Redbrae Acres

2. Property Use: Residential [X]; Commercial [ ]
No. of Bed Rooms 3 Describe:

Other Use [ ]
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Jones & Peterson Const
Signature of Applicant (owner or lessee)

1501 No 61
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: 11-10-71
Filing Fee: $30.

2. Date Site Clearance

3. Site Visits:
Date: 4/12/72 by: L.C.H.
Date: by:
Date: by:

4. Date: Approved [X]; Disapproved [ ]:
by: James Wevertsen

5. BUREAU OF LICENSES & PERMITS
Date Notified:
Date Issued: Serial

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/12/72 by: Jerrold E. Hoad

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 231

PROPERTY WHERE SOIL TESTED:
Location: Township 9N R7E Block 2 Lot 3
Section & ¼ Sect. 33
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).

Owner: James F. Peterson
Address Nebraska Acres

Soil Type: Silty Clay [X]; Silty Clay Loam [ ]; Sandy Loam [ ]
Silty Loam [ ]; Clay Loam [ ]; Sandy Clay [ ]

Dates of Tests: _____ to _____. Weather: Precip. _____ Temp. ___F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	38	3/29	1100	5/25	1100	3/25	1100	32	1200	31	1 hour	1	
2										31		1	
3										27		3	
4										23		9	
5										31		1	
6										27		5	

Roger C. Bailey
Signature of Person Conducting Test

Address 4131 Clifford Dr
Phone: 489-8208

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

1" every 22 min

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 18 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: April 10, 1972

Jerrold C. Hood R.S.
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 231

SPECIFICATIONS

DATE: Nov 10 1971


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 73½ ft.
4. Number of clean-outs ___.
5. Distances To:
Well or Suction Line ___ ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Fiber; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 50 in.
3. Factory Built: Yes [X] (Company CORRIGATED FIBERGLASS) No [ ]
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. 6 in.
Below Grade 24 in.
5. Inlet: Baffle [X]; or Tee [ ]
6. Outlet: Baffle [ ]; or Tee [X]
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line 60 ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes [X], (Company DRE-CAST STEP) No [ ]
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank 7½ ft.
5. Serial Distribution: Yes [ ], No [X] (If yes, show detailed plans.)


D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF Round
2. Lateral Lines: Depth below grade 24 in. Number 2; Length of each line 100 ft Total length of Laterals 152 ft.; ~~149~~ Slope 4 in/100 ft. Diameter of pipe 16 in.; Shape ~
Material: concrete [ ]; fiber asbestos [ ]; clay [ ]; other ___
Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth ___ in.; Width 48 in.
4. Filter Material: Gravel.
Depth of material from trench bottom 16 in.
5. Distances To:
Well or Suction Line 100 ft.;
Stream ___ ft.; Pressure Line ___ ft.
Property Line ___ ft.
6. Percolation Rate: 18 minutes/inch

TYPICAL SKETCHES

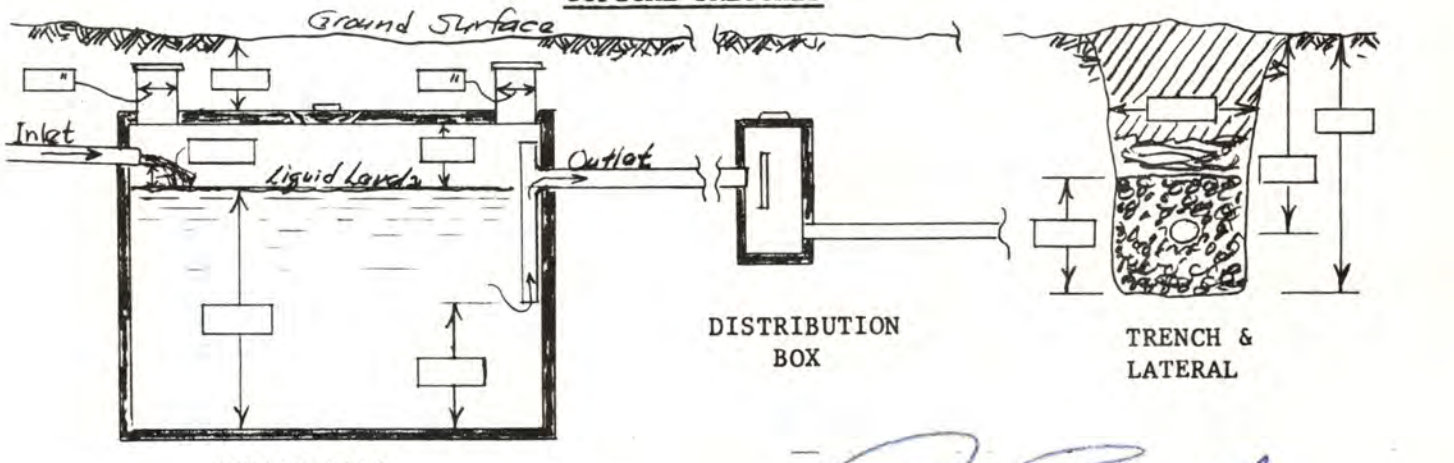

SEPTIC TANK

Signature of Applicant

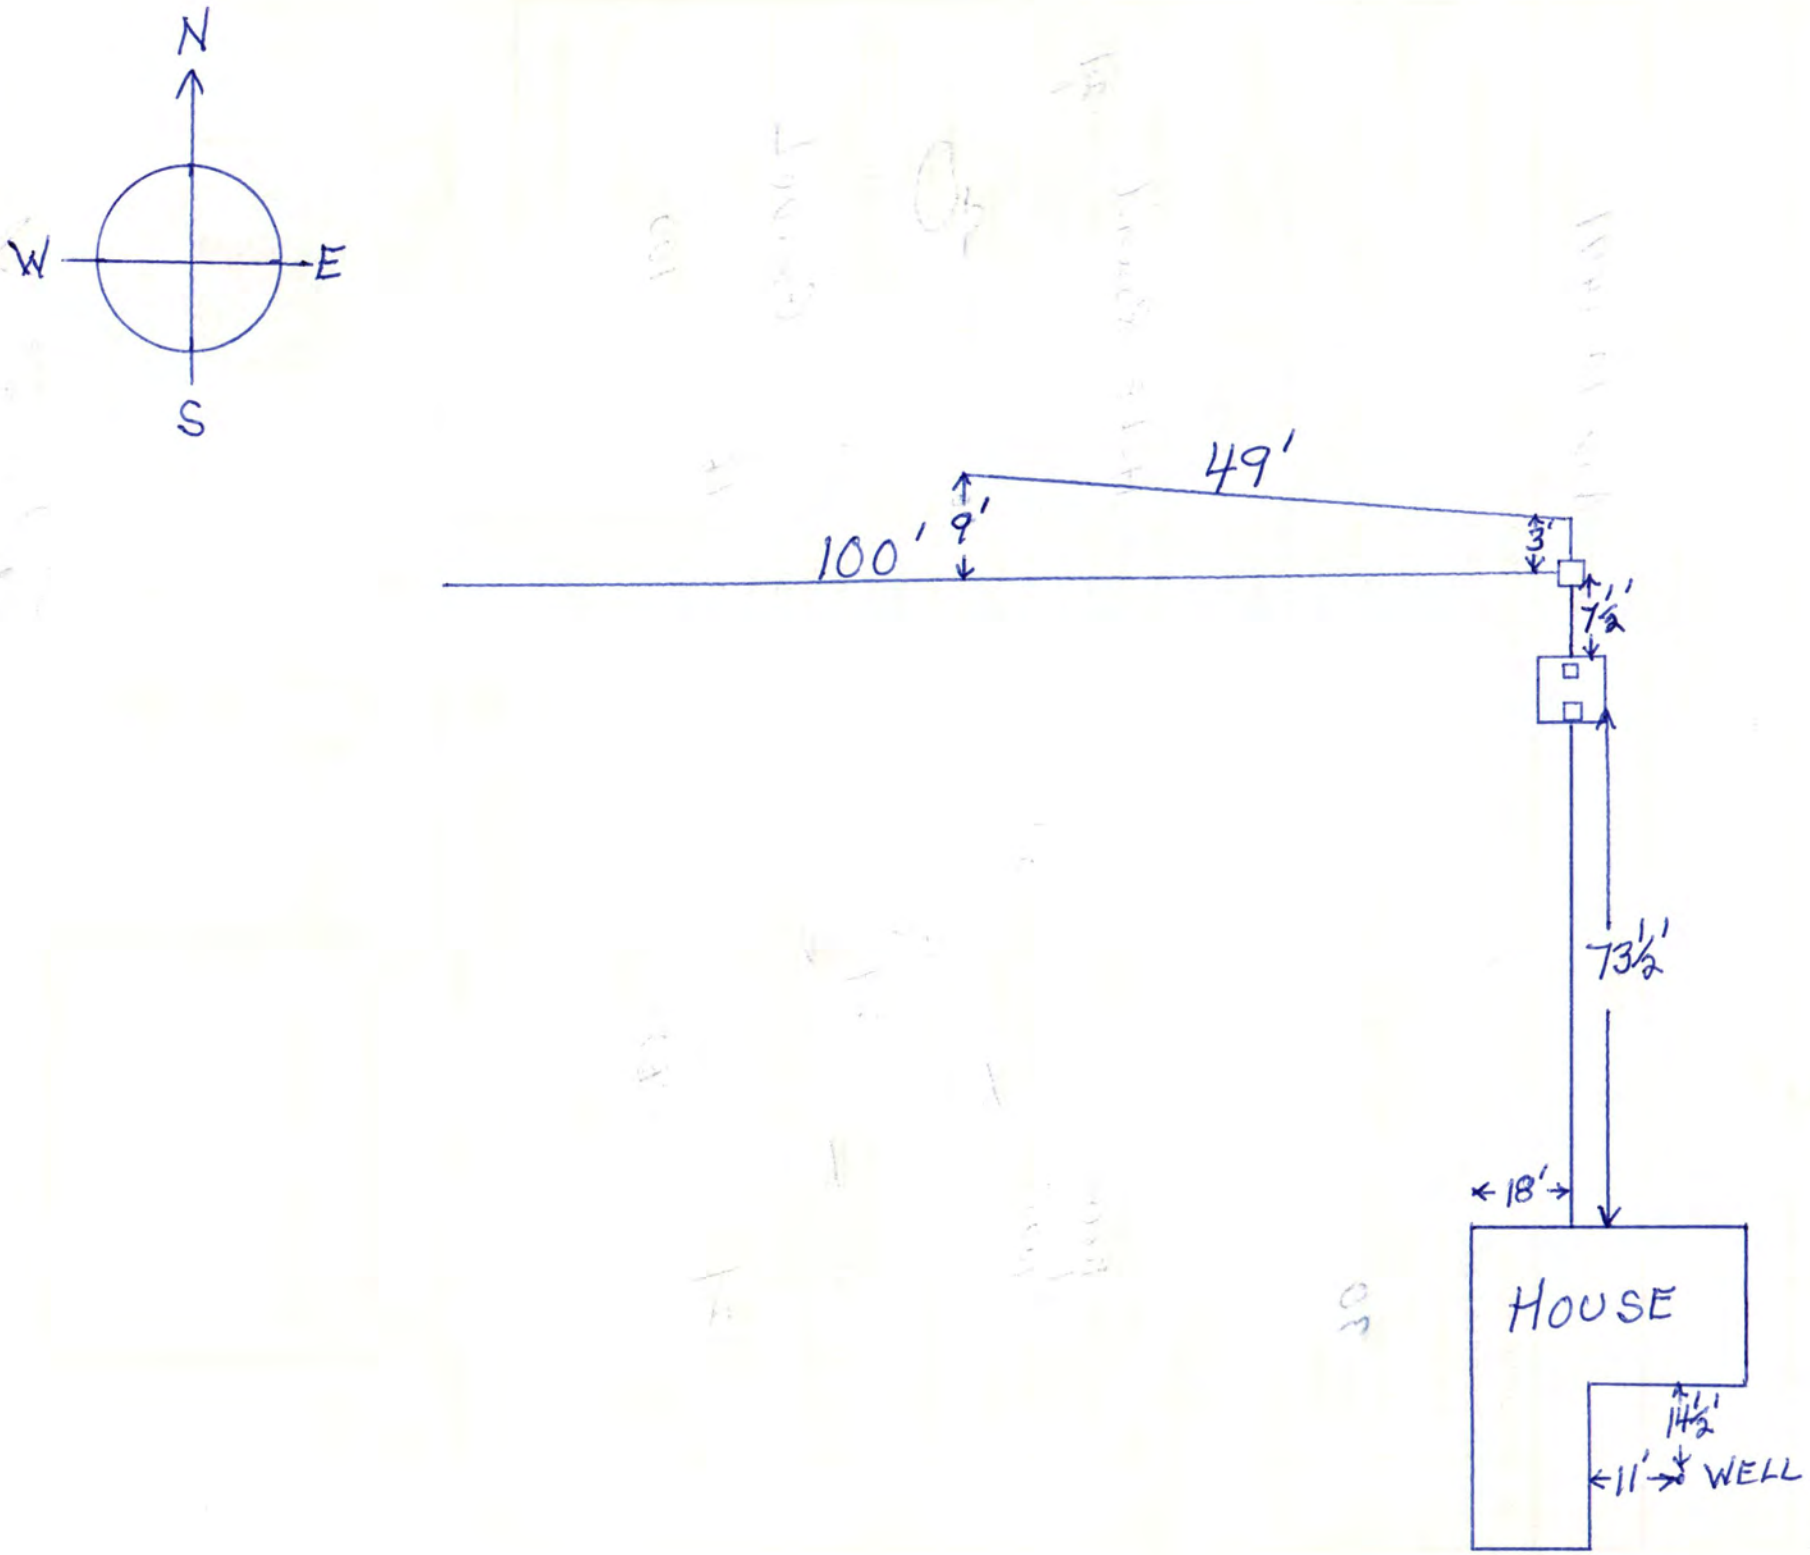
N
W
E
S
49'
100'
9'
3'
7½'
73½'
18'
HOUSE
14½'
11'
WELL