FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 150.00

FILE NO. _____

DATE: 4-22-93

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. ~~30~~ 9N ; Range 7E ; Section 33;
   Block 3 : Lot 7 : Addition Southdale Acres
   Street Address 5600 Saltillo Rd

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☐

4. Distance to public sewer: _____ ft. WILL INSTALL WHATEVER SOIL PERCOLATION TEST INDICATES

Kuhr Const Don Kuhr
Signature of Applicant (Owner or Lessee)

Rt 1 Box 138 Roca NE
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 4/22/93. Date Frwd. 4/23/93. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nool
2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 4/23/93. Date Frwd. 4/23/93. ACTION: Approved ☒ Disapproved ☐ Signature: Mary Spier
3. City or County Engineer: Date Rec'd. 4/23/93. Date Frwd. 4/23/93. ACTION: Approved ☒ Disapproved ☐ Signature: Dennis Bartels

REMARKS OR REASONS FOR DISAPPROVAL RURAL WATER DISTRICT

Site Visits:
Date: 8-6-93 by: P.D
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 8-6-93 By: Paul Waggoner

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23-43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

Test Taken So. 56th + Saltillo Rd
NE. side 11400 S56 Lot 7 Bk 3

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 9N ; Range 7E ; Section & ¼ Section 33.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☒ .
Dates of Tests: 6-2-93 to 6-3-93. Weather: Precip. .25 Temp. 50°.

OWNER: Kubr Construction INC.

Address: Rt. 1 Box 138 Roca, NE. 68430

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	6-2	4:00 pm	6-3	5:00 pm	6-3	5:00 pm	6"	9:00 pm	4 3/4"	30m	1 1/4"	
2	36"	6-2	4:00 pm	6-3	5:00 pm	6-3	5:00 pm	6"	9:00 pm	4 3/4"	30m	1 1/4"	
3	36"	6-2	4:00 pm	6-3	5:00 pm	6-3	5:00 pm	6"	9:00 pm	5"	30m	1"	
4	36"	6-2	4:00 pm	6-3	5:00 pm	6-3	5:00 pm	6"	9:00 pm	5"	30m	1"	
5	36"	6-2	4:00 pm	6-3	5:00 pm	6-3	5:00 pm	6"	9:00 pm	4 1/2"	30m	1 1/2"	
6	36"	6-2	4:00 pm	6-3	5:00 pm	6-3	5:00 pm	6"	9:00 pm	4-3/4"	30m	1 1/4"	

Mike Hoogland
Signature of Person Conducting Test

Address 2700 Daw Ave Lincoln, NE Phone 464-0638
Precast Products INC.

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Wymore Silty Clay Loam
Date: JUNE 15, 1993

Approved Percolation Rate (a)
A. 25 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. _____

Indicate on sketch if residence and well are exisiting or proposed.

REVIEWING ACTION

Remarks: _____

Date: JUNE 15, 1993

Minimum Design Requirement
1. Capacity of Septic Tank 1000 gals.
2. Total Length of Laterals 172 ft.
3. With a Trench Width of 48 in.
4. Total Area of Lateral needed 689 sq.ft.

Jerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: 8-6-93

FILE NO: 93380098O

~~1054 35 E4-3~~ 9-7-33 BK3 Lot 7


SPECIFICATIONS AS BUILT


A. BUILDING SEWER:
1. Material _____; Diameter _____ in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank _____ ft.
4. Number of clean-outs 1 inside house.
5. Distances to:
Well or Suction Line rural water ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material _____; No. of compartments _____.
2. Capacity 1,000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company Precast)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☒ Grade 24 in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 24 in.
8. Distances to:
Well or Suction Line Rural water ft.; Stream — ft.; Pressure Line _____ ft.; Property Line — ft.

C. DISTRIBUTION BOX:
1. Material Concrete; Number available outlets _____.
2. Factory Built: Yes ☒ No ☐
(Company Precast)
3. Distance from Septic Tank 5 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☒ Perforated Pipe ☐
Diameter of Half Round _____ or Perforated Pipe _____.
Material: fiberglass ☐ ; plastic ☐ ; concrete ☒ ; other _____.
2. Lateral Lines:
Number 2 ; Length of each line 100, 72, _____, _____, _____ ft.;
Total length of laterals 172 ft.;
Distance between lateral lines 15 ft.
3. Trench dimensions: Width 4 ft.;
Slope _____ in/100 ft.; Average Depth _____ in.
4. Filter Material: Gravel
Depth of Material _____ in.
5. Distances to:
Well or Suction Line Rural water ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

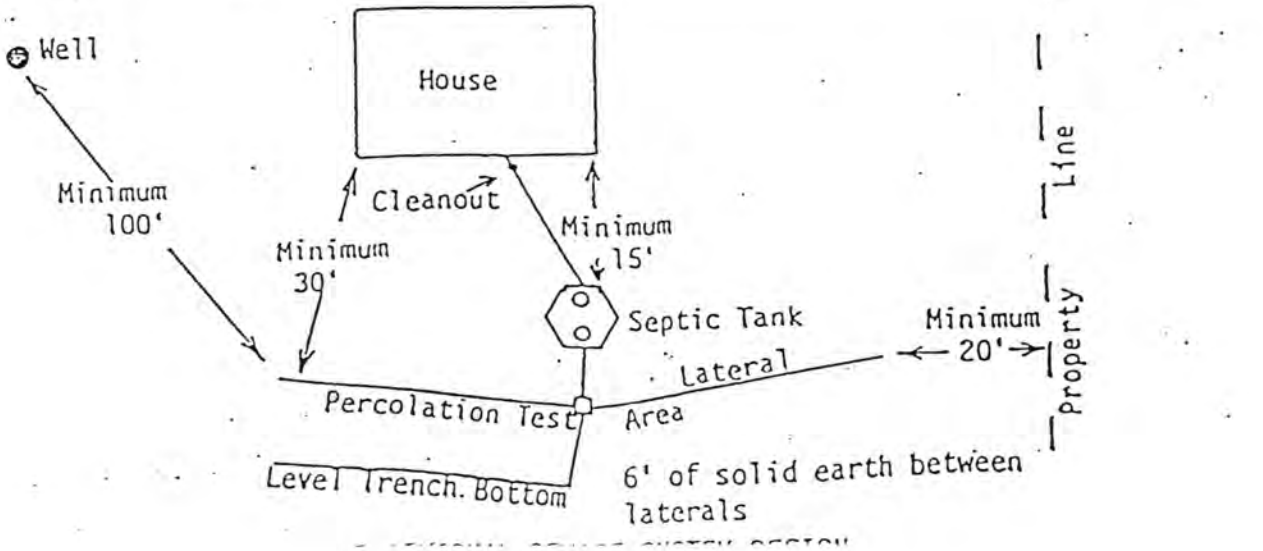

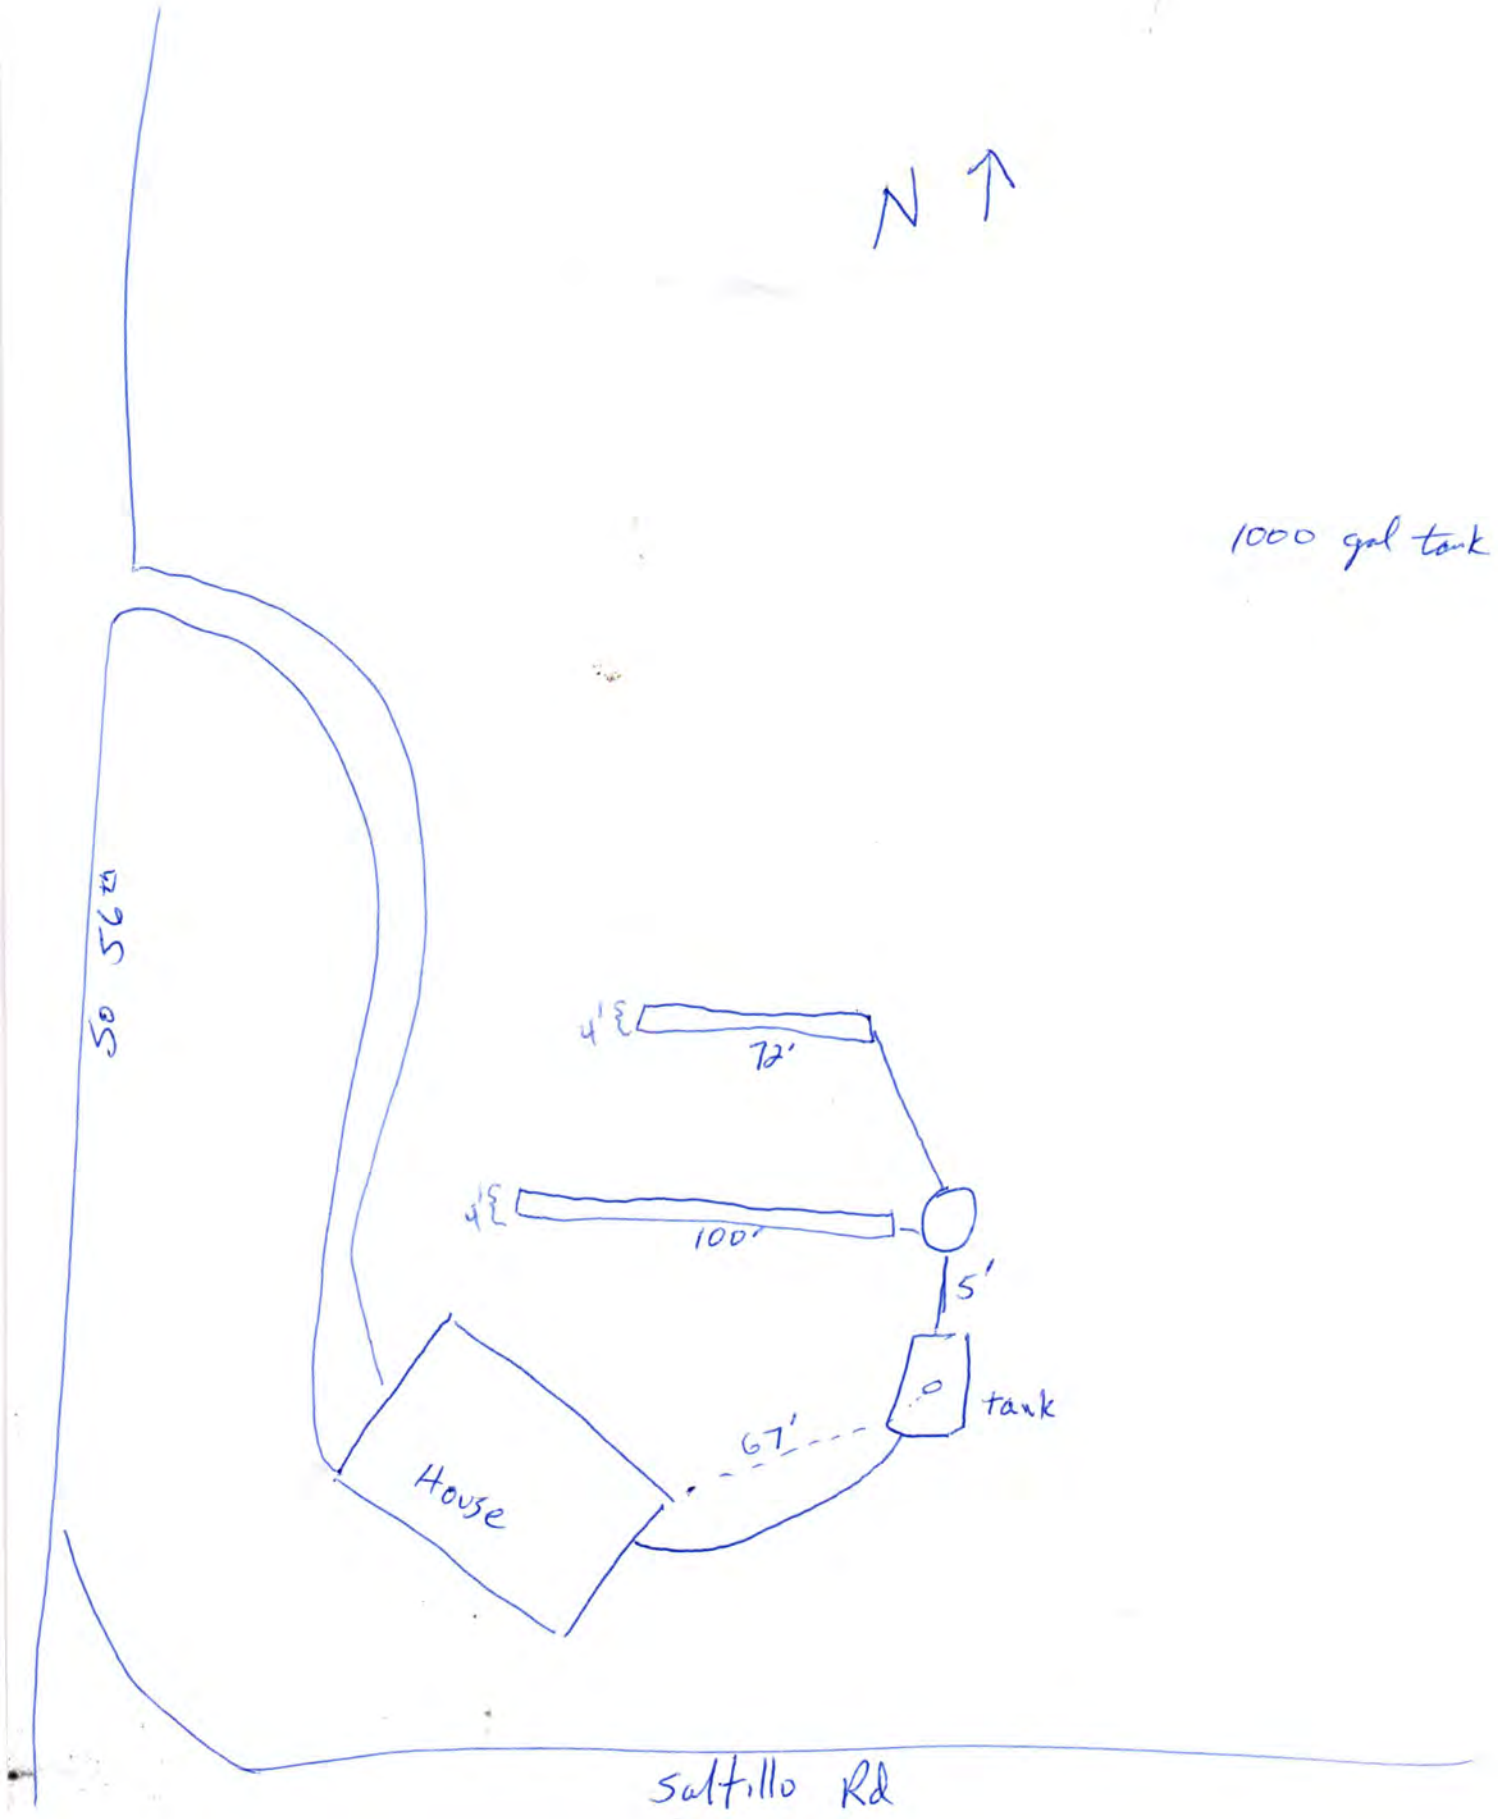
N
1000 gal tank
So 56th
4'
72'
4'
100'
5'
tank
67'
House
Saltillo Rd