FILE NO. 543

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

April 22, 1975 — THIS LICENSE OR PERMIT EXPIRES

Russell Bohaty — LICENSEE OR PERMITTEE

808 Smoky Hill — ADDRESS

T9N; R8E of 6 P.M.; 1/4 of Sec. 6; Lot Gov. 2; — NAME OF ESTABLISHMENT, IF ANY

LEGAL DESCRIPTION — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
624-1505 110.15	110.16	148.14	6-2	

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 543

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: October 21, 1974

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 9 North; Range 8 East of the 6th P.M.; Section Fractional Section 6
   Block _____; Lot Gov. Lot 2; Addition _____
   Street Address _____

2. Property Use: Residential _____ ☒ ; Commercial _____ ☐
   No. of Bedrooms 3 . Describe: _____
   Other Use _____ ☐
   Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

Russell G. Bhaty owner
Signature of Applicant (Owner or Lessee)

808 Smoky Hill Lincoln, Nebr.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 10/21/74 . Date Frwd. 10/22/74 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Wood
2. Supt. Bldg. Insp.: Date Rec'd. _____ . Date Frwd. 10-22-74 . ACTION: Approved ☒ Disapproved ☐ Signature: Ernest H. Bremmer
3. City ~~or County~~ Engineer: Date Rec'd. 10-22-74 . Date Frwd. 10-22-74 . ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO._____

DATE: Oct 21 1974

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9 North ; Range 8 East of the 6th P.M.; Section Fractional 6 _____; Block _____; Lot Nov. Lot 2; Addition _____.
   Street Address _____.

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
   No. of Bedrooms 3
   Describe: _____
   Other Use _____
   Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Russell G. Bohaty
Signature of Applicant (owner or lessee)

808 Smoky Hill Lincoln Nebr.
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;_____
   Filing Fee: $ 30.00

2. Site Visits:
   Date: July-7-75 by: rm
   Date:_____ by:_____
   Date:_____ by:_____

3. Date: Approved [X]; Disapproved [ ] 10/24/74
   by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: July-7-75 by: Ron Maynard

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Owner: Russell G. & Jennie L. Bohaty
Location: Township 9 N; Range 8 East of the 6th P.M.
Section & ¼ Sect. Fractional Section 6 Address 808 Smoky Hill, Lincoln Nebr
Property Dimensions: 453 ft. x 482 ft.
Area: 5.01 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: Oct 19, 1974 to Oct 20, 1974. Weather: Precip. 0 Temp. 65 F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	32	Oct 19	1:10 PM	Oct 19	5:10 PM	Oct 20	1:10 PM	6"	5:10 PM	4¾"	30	1¼"	
2	32	Oct 19	1:12 PM	Oct 19	5:12 PM	Oct 20	1:12 PM	6"	5:12 PM	5¼"	30	¾"	
3	32	Oct 19	1:14 PM	Oct 19	5:14 PM	Oct 20	1:14 PM	6"	5:14 PM	4½"	30	1½"	
4	32	Oct 19	1:16 PM	Oct 19	5:16 PM	Oct 20	1:16 PM	6"	5:16 PM	5"	30	1"	
5	32	Oct 19	1:18 PM	Oct 19	5:18 PM	Oct 20	1:18 PM	6"	5:18 PM	4½"	30	1½"	
6	32	Oct 19	1:20 PM	Oct 19	5:20 PM	Oct 20	1:20 PM	6"	5:20 PM	5¼"	30	¾"	

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

Russell G. Bohaty
Signature of Person Conducting Test

Address 808 Smoky Hill Road
Phone: 489-3202

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 27 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: October 21, 1974

Jerrold C. Woods
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. _____

SPECIFICATIONS

DATE: Oct 21 1974


A. BUILDING SEWER:
1. Material S.V. Tyler; Diameter 3½ in.
2. Distance above ~~basement floor~~ Crawl space 42 in. below grade
or below ~~basement floor~~ ____ in.
3. Distance between dwelling and septic tank 20 ft.
4. Number of clean-outs 3.
5. Distances To:
Well or Suction Line ____ ft.;
Stream ____ ft.; Pressure Line 165 ft.;
Property Line 205 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 47 in.
3. Factory Built: Yes ☒ (Company PreCast)
No ☐
4. Manholes: Over Inlet; diam. ____ in.
Over Outlet; diam. ____ in.
Below Grade 12 in.
5. Inlet: Baffle ☒; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
Well or Suction Line ____ ft.;
Stream ____ ft.; Pressure Line 165 ft.;
Property Line 150 ft.

C. DISTRIBUTION BOX
1. Material ____; No. available outlets ____.
2. Factory Built: Yes ☐, (Company ____)
No ☐
3. Dimension: Length ____ in.; Width ____ in.
Depth ____ in.
4. Distance from Septic Tank ____ ft.
5. Serial Distribution: Yes ☐, No ☐
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Pre-Cast
2. Lateral Lines: Depth below grade 12 in.
Number 2; Length of each line 100 ft
Total length of Laterals 178 ft.;
Slope 4" in/100 ft. Diameter of pipe 24 in.; Shape half round
Material: concrete ☒; fiber asbestos ☐; clay ☐; other ____
Distance between lateral lines ____ ft.
3. Trench Dimensions: Depth 32 in.;
Width 48 in.
4. Filter Material: Coarse Road gravel
Depth of material from trench bottom 20" in.
5. Distances To:
Well or Suction Line ____ ft.;
Stream ____ ft.; Pressure Line 165 ft.
Property Line 50 ft.
6. Percolation Rate: ____ minutes/inch

TYPICAL SKETCHES

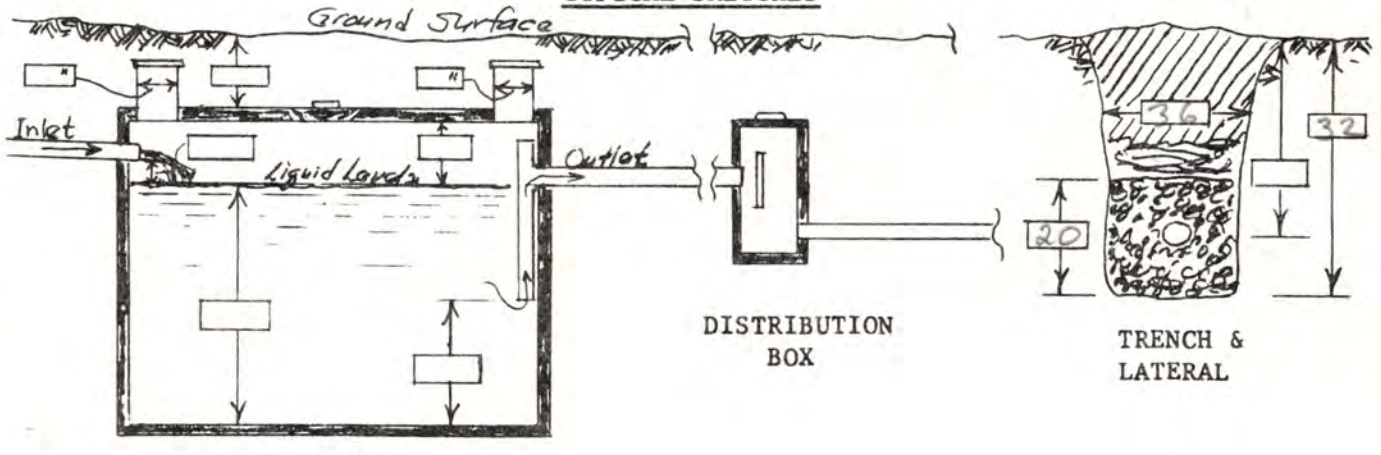


SEPTIC TANK


DISTRIBUTION BOX

TRENCH & LATERAL

Signature of Applicant

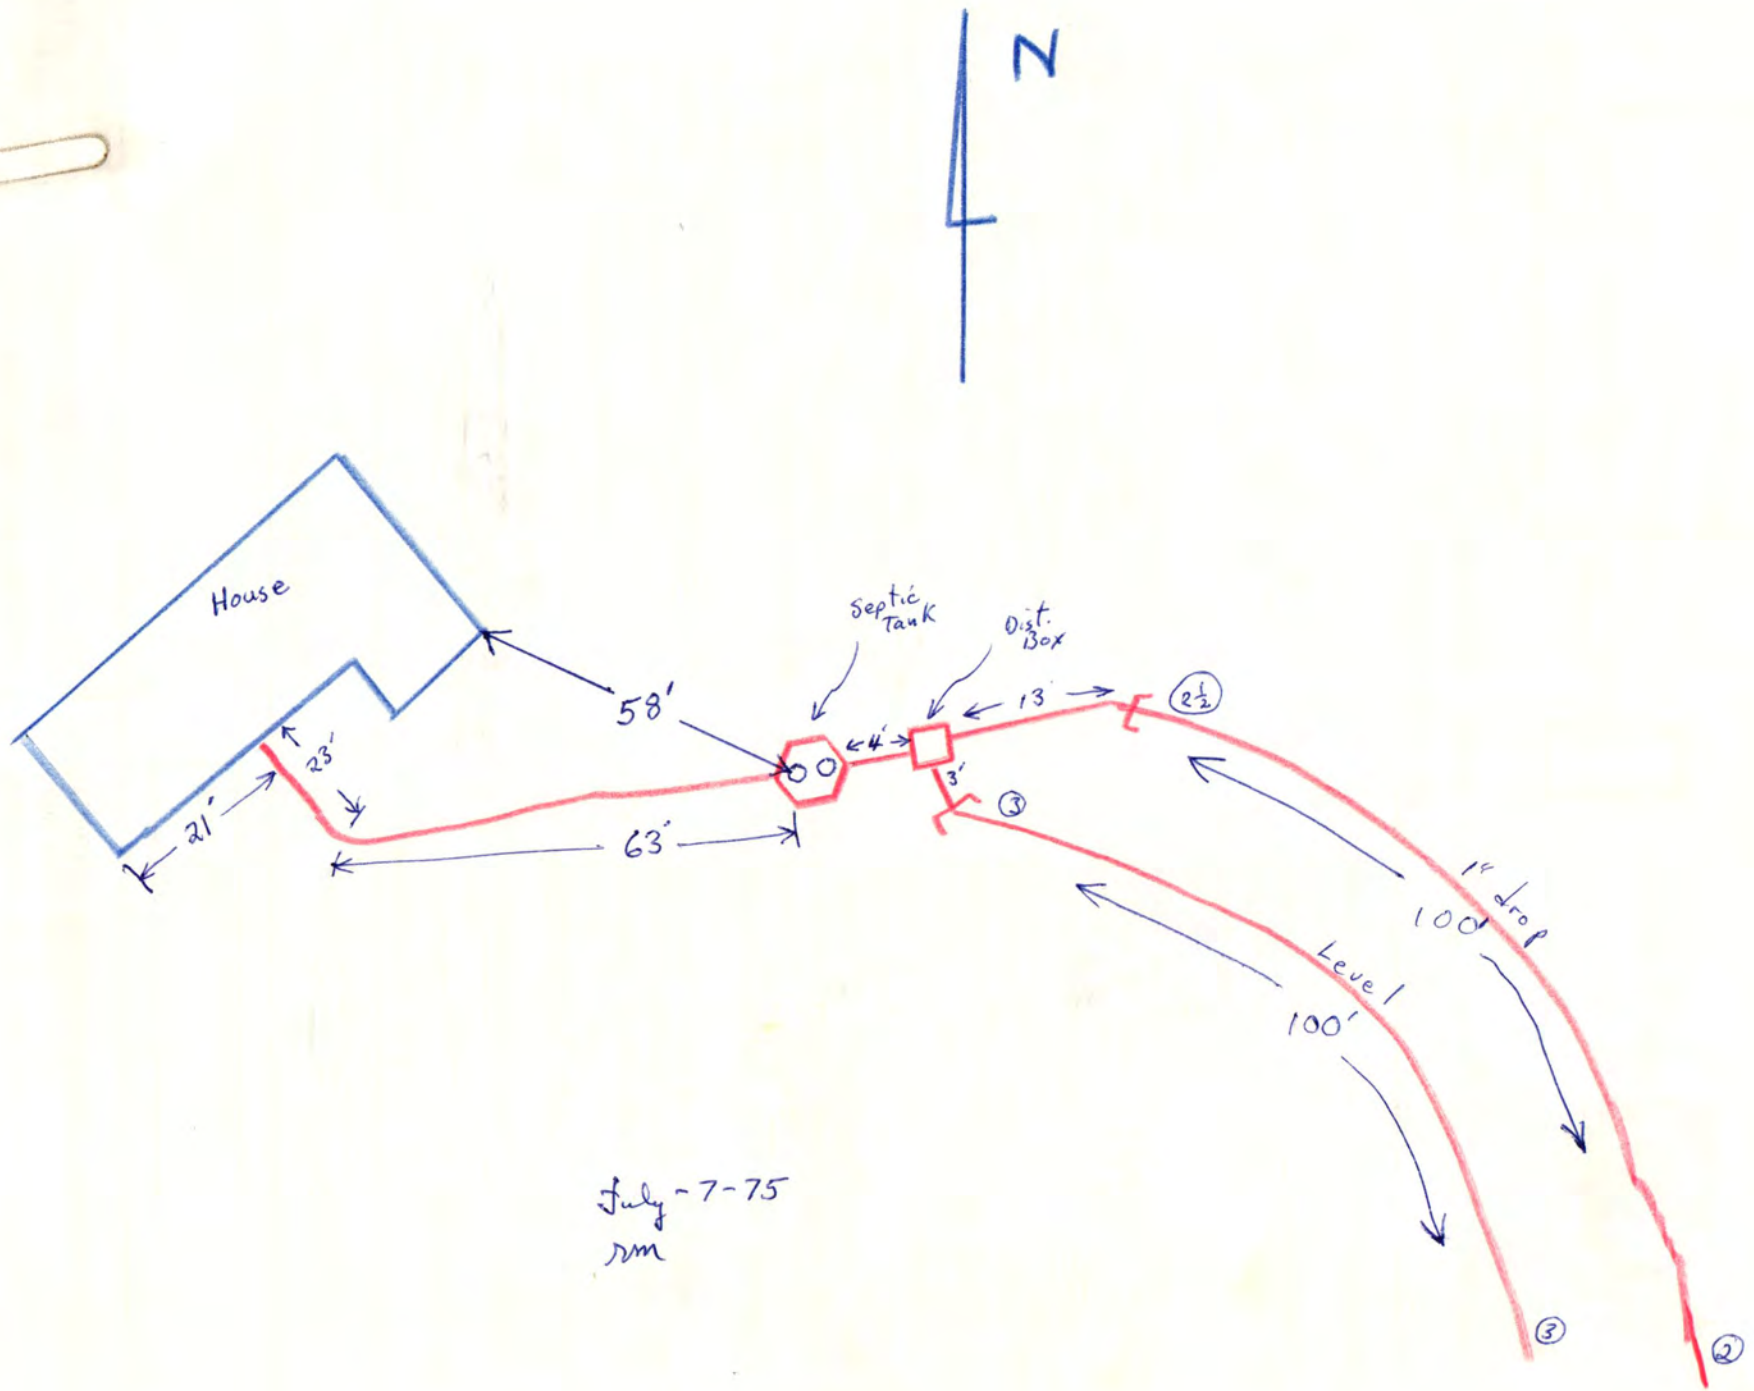
N
House
58'
23'
21'
63'
Septic Tank
Dist. Box
4'
13'
3'
2½
3
1st drop
100'
Level
100'
3
2

July - 7 - 75
rm

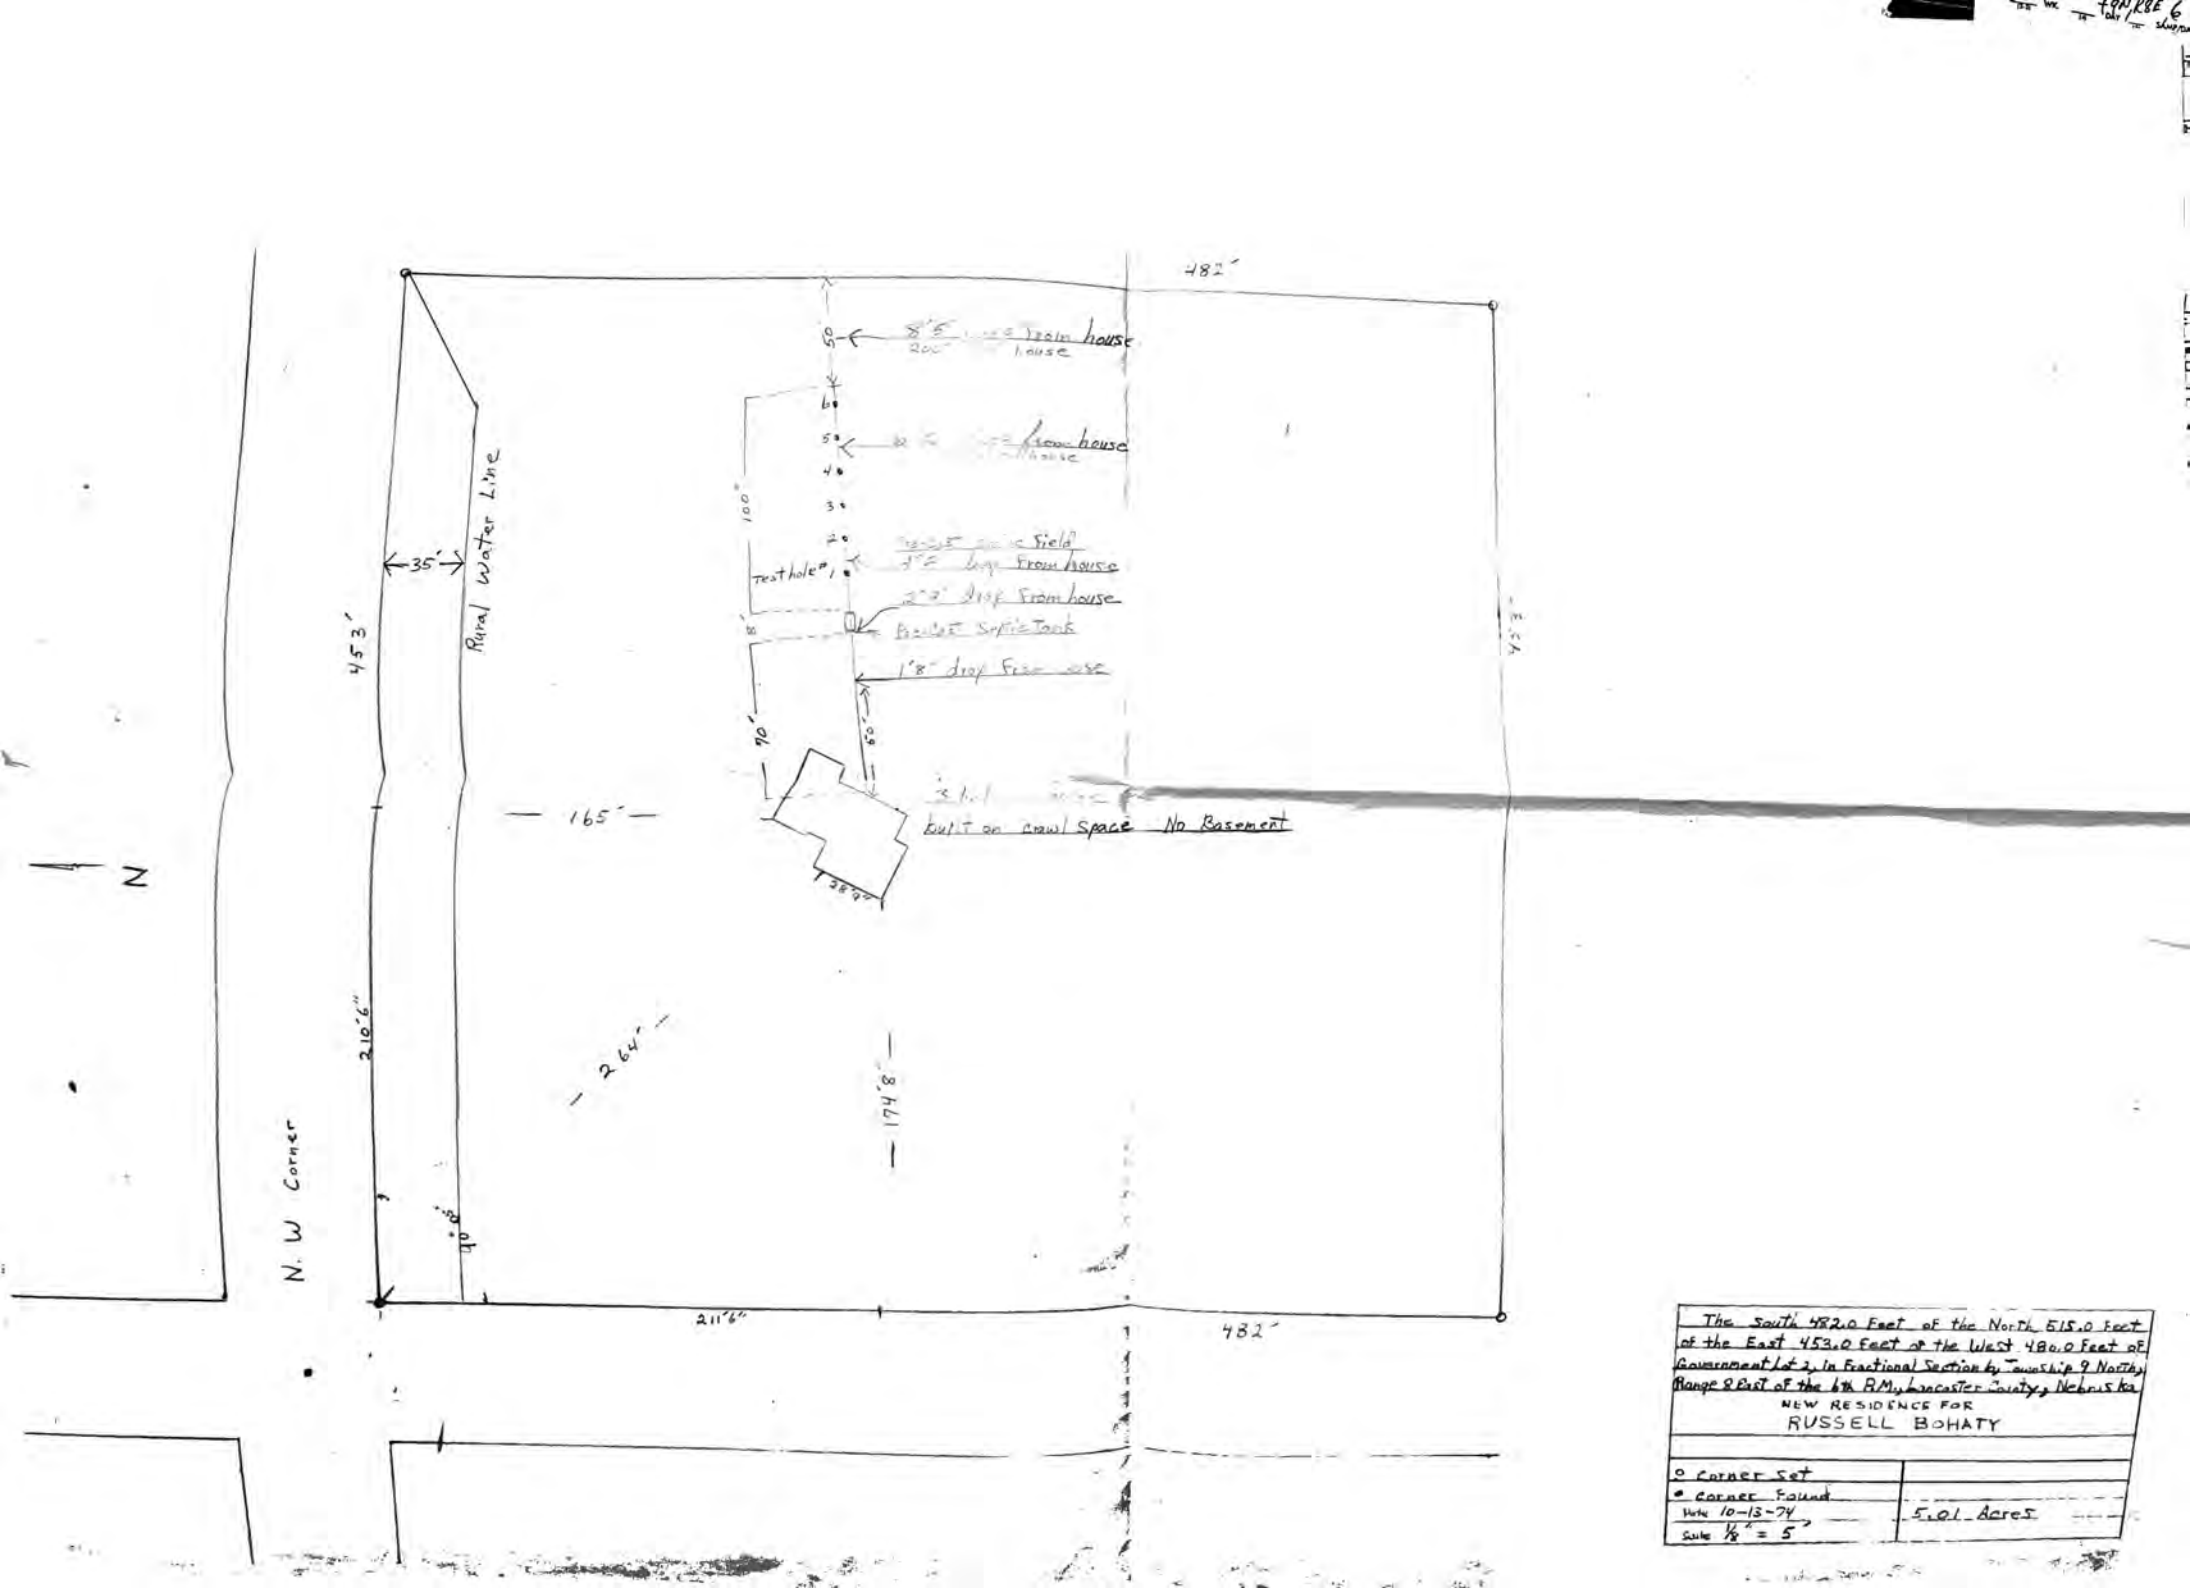

The South 482.0 Feet of the North 515.0 Feet of the East 453.0 Feet of the West 480.0 Feet of Government Lot 2, in Fractional Section 6, Township 9 North, Range 8 East of the 6th P.M., Lancaster County, Nebraska

NEW RESIDENCE FOR

RUSSELL BOHATY

○ Corner Set	
● Corner Found	
Date 10-13-74	5.01 Acres
Scale 1/8" = 5'	