LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 2432-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

JUNE 9, 1987 — THIS PERMIT EXPIRES

DWIGHT HANSON — ISSUED TO

BOX 9 — ADDRESS

ITHACA, NE 68033

T12N, R7E; Sec SW¼ 1 — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY	DATE	AMOUNT
M	12 16 86	

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH — ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 12N ; Range 7E ; Section & ¼ Section SW¼ 1.
Property Dimensions: 381 ft. x 697 ft. Area: 6.19 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☒ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: _____ to _____. Weather: Precip. .20 Temp. 55.

OWNER: PAUL FINIGAN

Address: LINCOLN, NEBRASKA

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1		11/21	4:00 PM	11/22	8:00AM	11/22	8:00AM	14⅛	12:00	20¼	240	6.125	39.18
2								18½		26		7.5	32
3								17½		25¾		8.25	29.09
4								18½		28½		10	24
5								21		30½		9.5	25.26
6								21½		30		8.5	28.24

Victor Hanson By Dennis Hanson
Signature of Person Conducting Test

Sum of Percolation Rates: 177.77
Average of Rates: 29.63
Mean of Rates: _____

Address Box 9 Ithaca, Ne 68033 Phone 623-4293

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): GEARY SILTY CLAY LOAM
Date: NOVEMBER 10, 1986

Approved Percolation Rate (a)
A. 29 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. 2432-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 12/6/86

The undersigned hereby applies for a permit to ALTER ☑, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 12N; Range 7E; Section 1 SW¼;
Block _____; Lot _____; Addition 6.19 Acres
Street Address _____

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. Bedrooms 3
Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Description of proposed alteration, extension or repair: Install New Lateral Field

5. Work to be done by: Owner ☐; or Contractor ☑, Hansen Well Co
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	2400 00

Dennis Hansen
Signature of Applicant (owner or lessee)

Box 9 Ithaca, Ne 68033
Address

(Do not write below this line)

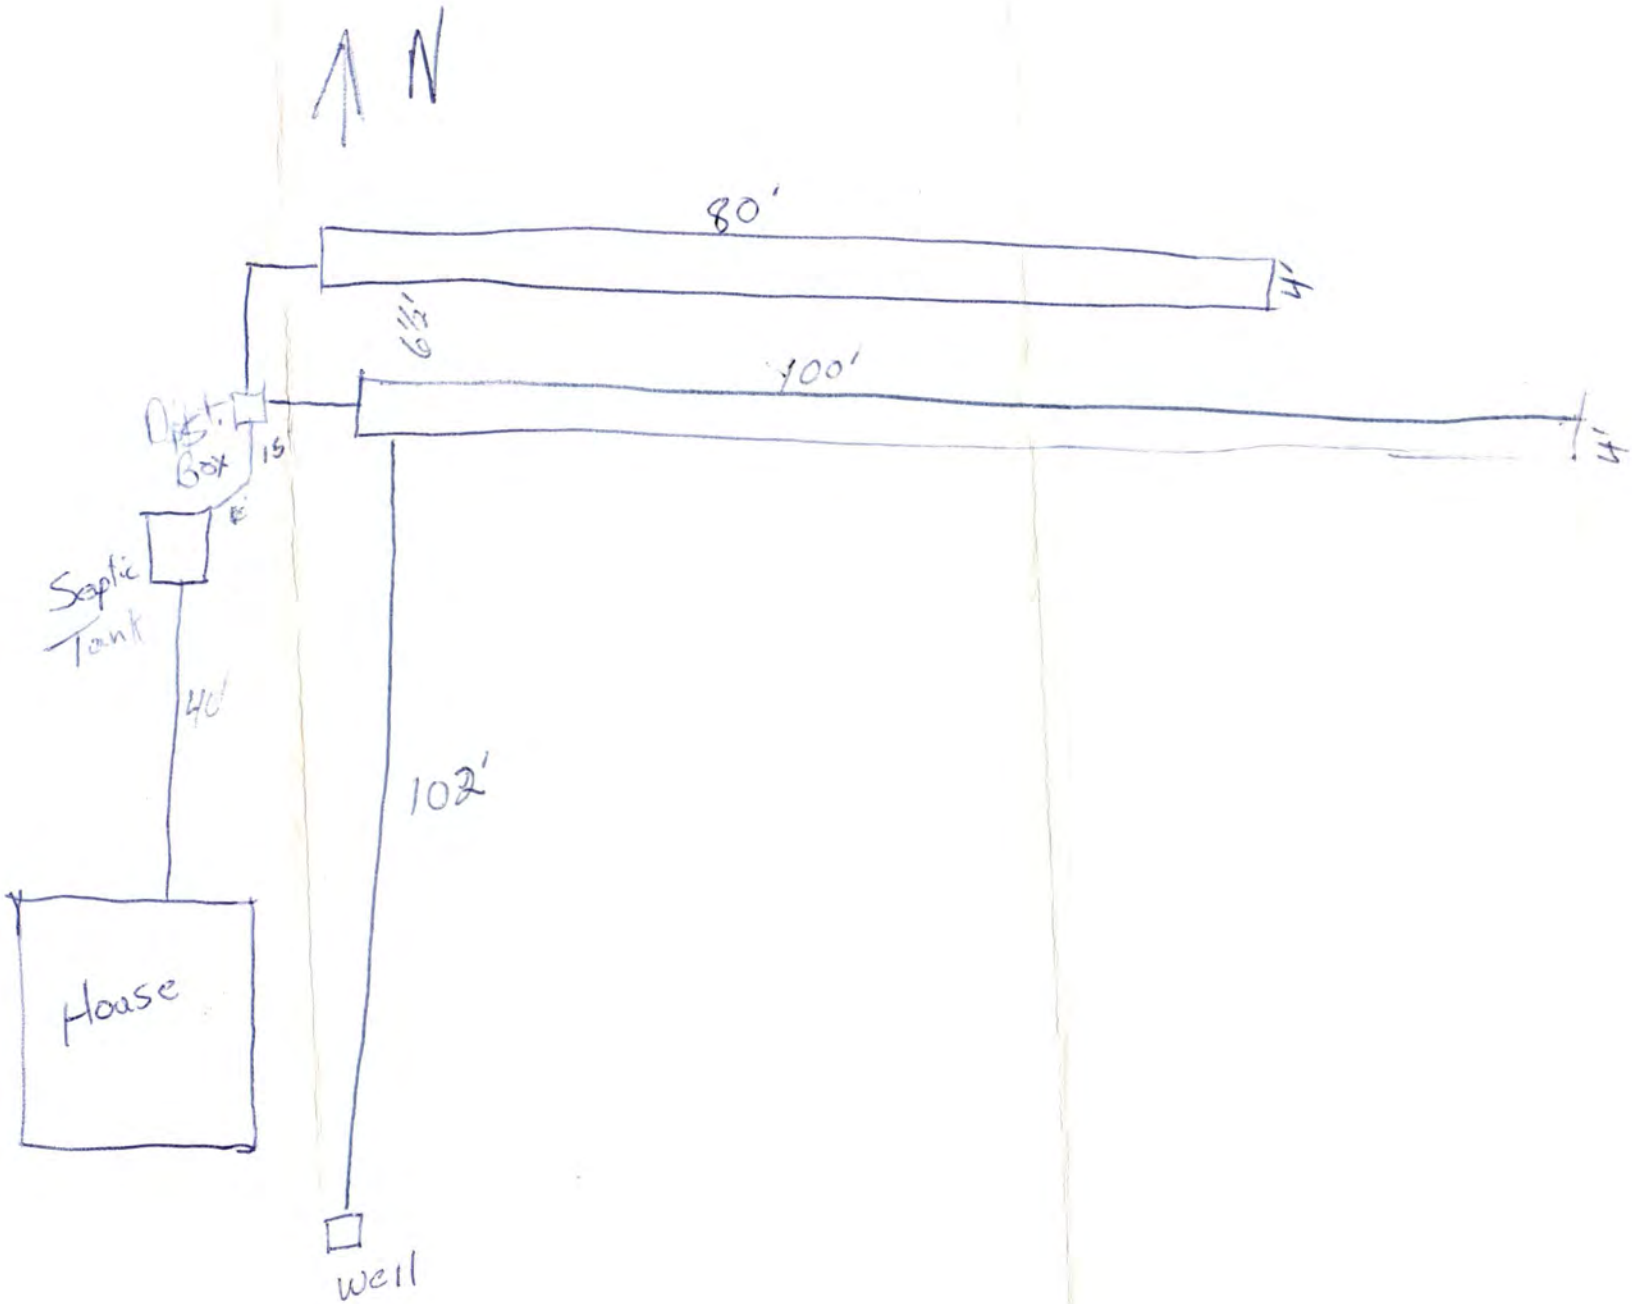
REVIEWING ACTION

1. Date Rec'd: 12-9-86
Filing Fee: $ 30.00

2. Site Visits:
Date: 12-5-86 by: JM
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold E. Head

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 12-9-86 by: Ka Margaret


N
80'
4'
15'
100'
4'
Dist. Box
15'
Septic Tank
40'
102'
House
well