LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2528-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

JANUARY 21, 1988 — THIS PERMIT EXPIRES

SCOTT FITZGERALD, STROHMYER EXCAVATING, 4201 NO. 27 STREET, LINCOLN (21)
ISSUED TO — ADDRESS

T9N; R8E; Sec 32; Lot 16 I.T.
LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY	DATE	AMOUNT
MG	7-22-87	

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

JUL 2 1 1987

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

WE Hush.

FILE NO. 2528-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 7-20-87

The undersigned hereby applies for a permit to ALTER ☑, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 9N; Range 8E; Section 32;
Block —; Lot 16 Irr.; Addition _____
Street Address _____

2. Property Use: Residential ☒; Commercial ☐
No. Bedrooms 3
Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Description of proposed alteration, extension or repair: _____

5. Work to be done by: Owner ☐; or Contractor ☒, Strohmyer Excavating
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	
TOTAL	$	

Scott Fitzgerald Strohmyer Excavating
Signature of Applicant (owner or lessee)

4201 N 27th Lincoln
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30


2. Site Visits:
Date: 7-15-87 by: mm
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hoos

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 7-22-87 by: Lon Mayeux

2528-C

10205 So. 134th

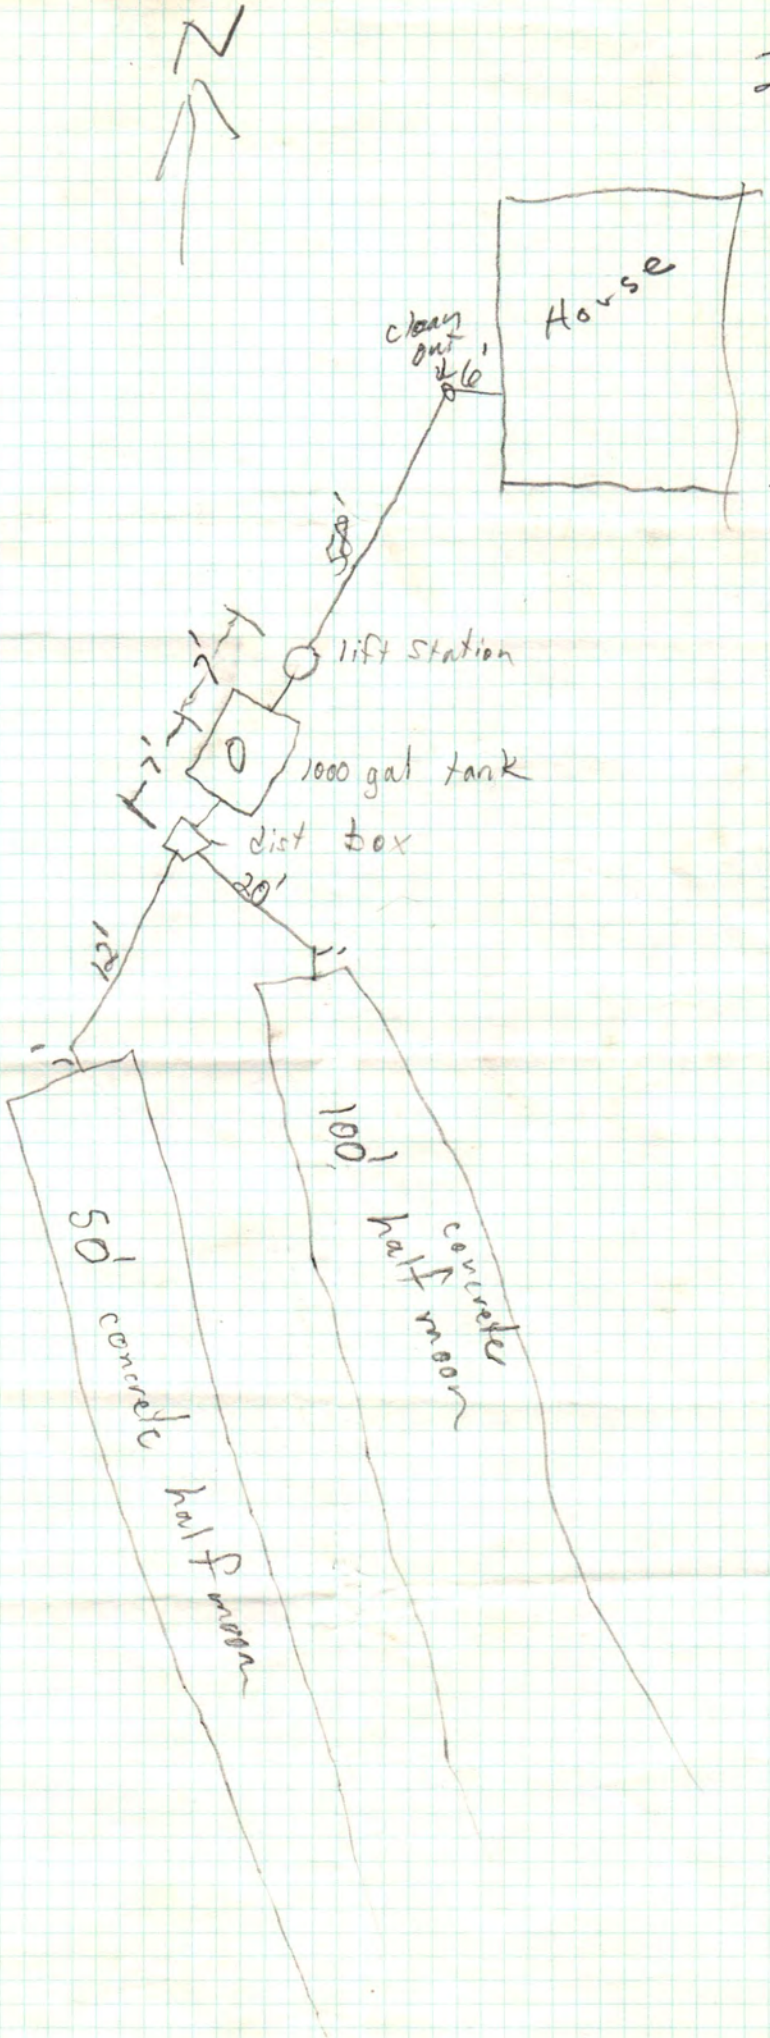

Legal Description — Lot 16, N.E. 32-9-8 Stockton Township, Lancaster County

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St. Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 4-18-89

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $75.00

Legal Description of Property: (See Above) TWP. 9N; RANGE 8E; SECTION 32; BLOCK ____

LOT 16 IT; ADDITION _____; Street Address 10205 South 134th Bennet, Nebr.

Directions to Property 134th + Hwy 2 - South 1/3 mile - 3rd House on West side - just North of R/R Tracks - Red House

Location of Well ? Ask present owner Tap Location: Inside ☒ (Garage?) Outside ☐

Location of Sewage System Behind House Year Installed ? New 2-5 yrs ago?

	NAME	ADDRESS	PHONE
Present Owner:	William Ernst + Barbara Kuhn	10205 South 134 Bennet Nebr	782-8971 (Work 421-5240)
Tenant/Buyer:	Kenneth + Jeanne Chapp	2610 South 37 Lincoln, Nebr 68506	483-6312
Return to:	Kenneth Chapp (SC Mortgage Trust)	" " " "	"

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Kenneth Chapp (Mary Ann Chapp) Address 2610 South 37 Lincoln, Neb. 68506

==========

HEALTH DEPARTMENT USE ONLY

Date Received APRIL 18, 1989 Received $75.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 4/19/89

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒ (correction made)	☒	Approved:	☐	Date 4/19/89 by LCH
Bacteria	☒	☒	Provisional:	☐	Date 4-27-89 by mm
Nitrate	☒	☐	Disapproved:	☐	Date 5-15-89 by mm

Comments: NO SANITARY WELL SEAL. WELL DITCH. Recommend checking to see if septic tank need pumping

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☒ (* Recommend either a section of garage foundation be removed to ground level of well or connection to Lan Co RWD #1 Public Supply.)

SEWAGE DISPOSAL SYSTEM: Approved: ☐ Provisional Approval: ☒

APPROVED BY for Margaret DATE 4-28-89

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832