LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 1177-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

March 29, 1978 — THIS PERMIT EXPIRES

Bruce A. Bunik — ISSUED TO

3300 Huntington, Lincoln, NE 68504 — ADDRESS

T12N, R6E, Section 32, Block 5, Lot 5, Addition Willard Estates — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH — ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1177-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: _____

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 12 North; Range 6 East ~~of the 6th P.M.~~; Section 32
Block 5; Lot 5; Addition WILLARD ESTATES
Street Address _____

2. Property Use: Residential ☒; Commercial ☐
No. of Bedrooms 3. Describe: _____
Other Use ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: _____ ft.

Bruce A. Burak
Signature of Applicant (Owner or Lessee)

3300 Huntington Lin. Ne.
Address

466-3228

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 9/28/77. Date Frwd. 9/29/77. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nook

2. Supt. Bldg. Insp.: Date Rec'd. _____. Date Frwd. _____. ACTION: Approved ☐ Disapproved ☐ Signature: _____

3. City or County Engineer: Date Rec'd. 9/29/77. Date Frwd. 9/29/77. ACTION: Approved ☐ Disapproved ☒ Signature: Denny Graff

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

Wesley W. Mowery

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1177-C

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 12 North; Range 6 East ~~of the 6th P.M.~~; Section 32; Block 5; Lot 5; Addition WILLARD ESTATES.
Street Address _____.

2. Property Use: Residential _____ [X]; Commercial _____ ☐
No. of Bedrooms 3 Describe: _____
Other Use _____
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [x]; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Bruce A. Benik
Signature of Applicant (owner or lessee)

3300 Huntington Lin. We.
Address
466-3228

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd; _____
Filing Fee: $ 30.00

2. Site Visits:
Date: 11-21-77 by: jw
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved [X]; Disapproved ☐ 9/29/77
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 11-21-77 by: James Neverka

FORM HD-43 (73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 474-1541)

FILE NO. 1177-C

PROPERTY WHERE SOIL TESTED: Owner:
Location: Township 12 North : Range 6 East of the 6th P.M. Address:
Section & ¼ Sect. 32
Property Dimensions: 430 ft. x 300 ft. x 260 x 130
Area: 2.70 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ; Silty Clay Loam ; Sandy Loam
Silty Loam ; Clay Loam ; Sandy Clay

Dates of Tests: Sept 18-77 to Sept 19-77. Weather: Precip. 0 Temp. 70°

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	32"	9/18	5/PM	9/19	4/PM	9/19	4/PM	12"	7PM	3½	30M	¾	
2										2¼		1	
3										3⅞		¾	
4										3¼		¾	
5										7		½	
6										7		½	

Robert D Johnson
Signature of Person Conducting Test

Address 2618 no 3rd
Phone 432 3595

Sum of Percolation Rates:
Average of Rates:
Mean of Rates:

(Do not write below this line)

REVIEWING ACTION

REMARKS: Shelby Clay Loam (S.C.L.)

DATE: September 29, 1977

Approved Percolation Rate (a)
A. 44 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

House
120'
80'
100'
well
100'
30'
1
2
3
4
5

FORM HD-45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1177-C

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material _____; Diameter ____ in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank ____ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 51 in.
3. Factory Built: Yes ☒ (Company Pre Cast Step) No ☐
4. Manholes: Over Inlet; diam. 6 in.
Over Outlet; diam. 6 in.
Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☒, or Tee ☐
Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

C. DISTRIBUTION BOX
1. Material Concrete; No. available outlets 5.
2. Factory Built: Yes ☒, (Company Pre Cast Step Co) No ☐
3. Dimension: Length 20 in.; Width 14 in. Depth 14 in.
4. Distance from Septic Tank ____ft.
5. Serial Distribution: Yes ☐, No ☐ (If yes, show detailed plans.)


D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Half moon
2. Lateral Lines: Depth below grade ___in. Number ____; Length of each line ___ft Total length of Laterals 223 ft.; Slope ____in/100 ft. Diameter of pipe 30 in.; Shape Half moon Material: concrete ☒; fiber asbestos ☐; clay ☐; other _____ Distance between lateral lines ____ft.
3. Trench Dimensions: Depth ___in.; Width 48 in.
4. Filter Material: Road Gravel. Depth of material from trench bottom _____in.
5. Distances To:
Well or Suction Line ____ft.;
Stream _____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

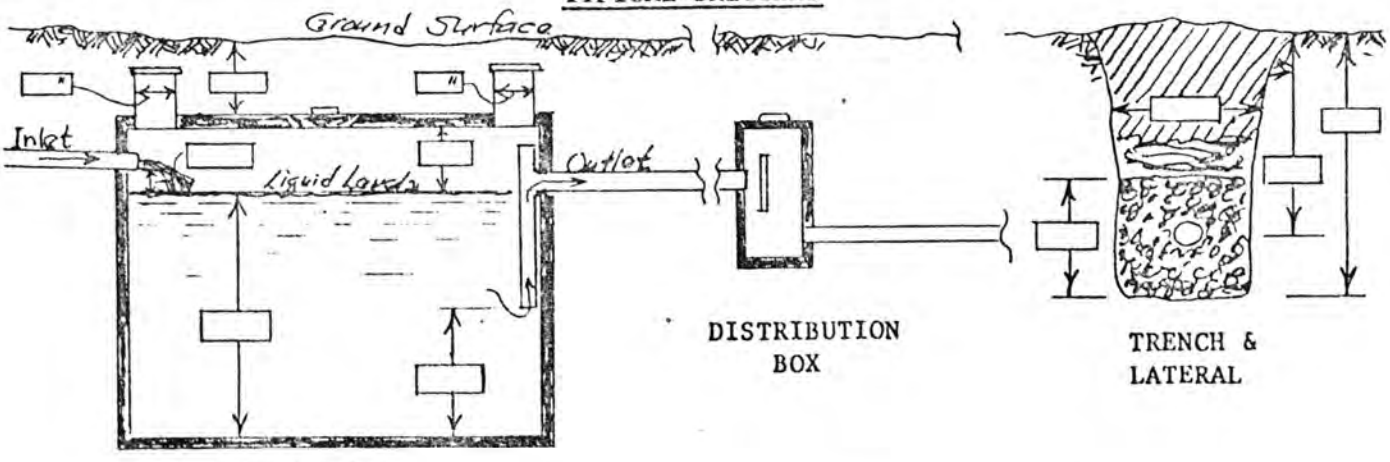

_____
Signature of Applicant

Larry Schwarck

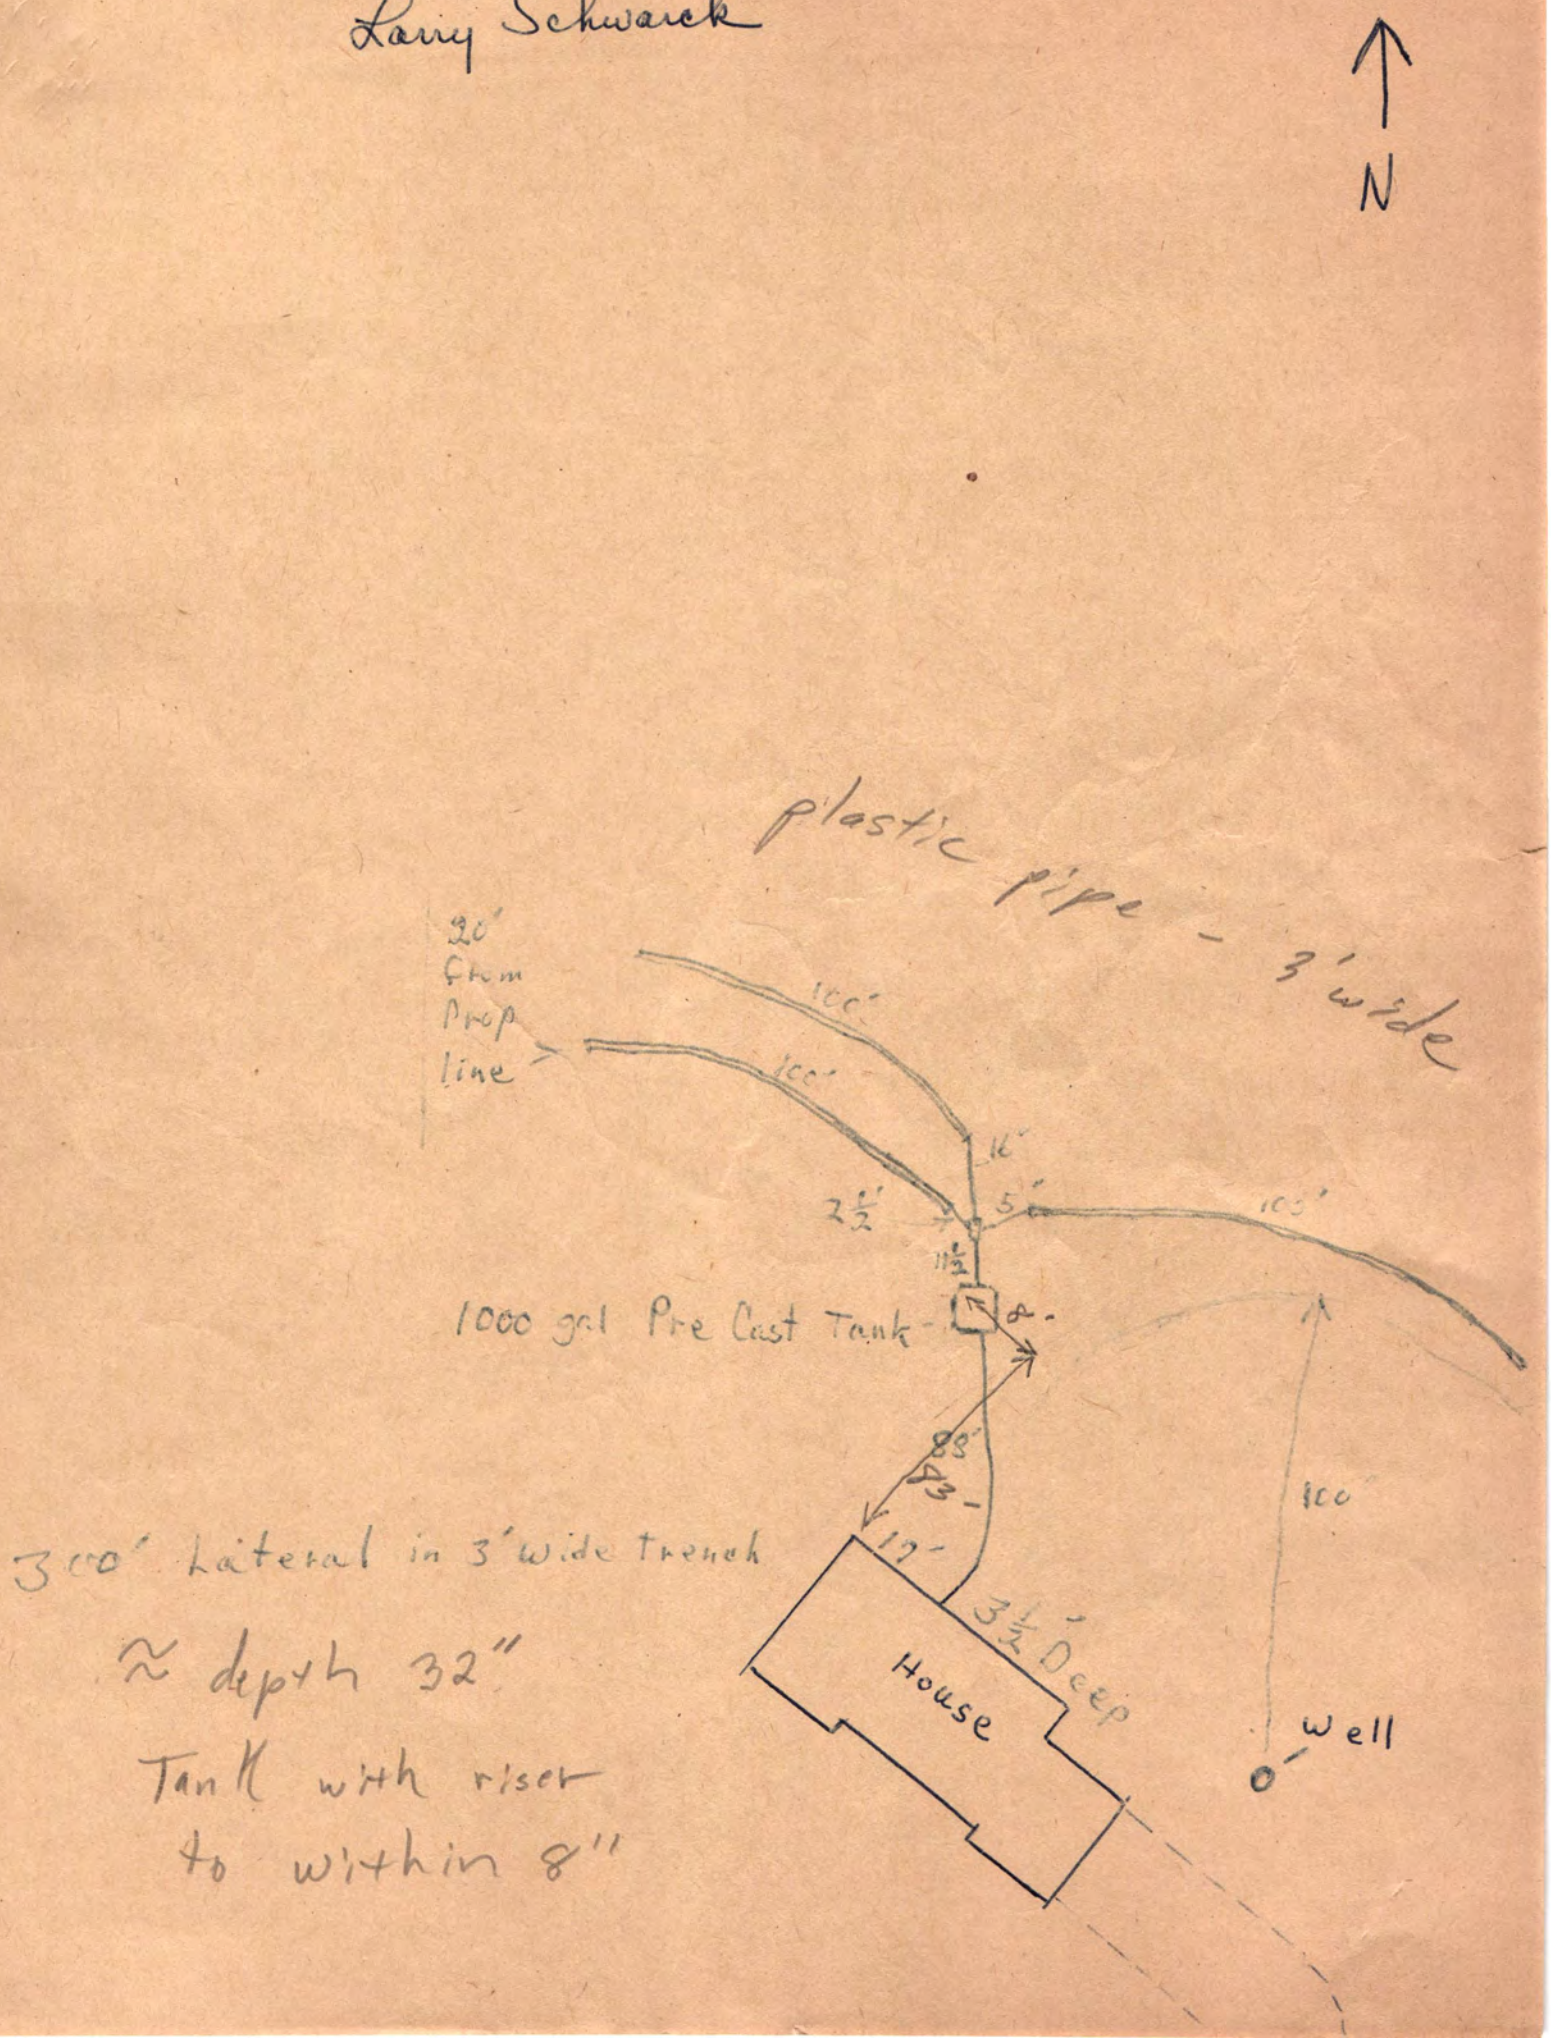

019

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☐ Evaluation of the Individual Water System Date: Sept 13, 1992

☐ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 12 North RANGE 6E; SECTION SE¼ Sec 32; BLOCK 5

LOT 5; ADDITION Willard Estates; Street Address RR1 Box 3000

Directions to Property 3rd house off Raymond Road on NW 31

Location of Well 15 ft East of Driveway Tap Location: Inside ☐ Outside ☐

Location of Sewage System 10 ft from Weeping Willow tree Year Installed 1978

	NAME	ADDRESS	PHONE
Present Owner:	Peter C Thompson	RR1 Box 3000 Raymond	783-3701
Tenant/Buyer:	refinance of bank loan.		
Return to:	Peter C Thompson	RR1 Box 3000 Raymond	783-3701

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Peter C Thompson Address RR1 Box 3000 Raymond

==========

HEALTH DEPARTMENT USE ONLY

Date Received 9-18-92 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 9-21-92

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☒	Date 9-21-92 by JM
Bacteria	☒	☐	Provisional:	☐	Date _____ by ____
Nitrate	☒ 0.5	☐	Disapproved:	☐	Date _____ by ____

Comments: Recommend checking to see if septic tank needs pumping

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Ron Mayfield RS DATE 10-6-92

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832