LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 943-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — April 21, 1977

TYPE OF PERMIT — THIS PERMIT EXPIRES

H. C. Heiser — 6131 Galdstone, Lincoln, NE 68507

ISSUED TO — ADDRESS

T9N; R8E; Section 33; Lot 15 I.T.

LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

Health

ISSUING OFFICER

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 943-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 10/21/76

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

Lot 15, IT

1. Legal description of property: Twp. 9N ; Range 8E; Section 33
Block 0 ; Lot ~~0~~ 15 I.T.; Addition _____
Street Address 14300 Saltillo Road

2. Property Use: Residential _____ ☒ ; Commercial _____ ☐
No. of Bedrooms 3 . Describe: _____

Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: Miles ft.

H Olsen
Signature of Applicant (Owner or Lessee)

6131 Gladstone
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 10/21/76. Date Frwd. 10/21/76. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Todd

2. Supt. Bldg. Insp.: Date Rec'd. _____. Date Frwd. _____. ACTION: Approved ☐ Disapproved ☐ Signature: _____

3. City or County Engineer: Date Rec'd. 10/21/76. Date Frwd. 10/21/76. ACTION: Approved ☒ Disapproved ☐ Signature: Henry Krafft
Rec'd 10/21/76

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [ ]
County Resolution No. 2832 [X]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 943-C

DATE: 10/21/76

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 9N ; Range 8E ; Section 33 ; Block 1+5 ; Lot ; Addition .
Street Address 14300 Saltillo Road .

2. Property Use: Residential [X] Commercial [ ]
No. of Bedrooms 3
Describe:
Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

H P Hesser
Signature of Applicant (owner or lessee)

6131 Gladstone
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00

2. Site Visits:
Date: 11-23-76 by: sm
Date: by:
Date: by:

3. Date: Approved [X]; Disapproved [ ] 12/4/76
by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 11-23-76 by: Ron Maynard

Saltillo Rd.

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. 943-C

PROPERTY WHERE SOIL TESTED:
Location: Township 9 ; Range 8 East
Section & ¼ Sect. East ½ Lot 5
Property Dimensions: 521.28 ft. x 982.25 ft. west -903.76 East
Area: _____ acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☒; Clay Loam ☐; Sandy Clay ☐

Owner: Mr & Mrs William Tuning
Address Present: 3831 'B' - New: 14300 Saltillo Road

Dates of Tests: 10-7-76 to 10-8-76. Weather: Precip. 0 Temp. 60°F

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	32"	10/7	5 30 PM	10/8	5 30 PM	10/8	5 30 PM	6"	7 PM	1 3/4	30 M	3/4	
2										1 3/4		3/4	
3										1 1/2		3/4	
5										1		1/2	
4										1		1	

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

Robert D Johnson
Signature of Person Conducting Test

Address 2618 N 3rd
Phone: 432-3545

(Do not write below this line)


REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 32 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: October 21, 1976

Gerrald C. Hood
Signature of Reviewing Official

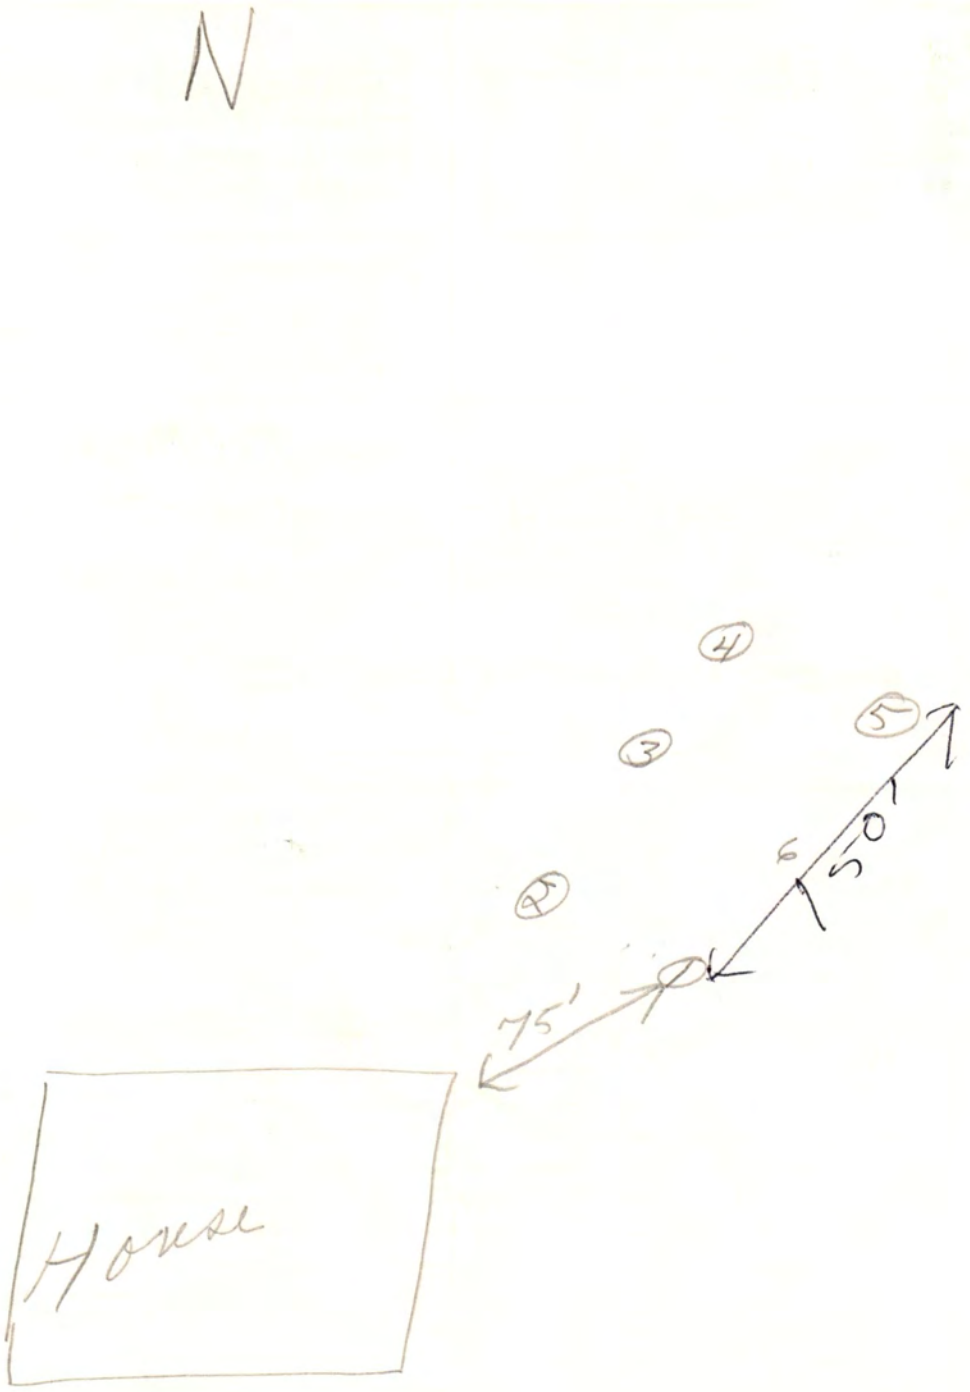
N
4
3
5
2
150'
75'
House

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 943-C

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material _____; Diameter ____ in.
2. Distance above basement floor ____in.; or below basement floor ____in.
3. Distance between dwelling and septic tank ____ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material _____; No. of compartments _____.
2. Capacity 1000 gals.; Liquid depth ____in.
3. Factory Built: Yes ☐ (Company _____)
No ☐
4. Manholes: Over Inlet; diam. ____in.
Over Outlet; diam. ___in.
Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade ____in.
8. Distances To:
Well or Suction Line ____ft.;
Stream ____ft.; Pressure Line ____ft.;
Property Line ____ft.


C. DISTRIBUTION BOX
1. Material _____; No. available outlets _____.
2. Factory Built: Yes ☐, (Company _____)
No ☐
3. Dimension: Length ____in.; Width ___in.
Depth ____in.
4. Distance from Septic Tank ____ft.
5. Serial Distribution: Yes ☐, No ☐
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF ROUND
2. Lateral Lines: Depth below grade ___in.
Number 2; Length of each line ___ft
Total length of Laterals 194 ft.;
Slope ____in/100 ft. Diameter of pipe ____ in.; Shape _____
Material: concrete ☐; fiber asbestos ☐; clay ☐; other _____
Distance between lateral lines ____ft.
3. Trench Dimensions: Depth ___in.;
Width 48 in.
4. Filter Material: _____.
Depth of material from trench bottom _____in.
5. Distances To:
Well or Suction Line ____ft.;
Stream _____ft.; Pressure Line ____ft.
Property Line ____ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES

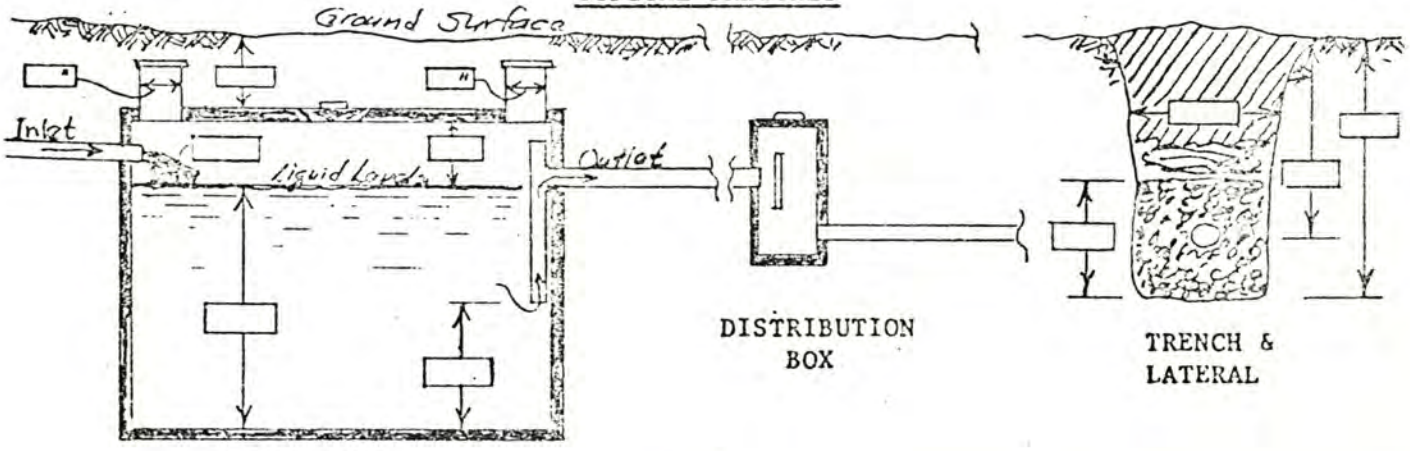

_____
Signature of Applicant

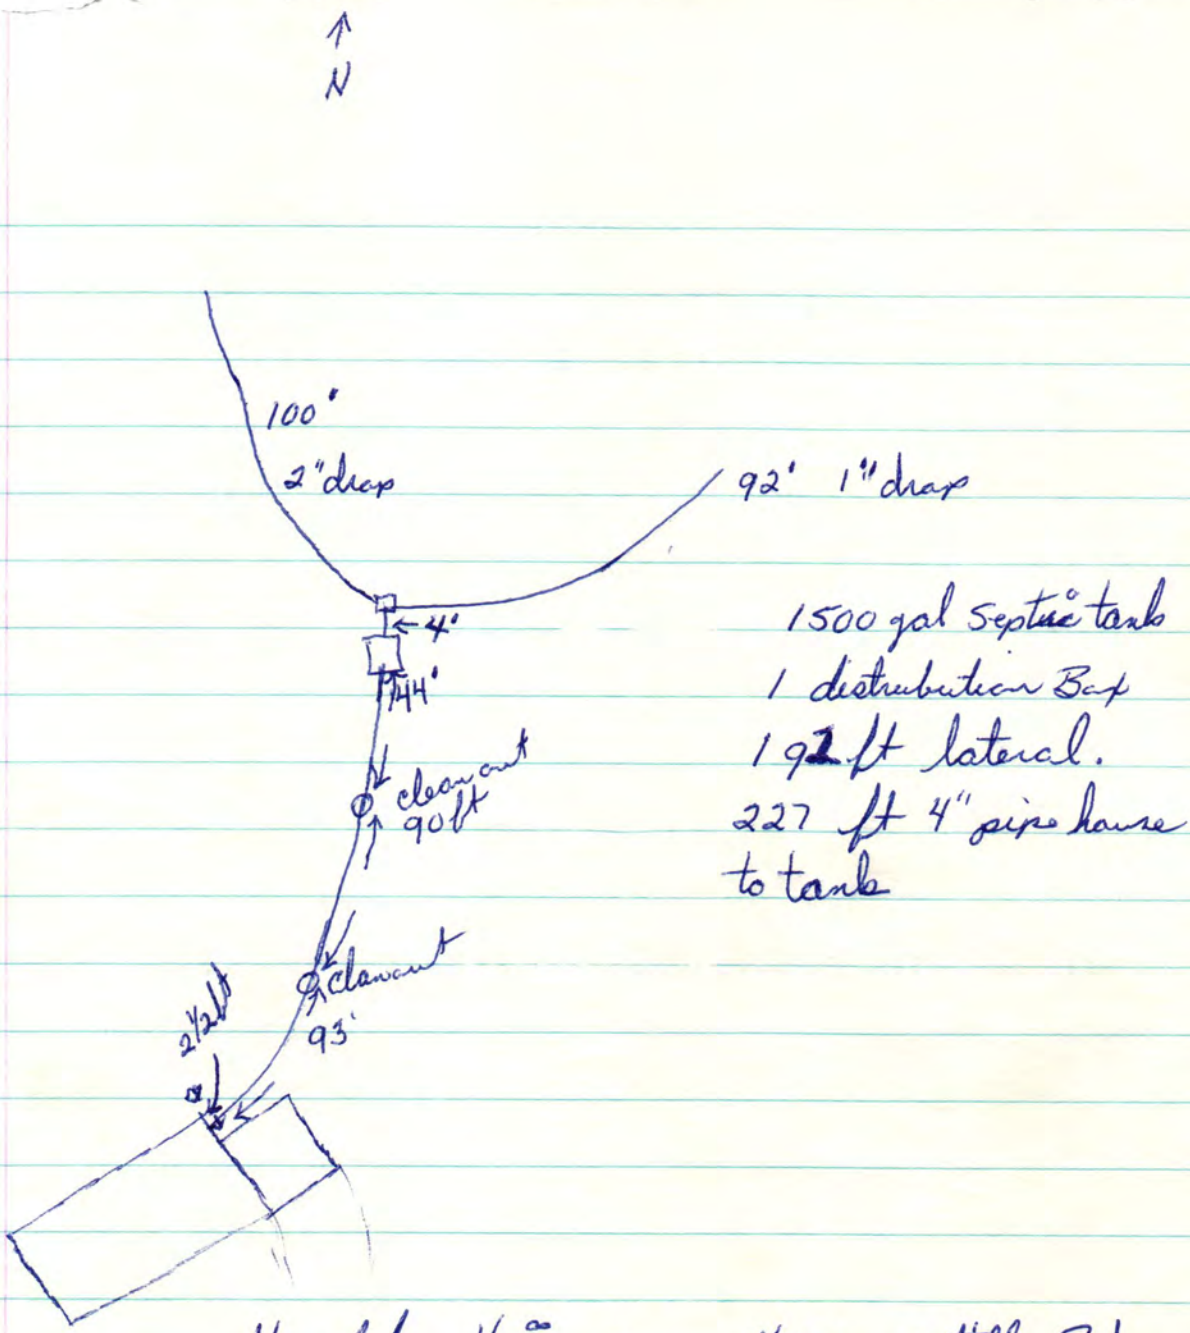

1500 gal Septic tank
1 distribution Box
192 ft lateral.
227 ft 4" pipe house
to tank

Harold Heizer 14,300 Saratillo Rd.
11-23-76
Bouma Trenching
Terry Bouma

004

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 14500 Saltillo Rd., Bennet, NE

Twp 9 North Range 8 east of 6th p.m. Section 33 1/4 SE 1/4 ___ Block ___ Lot 15 Addition (irregular tracts)

Directions to Property _____

Location of Well Rural System Tap Location: Inside ☒ Outside ☐

Location of Sewage System _____ Year Installed 1976

	NAME	ADDRESS	PHONE
Present Owner:	William Tuning	14500 Saltillo Rd. Bennet, Ne	782-8974
Tenant/Buyer:	Kent Reinhart	3418 Randolph St Lincoln Ne	477-3377
Return to:	Bert Alfrey	903 Roanoke Ct. #46 Lincoln, Ne 68510	489-0887

Signature of Applicant Bert Alfrey Address 903 Roanoke Ct Lincoln, Ne. Date 11/21/96

HEALTH DEPARTMENT USE ONLY

RECEIVED

Date 11/21/96
Initials LS
Amount $150.00
Check No. 4414

DATA ENTRY

Date ___/___/___
Case No. _____
Initials _____

PRELIMINARY STATUS--By Jerrold C. Hood DATE: 11/22/96

RURAL WATER DISTRICT

WATER SYSTEM:	Approved	Disapproved
Construction	☐	☐
Bacteria	☐ ____/ml	☐ ____/ml
Nitrate	☐ ____ppm	☐ ____ppm

SEWAGE SYSTEM	
Approved	☒
Provisional	☐
Disapproved	☐

Additional Site Visits

Date ___/___/___ by ___
Date ___/___/___ by ___
Date ___/___/___ by ___

Comments: OWNER STATES SEPTIC TANK HAS NEVER BEEN PUMPED, PROBABLY NEEDS TO BE DONE.

See Attached Letter ☐

FINAL STATUS RURAL WATER DISTRICT

WATER SYSTEM: Approved ☐ **SEWAGE DISPOSAL SYSTEM:** Approved ☒ Provisional Approval ☐

Approved by Jerrold C. Hood R.E.H.S. Date 12/3/96

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 10-95