LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2332-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

NOVEMBER 22, 1986 — THIS PERMIT EXPIRES

CHUCK SCHMITAL, % PAUL VON GILLERN, 18100 NO. 1 STREET, RT #1, DAVEY — ISSUED TO / ADDRESS

T12N; R8E; Sec SE¼ 27 — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE NEW CONSTRUCTION

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60000	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY: MG — DATE: 5 23 86 — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH — ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

475-8515

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2332-C

DATE: 5-19-86

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 12N; Range 6E; Section SE¼ 27;
   Block _____: Lot _____: Addition _____
   Street Address _____

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 5. Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☐

4. Distance to public sewer: over ft.

s/ Paulson Gilbert Chuck Schmitt
Signature of Applicant (Owner or Lessee)

W. Vista Dr
Address or 18100 N 1st

(Do not write below this double line)

1. Health Department: Date Rec'd. 5/22/86. Date Frwd. 5/23/86. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 5/23/86. Date Frwd. 5/23/86. ACTION: Approved ☒ Disapproved ☐ Signature: Gary M Shenwal

3. City or County Engineer: Date Rec'd. 5/23/86. Date Frwd. 5/23/86. ACTION: Approved ☒ Disapproved ☐ Signature: Don R. Thomas

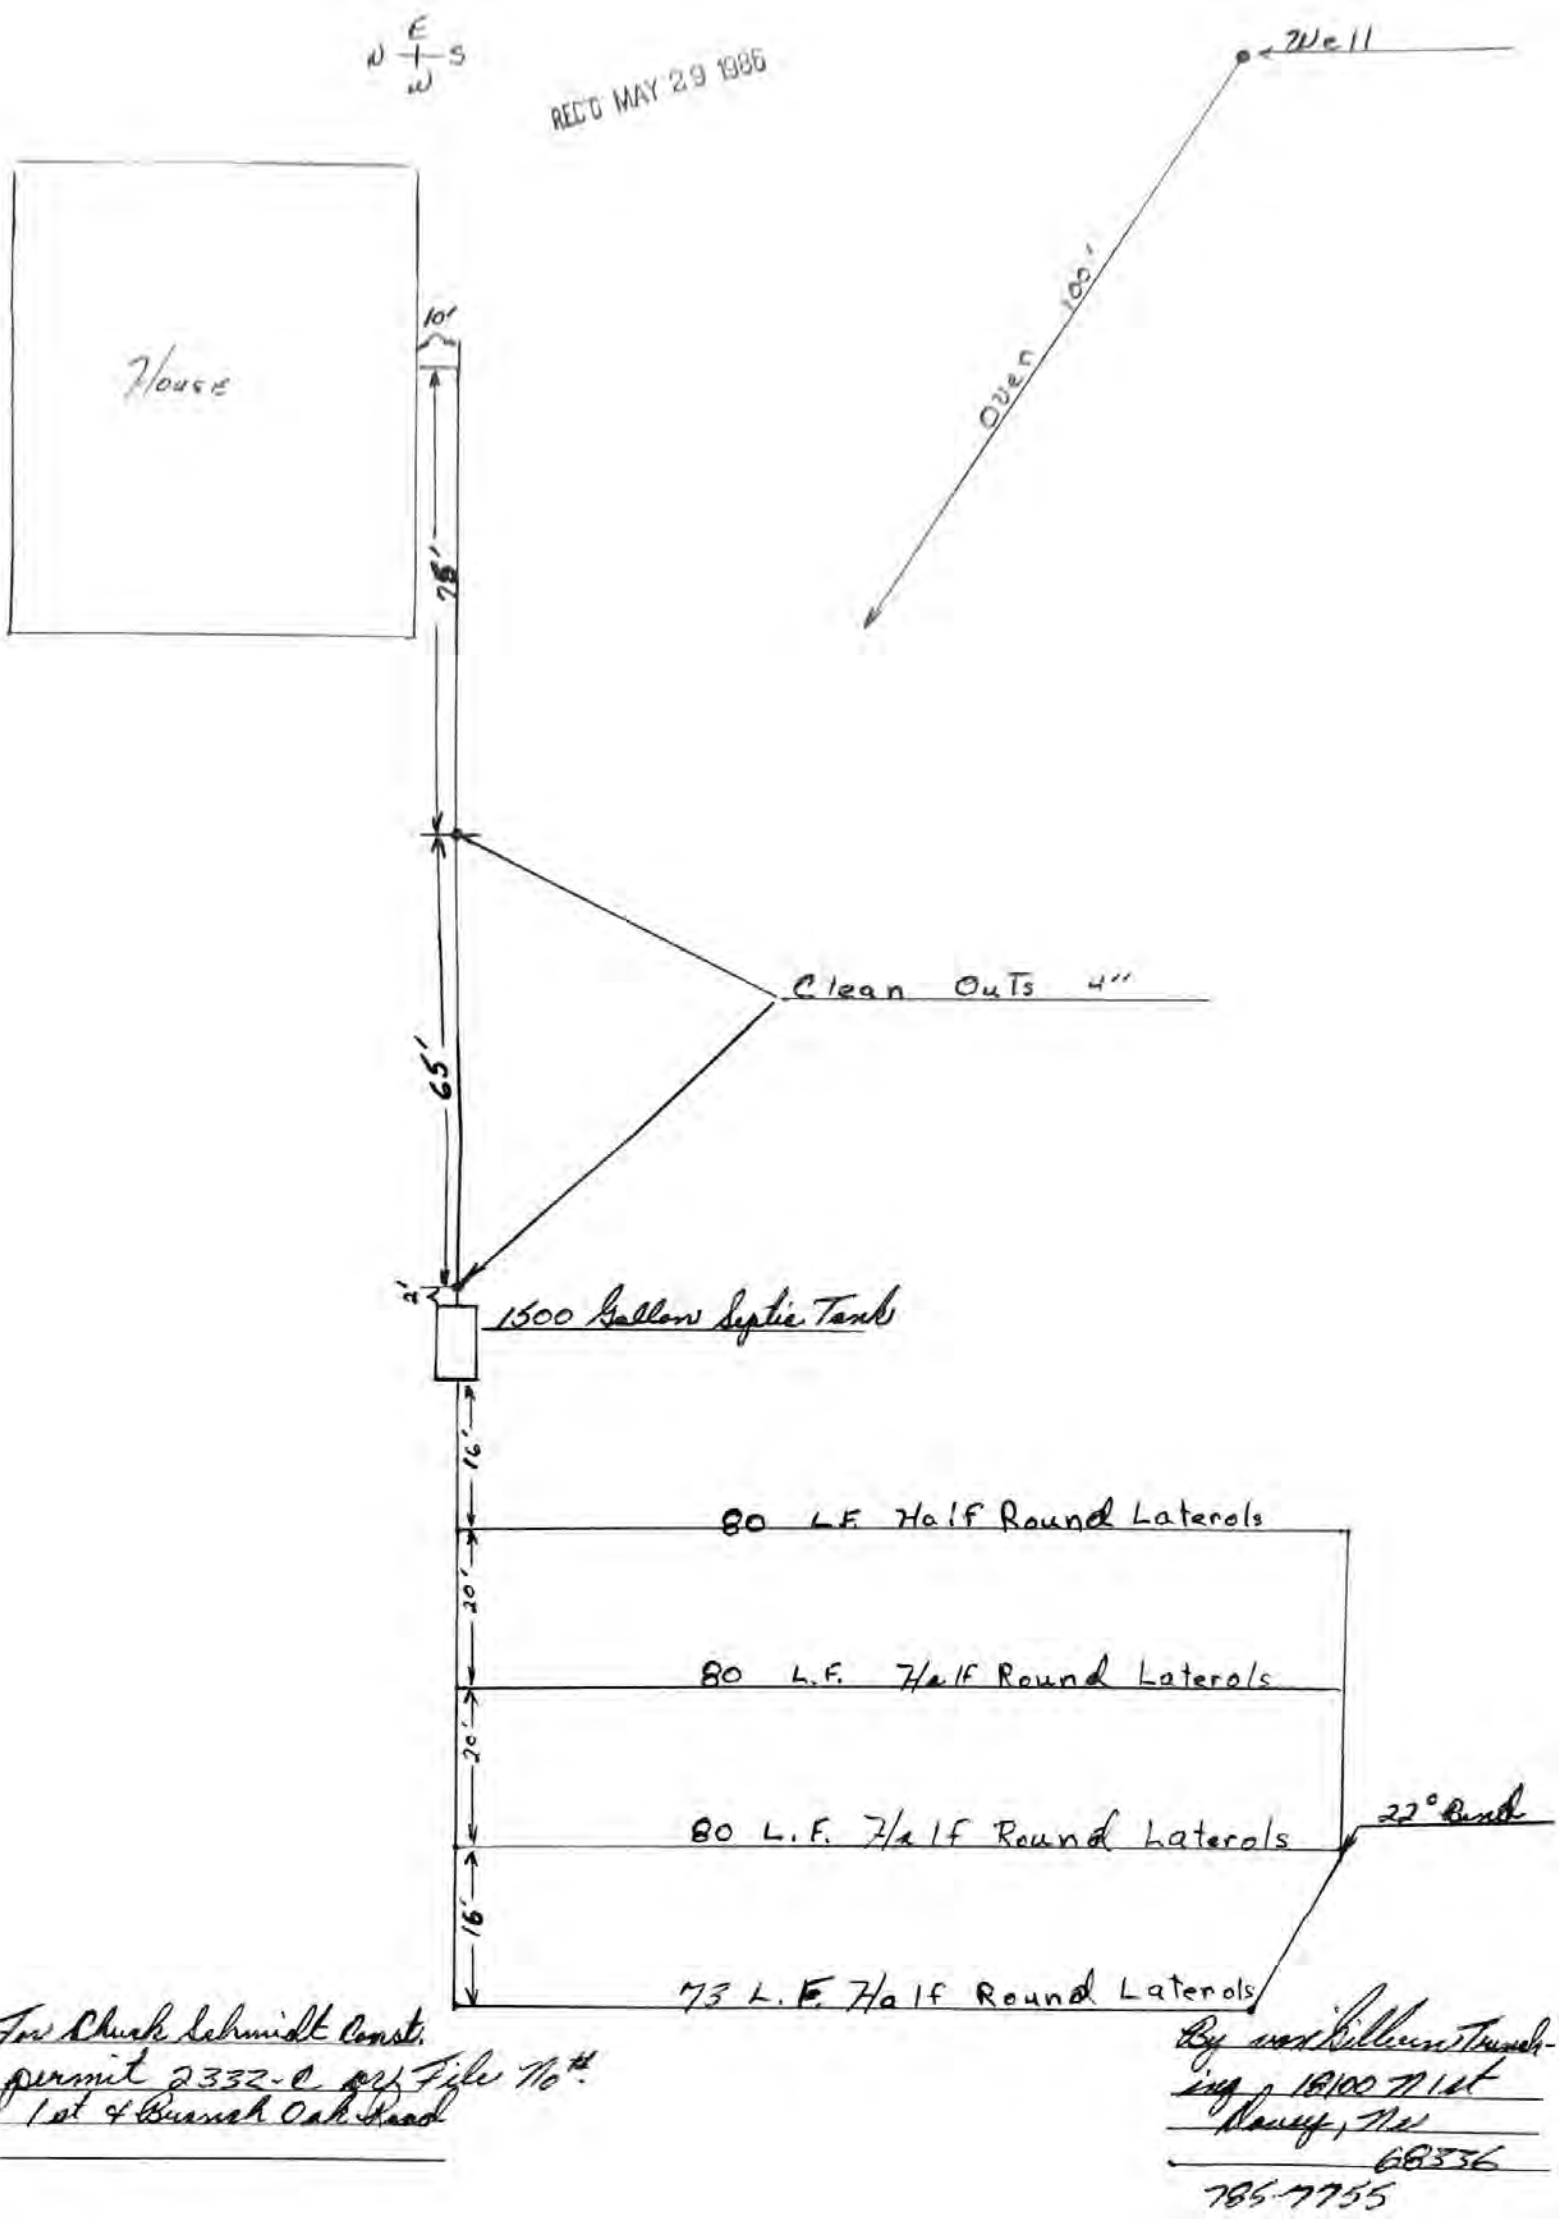
REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 5/22/86 by: J. C. Hood
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 5/30/86 By: Jerrold C. Hood

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

Percolation test form was lost but percolation rate was around 53 minutes/in.


N E S W
RECD MAY 29 1985
Well
Over 100'
House
10'
75'
65'
Clean OuTs 4"
2'
1500 Gallon Septic Tank
16'
80 L.F. Half Round Laterals
20'
80 L.F. Half Round Laterals
20'
80 L.F. Half Round Laterals
22° Bends
16'
73 L.F. Half Round Laterals
For Chuck Lehmidt Const.
permit 2332-C on File No.
Lot 4 Burnt Oak Road
By ron Billerman Trenching
18100 N 16th
Nancy, Ne
68336
785-7755