LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

3140 "N" STREET Lincoln, NE 68510-1514 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 95390044901

Issued 06/26/95
Expires 12/26/95
Revenue Code 18754

Establishment
DAN CRICHTIN
T12N R6E SEC 22
8200 OLD CHENEY

FEES: $50.00

TOTAL $50.00

Permittee
DAN CRICHTIN
8200 OLD CHENEY RD
LINCOLN, NE 68516

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☒

Lincoln-Lancaster County
HEALTH DEPARTMENT
3140 "N" STREET LINCOLN, NE 68510-1514

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 6-15-95

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☐, or REPAIR ☒ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 12N ; Range 6E ; Section 22 ;
Block _____; Lot _____; Addition _____
Street Address 1800 N. 1st St. Ed Ralston

2. Property Use: Residential _____ ☐; Commercial _____ ☐
No. Bedrooms _____ Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: Installed 100 foot of extra lateral

5. Work to be done by: Owner ☐ ; or Contractor ☒ , Larry Schwarck
Contractor's Name

6. Estimated cost of project:

a. Materials	$	>400
b. Labor	$	
c. Other	$	
TOTAL	$	

Larry Schwarck

Dan Crichton for Larry Schwarck
Signature of Applicant (owner or lessee)

8200 old cheney Rd 68516
Address

(Do not write below this line)

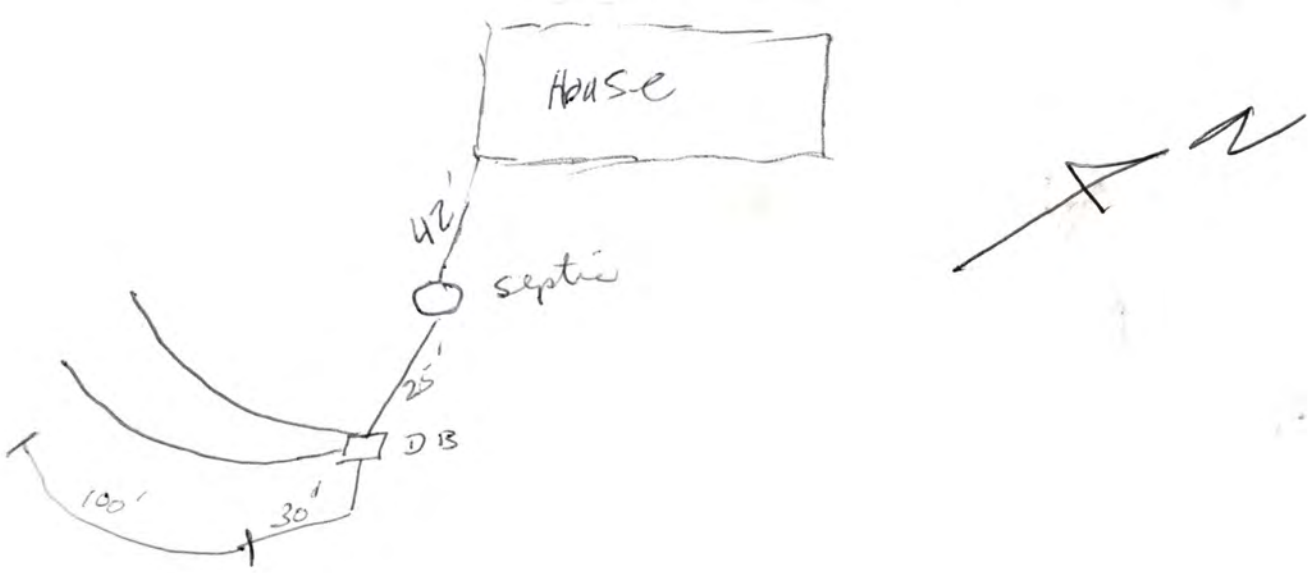
REVIEWING ACTION

1. Date Rec'd: 6-16-95
Filing Fee: $ 50.00

2. Site Visits:
Date: 6-15-95 by: rm
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒ ; Disapproved ☐
by: Ron Magnuson

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 6-29-95 by: Ron Magnuson


House
42'
septic
25'
DB
100'
30'
N

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 1810 + N. 1st. Davey, NE. 68336

Twp 12 N Range 6E Section 22 1/4 SE 1/4 ___ Block ___ Lot 3 Addition ___

Directions to Property North on 14TH Street to Davey Rd - west one mile to 1st -

Location of Well Just west of patio Tap Location: Inside ☐ Outside ☒

Location of Sewage System SE of house Year Installed 1978

	NAME	ADDRESS	PHONE
Present Owner:	Edward Ralston	1810 1 No 1st Davey, Nebr 68336	785-2016 (474-0545)
Tenant/Buyer:	Dan Hoage	3232 No 67TH Lincoln NE 68507	464-3340
Return to:	Louise Kirkbride Woods Bros. Realty	7141 "A" St Lincoln, NE 68510	432-5943

Signature of Applicant Edward J Ralston Address 1810 1 No 1st Davey, NE 68336 Date 5 / 28 / 95

HEALTH DEPARTMENT USE ONLY

Date Received ___/___/___ Received $150.00 Check ☒ Cash ☐ Mary Hoage 3609 5/31/95 avi

PRELIMINARY STATUS--By Ron Marquart **DATE:** 6 / 1 / 95

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☒ 20 /ml (Corrected)
Nitrate	☒ <0.1 ppm	☐ ___ ppm

SEWAGE SYSTEM	
Approved	☒
Provisional	☐
Disapproved	☒ (Corrected)

Additional Site Visits

Date 6 / 15 / 95 by mm cl

Date 6 / 16 / 95 by mm

Date ___/___/___ by ___

Comments: Deficiencies of water and sewage systems have been corrected.

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☒

Provisional Approval: ☐

Approved by 6-16 Ron Marquart, R.S. Ron Marquart Date 6 / 20 / 95

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St. Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 7-28-89

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $75.00

Legal Description of Property: TWP. 12N; RANGE 6E; SECTION 22; BLOCK ___

LOT 31; ADDITION _____; Street Address 18101 N 1 Davey RD

Directions to Property N 14 to Davey Road - left to 1st ST

Location of Well _____ Tap Location: Inside ☐ Outside ☒

Location of Sewage System _____ Year Installed 79

	NAME	ADDRESS	PHONE
Present Owner:	Les DeBoer	18101 N 1 Davey	785-7975
Tenant/Buyer:	Ed + Rose RALSTON	4411 N 19	475-6725
Return to:	Woods Bros Attn: Shirley Van Ostrand	7141 A	483-4741 Tom Bowers listing agent

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Rose Ralston Address 4411 N 19 Lincoln

==========

HEALTH DEPARTMENT USE ONLY

Date Received JULY 28, 1989 Received $75.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 7/31/89

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:	SITE VISIT:
Construction	☐	☒	Approved: ☒	Date 7/31/89 by J.C.H.
Bacteria	☒	☐	Provisional: ☐	Date 8/21/89 by J.C.H.
Nitrate	☒ 10.1	☐	Disapproved: ☐	Date _____ by ___

Comments: ELECTRICAL PLATE MISSING ON WELL HEAD. DEPRESSION AROUND WELL. SEPTIC HAS NOT BEEN PUMPED IN AT LEAST SIX YEARS SO SHOULD BE CHECKED TO SEE IF IT IS NEEDED. SYSTEM IS NOW ELEVEN YEARS OLD. Corrected 8/21/89

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Gerald E. Hood R.S. DATE AUGUST 22, 1989

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska
INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

FG.4120