FILE NO. 347

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

February 13, 1974 — THIS LICENSE OR PERMIT EXPIRES

Gary Ditweiler — LICENSEE OR PERMITTEE

3649 St. Mary's Ave. — ADDRESS

T10N; R5E; Section 10 — LEGAL DESCRIPTION

NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-1535 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 347

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 5E; Section 10;
Block ____; Lot ____; Addition ____;
Street Address S. 196.7' of N 1046.6' of E 1139.8' of SE¼ PAWNEE LAKE

2. Property Use: Residential ____ [X]; Commercial ____ [ ]
No. of Bedrooms 3. Describe: ____
Other Use ____ [ ]
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Distance to public sewer: ____ ft.

Gary Ditwiler
Signature of Applicant (owner or lessee)

PAWNEE LAKE
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 8/13/73. ACTION: Approved [X] Disapproved [ ]
Date Frwd. 8/13/73. Signature: Jerrald C. Hood

2. Supt. Bldg. Insp.: Date Rec'd. 8/13/73. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 8/13/73. Signature: Charles Neal

3. City Engineer: Date Rec'd. ____. ACTION: Approved ___ [X] Disapproved [ ]
Date Frwd. 8-13-73. Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved [ ] Disapproved [ ]

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 347

DATE: August 13, 1973

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 5E; Section 10;
Block _____; Lot _____; Addition _____;
Street Address S 196.78 of N 1046.6 of E 1139.8 of SE 1/4 Pawnee Lake

2. Property Use: Residential _____ [X]; Commercial _____ [ ]
No. of Bed Rooms 3 Describe: _____

Other Use _____ [ ]
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Gary Dittweiler
Signature of Applicant (owner or lessee)

3649 St. Mary's Avenue
Address Lincoln, Nebraska

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: _____ by: _____
Date: _____ by: _____
Date: _____ by: _____

4. Date: Approved [X]; Disapproved [ ]: 8/13/73
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 1/15/74 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. 347

PROPERTY WHERE SOIL TESTED:
Location: Township 10N R5
Section & ¼ Sect. 10
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Gary DiTweiler
Address _____

Dates of Tests: Aug 11 73 to Aug 13 73. Weather: Precip. None Temp. 80 F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
Hole No.	Hole Depth (in.)	Pre-Saturation Period Start Date (Mo. Day)	Pre-Saturation Period Start Time (Hr. Min.)	Pre-Saturation Period End Date (Mo. Day)	Pre-Saturation Period End Time (Hr. Min.)	Percolation Readings Start Date (Mo. Day)	Percolation Readings Start Time (Hr. Min.)	Percolation Readings Start Water Level (in.)	Percolation Readings End Time (Hr. Min.)	Percolation Readings End Water Level (in.)	Results Elapsed Time (Min.)	Results Water Level Drop (in.)	Results Percolation Rates (Min./inch)
1	36	11	8 20	13	9 00	8 13	8:00	8	9:00		60	1	
2											60	1	
3											60	2	
4											60	2	
5											60	1	
6											60	1	

Roy Bailey
Signature of Person Conducting Test

Address 4131 CLIFFORD D
Phone: 489-8208

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

DATE: August 13, 1973

Approved Percolation Rate(s)
A. 46 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood R.S.
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 347

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material PLASTIC; Diameter 4 in.
2. Distance above basement floor ___ in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 177 ft.
4. Number of clean-outs 2.
5. Distances To:
Well or Suction Line 100+ ft.;
Stream — ft.; Pressure Line — ft.;
Property Line — ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Fiber; No. of compartments 1.
2. Capacity 1000 gals.; Liquid depth 50 in.
3. Factory Built: Yes ☒ (Company CORRIGATED FIBERGLASS) No ☐
4. Manholes: Over Inlet; diam. 16 in.
Over Outlet; diam. ___ in.
Below Grade _____ in.
5. Inlet: Baffle ☒; or Tee ☐
6. Outlet: Baffle ☒; or Tee ☐
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 24 in.
8. Distances To:
Well or Suction Line 200 ft.;
Stream — ft.; Pressure Line — ft.;
Property Line — ft.


C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP) No ☐
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank 4 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: HALF Round
2. Lateral Lines: Depth below grade ___ in.
Number 3; Length of each line 100 ft
Total length of Laterals 226 ft.; +26'4"
Slope 4 in/100 ft. Diameter of pipe 16 in.; Shape O
Material: concrete ☐; fiber asbestos ☐; clay ☐; other ___
Distance between lateral lines 6'8" ft.
3. Trench Dimensions: Depth 36 in.; Width 48 in.
4. Filter Material: Gravel.
Depth of material from trench bottom ___ in.
5. Distances To:
Well or Suction Line 200+ ft.;
Stream — ft.; Pressure Line — ft.
Property Line — ft.
6. Percolation Rate: 46 minutes/inch

TYPICAL SKETCHES

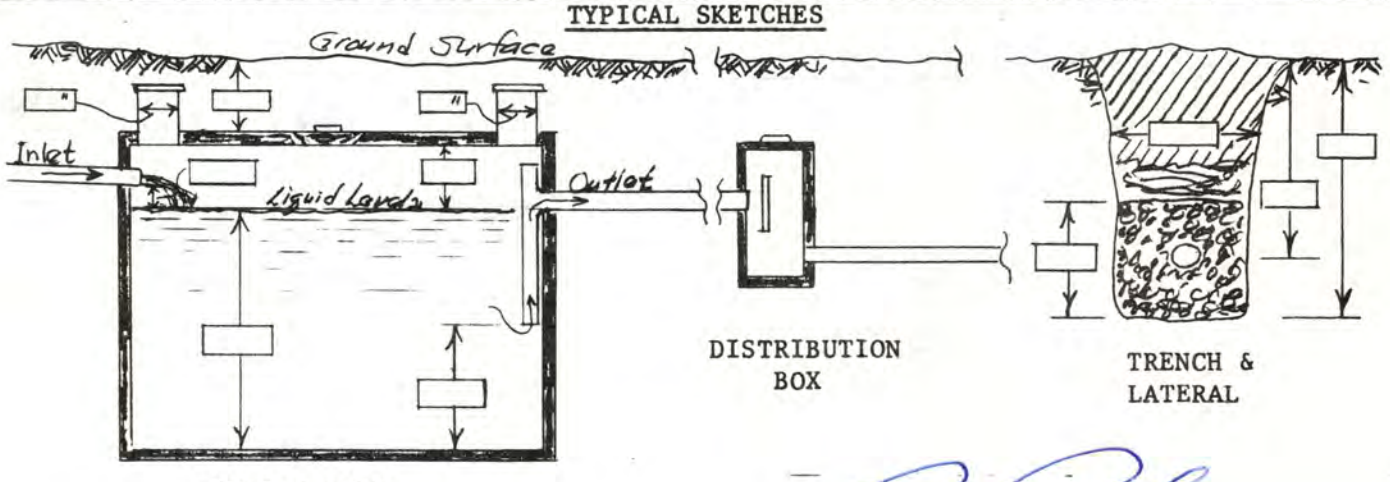

Signature of Applicant

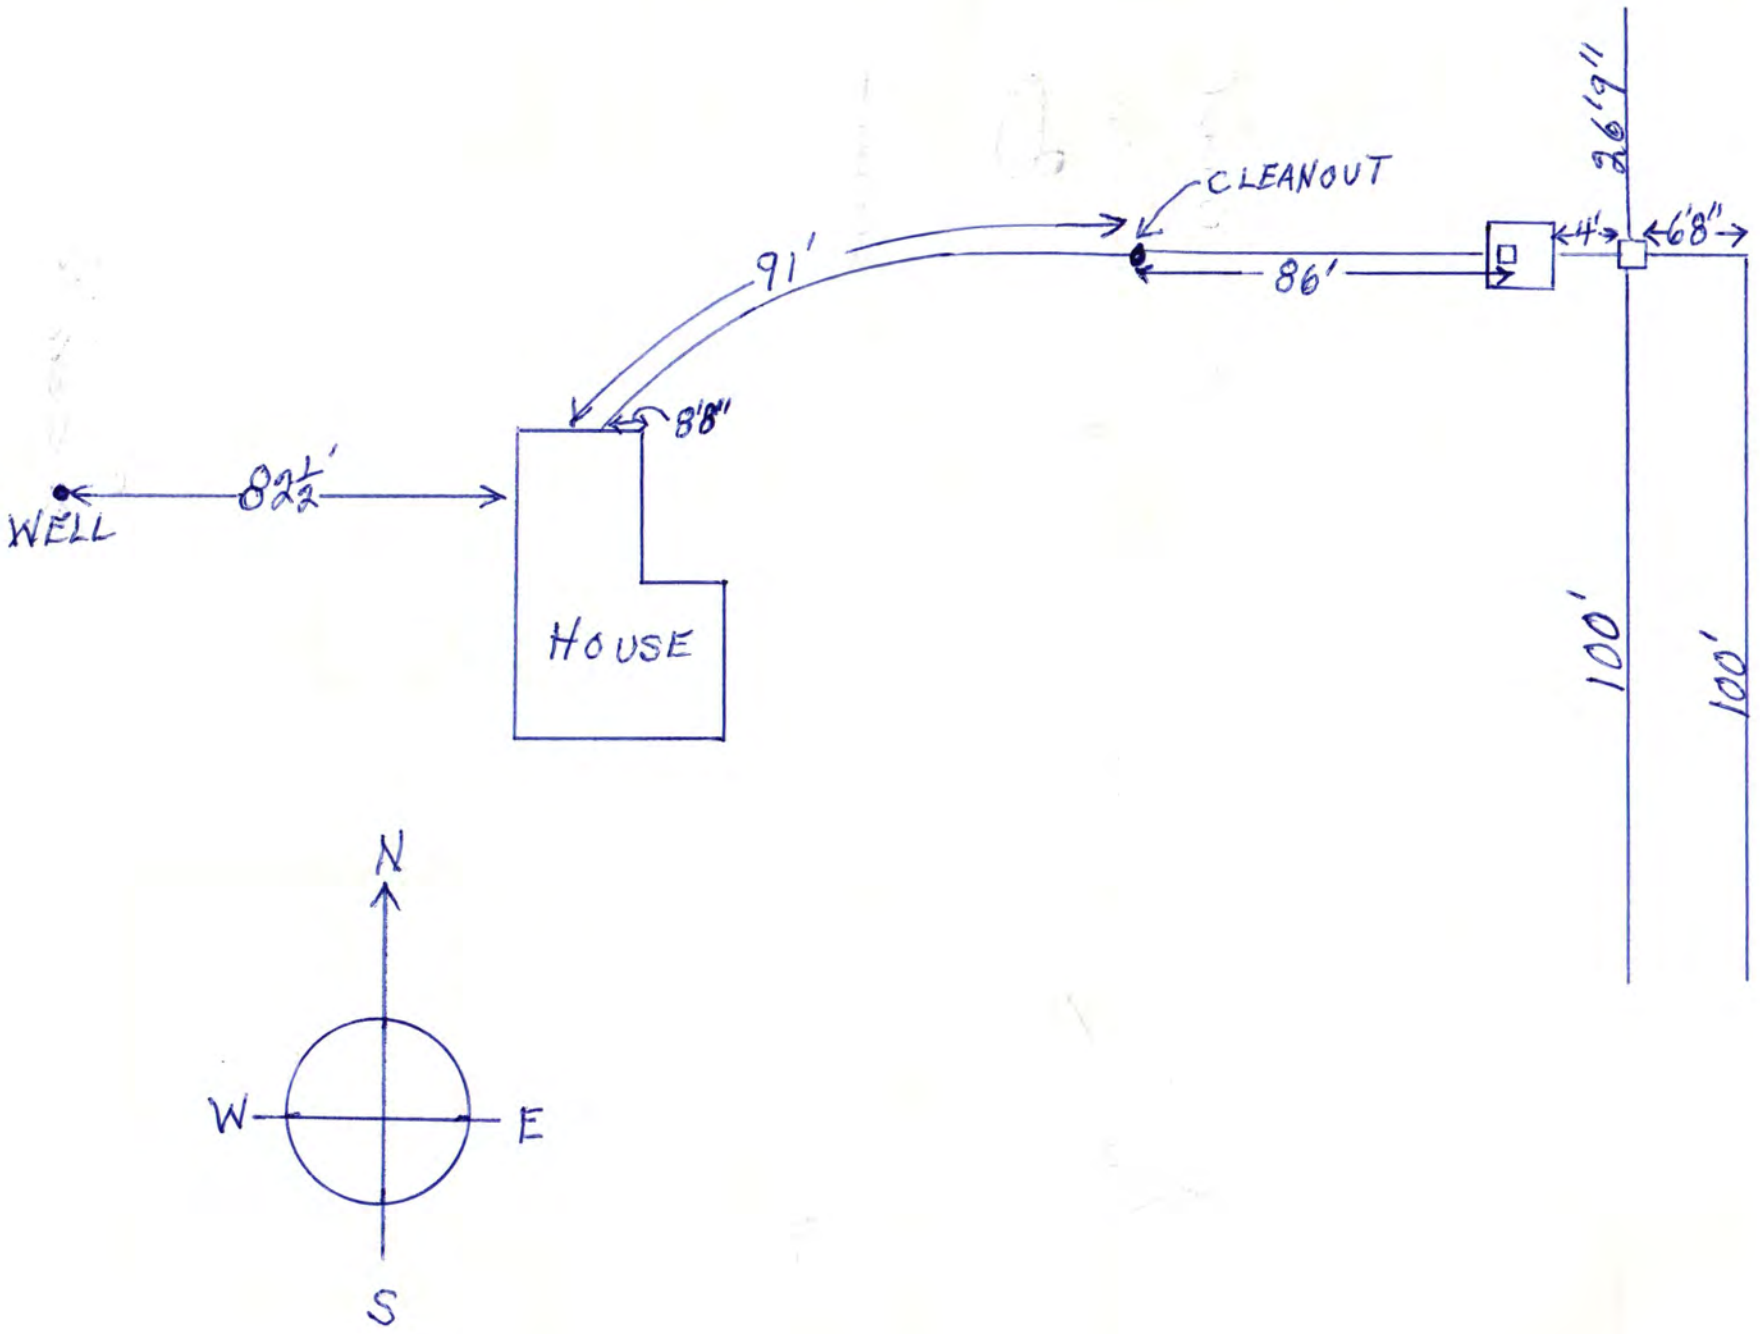
CLEANOUT
91'
86'
26'9"
4'
6'8"
8'8"
82½'
WELL
HOUSE
100'
100'
N
W
E
S