Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOA

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

This form must be completed and returned to req

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☐ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☑ Evaluation of the Individual Water System ☑ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 4140 N.W. 84th

Twp 10 Range 5 Section 11 1/4 SE 1/4 NW Block ___ Lot ___ Addition ___

Directions to Property ___

Location of Well East of House Tap Location: Inside ☐ Outside ☑

Location of Sewage System South of Air Conditioner South Side of House Year Installed 1970

	NAME	ADDRESS	PHONE
Present Owner:	Robert J Tlamka	4140 NW 84th	470 3047 466-8311 Ext 8519
Tenant/Buyer:			
Return to:	Robert Tlamka		

Signature of Applicant Robert J Tlamka Address 4140 NW 84th Date 12/10/93

Cost 150.00 Hand carried to Ruth J. 12-10-93

HEALTH DEPARTMENT USE ONLY

Date Received 12/10/93 Received $150.00 Check ☐ Cash ☑

PRELIMINARY STATUS--By R. Marquart **DATE:** 12/13/93

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☒ TNTC /ml (shock treated)
Nitrate *	☒ <0.1 ppm	☑ 85.4 ppm

SEWAGE SYSTEM

Approved	☐
Provisional	☑
Disapproved	☐

Additional Site Visits

Date 1/3/94 by RM

Date 1/6/94 by RM 20

Date 1/7/94 by RM 0

Comments: If in the future, the barn is used for livestock, the livestock must be confined to the east side of barn with the concrete floor which is 100 feet from the well. Recommend checking to see if septic tank needs pumping. See Attached Letter ☐

Original septic system installation predates County regulations. Plans Not Available. 1-10-94 by RM

FINAL STATUS

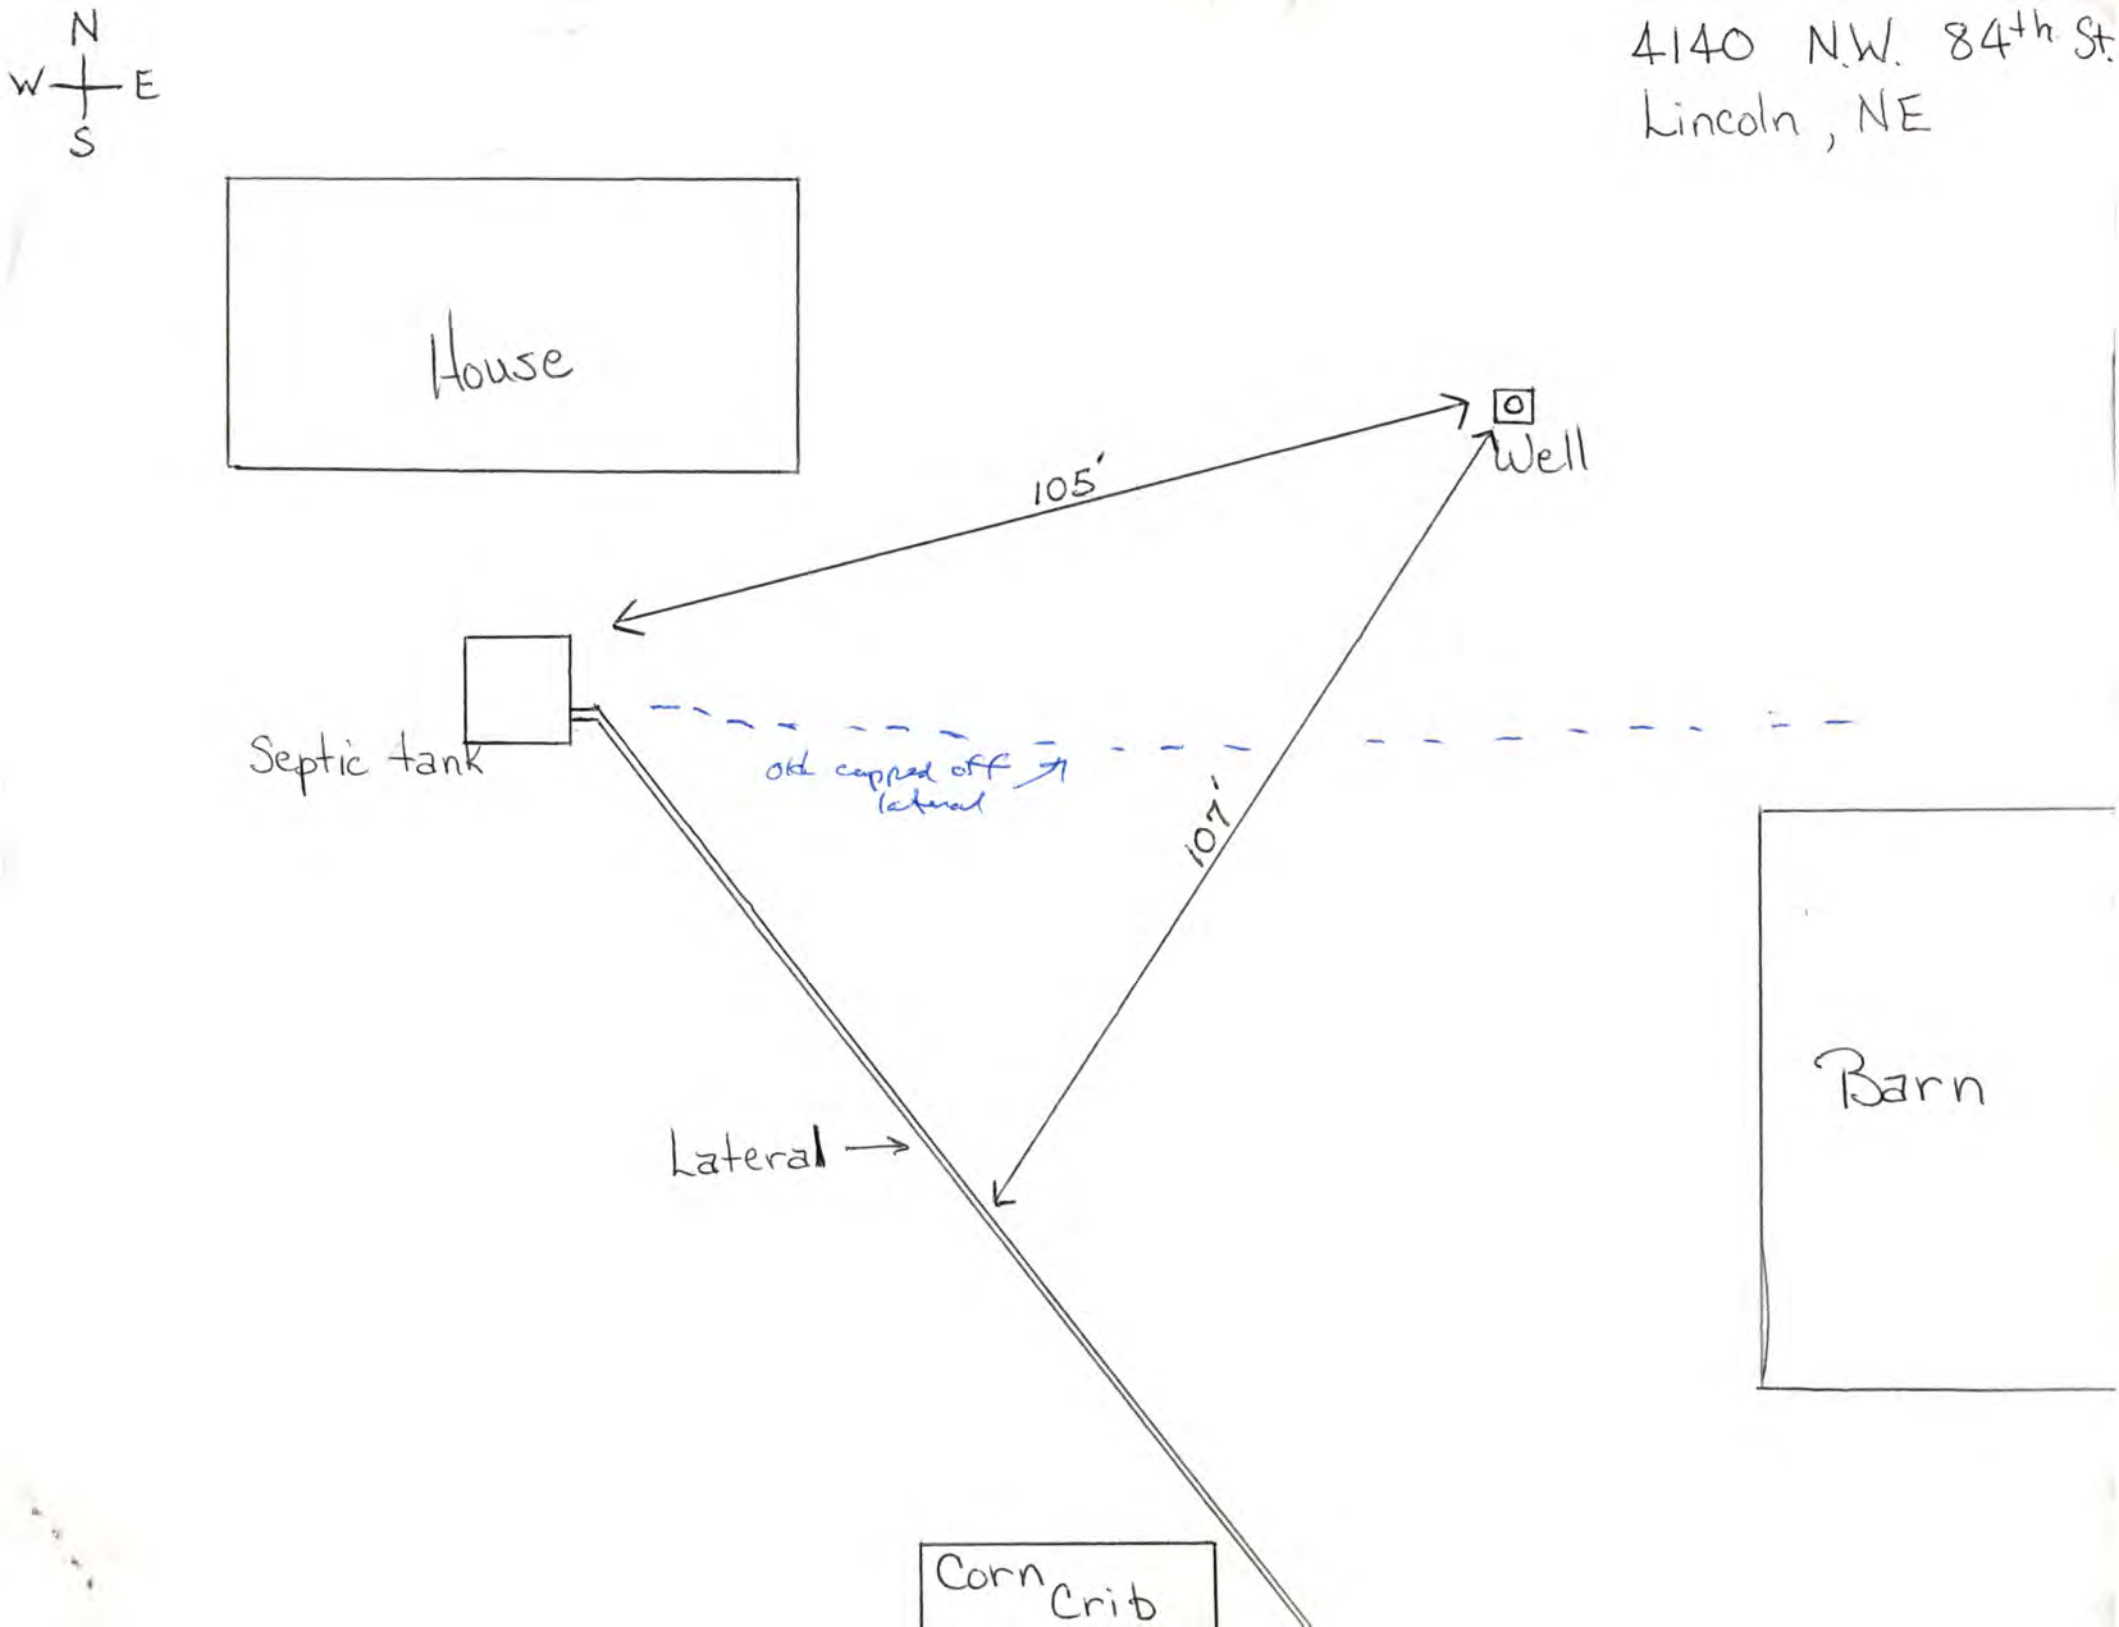
* Approval applies to treated water for nitrate removal, not the raw water.

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☑

Approved by Ron Marquart Date 1/12/94

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

182


N
W
E
S
4140 N.W. 84th St.
Lincoln, NE
House
Well
105'
Septic tank
old capped off lateral
107'
Barn
Lateral
Corn Crib