LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

3140 "N" STREET — ENVIRONMENTAL HEALTH DIVISION — Lincoln, NE 68510-1514 — (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE INSTALLATION

No. 95380135301

Issued 09/26/95
Expires 03/26/96
Revenue Code 18754

Establishment
LESTER JOHNSON
T10N R5E SEC 12
LOT 16
5900 W ADAMS STREET

FEES: $150.00

TOTAL $150.00

Permittee
LESTER JOHNSON
5900 S 28 ST CT
LINCOLN NE 68516

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW "POST IN A PROMINENT PLACE"

FORM 20103-0477

REQUEST FOR SITE CLEARANCE AND PERMIT FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☐

Lincoln-Lancaster County HEALTH DEPARTMENT

3140 "N" STREET LINCOLN, NE 68510-1514

FILING FEE: $_____

FILE NO. _____

DATE: 9-25-95

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range 5E ; Section SE¼ 12 ; Block — : Lot 16 E.T. : Addition _____
   Street Address 5900 west Adams Lincoln

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 2 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: 1 mile ft.

Leslie Johnson
Signature of Applicant (Owner or Lessee)

5900 So. 28 St. ct. Lincoln
Address
423-1165 68516

(Do not write below this double line)

1. Health Department: Date Rec'd. 9/25/95. Date Frwd. 9/26/95. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd. 9-26-95. Date Frwd. 9-26-95. ACTION: Approved ☒ Disapproved ☐ Signature: _____

3. City or County Engineer: Date Rec'd. 9-26-95. Date Frwd. 9-26-95. ACTION: Approved ☒ Disapproved ☐ Signature: Bruce Michaelson

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 10-2-95 by: P.D. Tank
Date: 10-9-95 by: m
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 10-12-95 By: Ron Maynard

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 23 43

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township 10 ; Range 5 ; Section & ¼ Section 12 .
Property Dimensions: _____ ft. x _____ ft. Area: 230 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☑ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 8/30/95 to 8/31/95 . Weather: Precip. dry Temp. 98° .

OWNER: Stan Harn
Address: 5900 West Adams

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	28"	8/30	2:00	8/31	2:00	8/31	3:30	6	4:00	5	30	1	
2	28"	"	"	"	"	"	"	6	"	4½	30	1½	
3	28"	"	"	"	"	"	"	6	"	4¾	30	1¼	
4	28"	"	"	"	"	"	"	6	"	5	30	1	
5	28"	"	"	"	"	"	"	6	"	4¼	30	1¾	
6	28"	"	"	"	"	"	"	6	"	4¼	30	1¾	

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

John Strohmyer
Signature of Person Conducting Test

Address 9811 N.W. 40th LNK Phone 474-9811

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Depends on where in lot.
Date: SEPTEMBER 27, 1995

Approved Percolation Rate (a)
A. 22 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

Lincoln-Lancaster County Health Dept.
3140 "N" Street
Lincoln, NE 68510

D

DATE: 9-25-95

FILE NO: _____

PROPOSED
~~SPECIFICATIONS AS BUILT~~

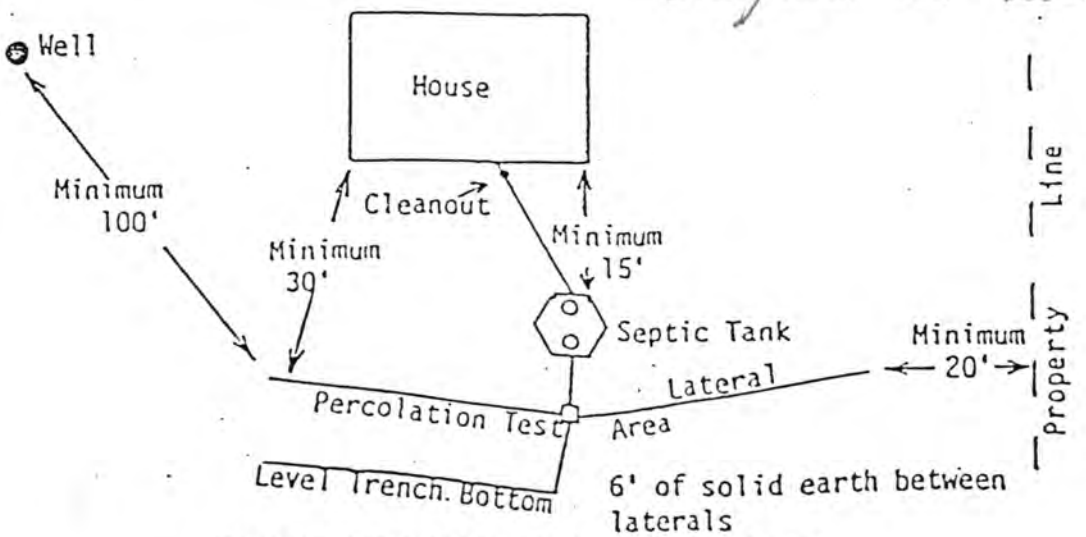
A. BUILDING SEWER:
1. Material Sch 40; Diameter 4 in.
2. Distance above basement floor NA in., or below basement floor NA in.
3. Distance between dwelling and septic tank 20 ft.
4. Number of clean-outs 1.
5. Distances to:
Well or Suction Line 330 ft.; Stream 400 ft.; Pressure Line 4 ft.; Property Line 120 ft.

B. SEPTIC TANK:
1. Material Concrete; No. of compartments _____.
2. Capacity 1000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company Precast)
4. Manholes: Over Inlet; diam. 6" in.
Over Outlet; diam. 6" in.
Riser Above ☐ Below ☒ Grade 8 in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☒ ; or Tee ☐
7. Depth of top of tank below finished grade 8" in.
8. Distances to:
Well or Suction Line 350 ft.; Stream 400 ft.; Pressure Line 30 ft.; Property Line 150 ft.

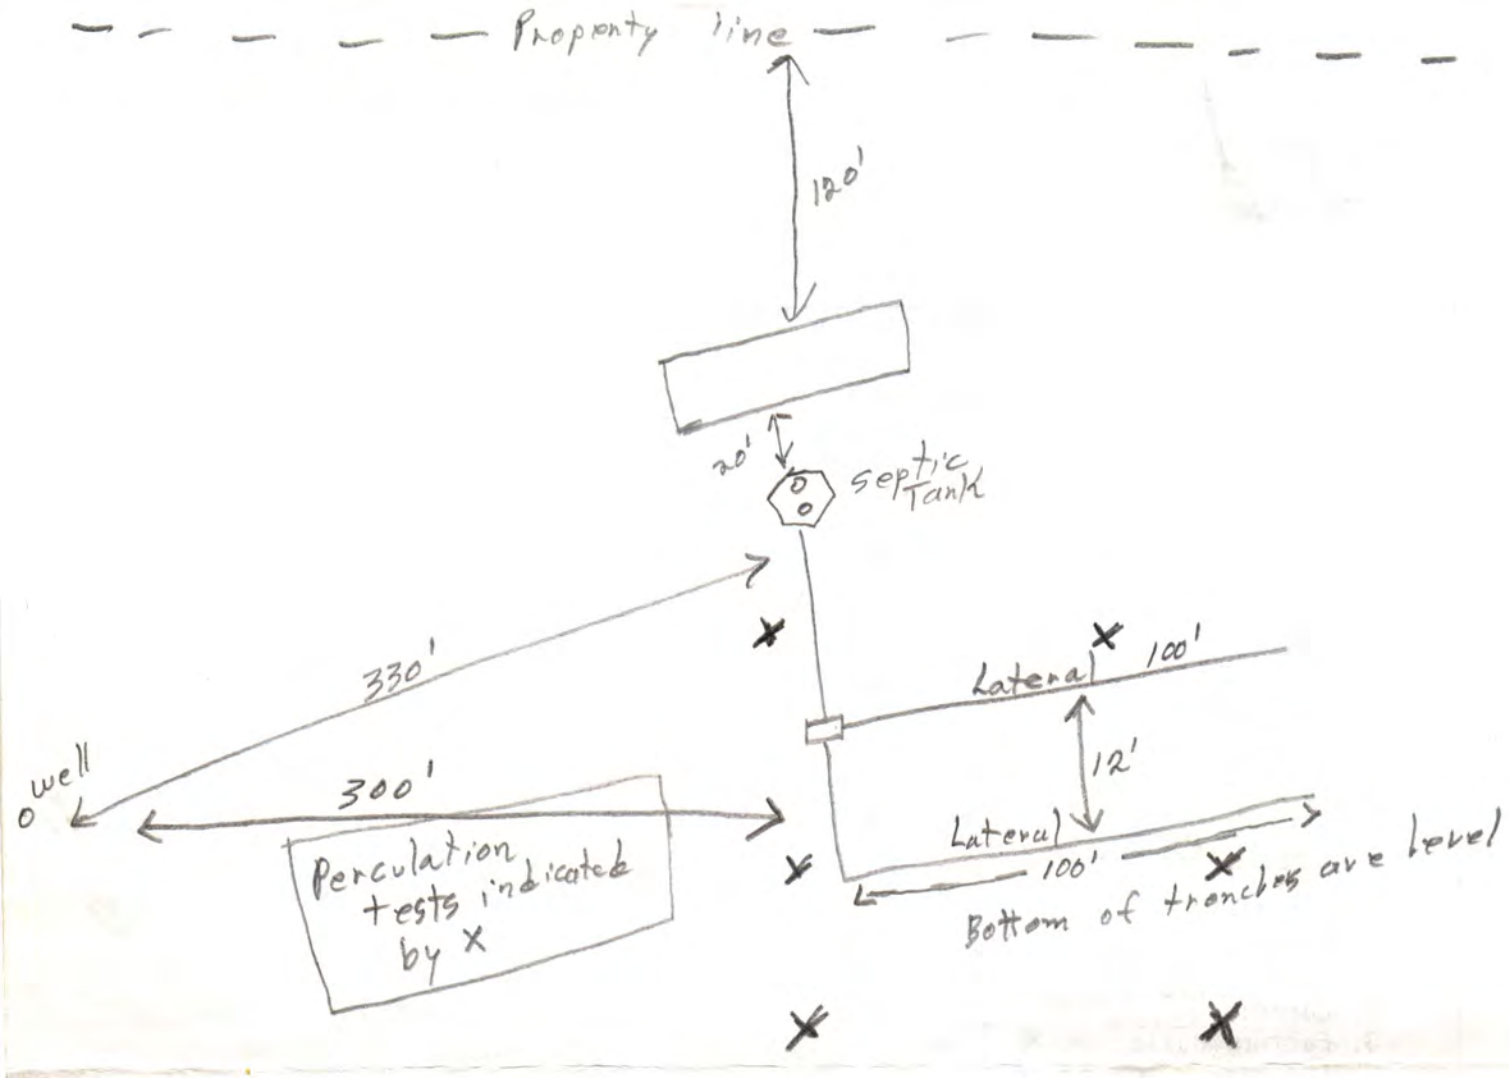
C. DISTRIBUTION BOX:
1. Material PLA Hardcore; Number - available outlets 7.
2. Factory Built: Yes ☒ No ☐
(Company _____)
3. Distance from Septic Tank ? ft.

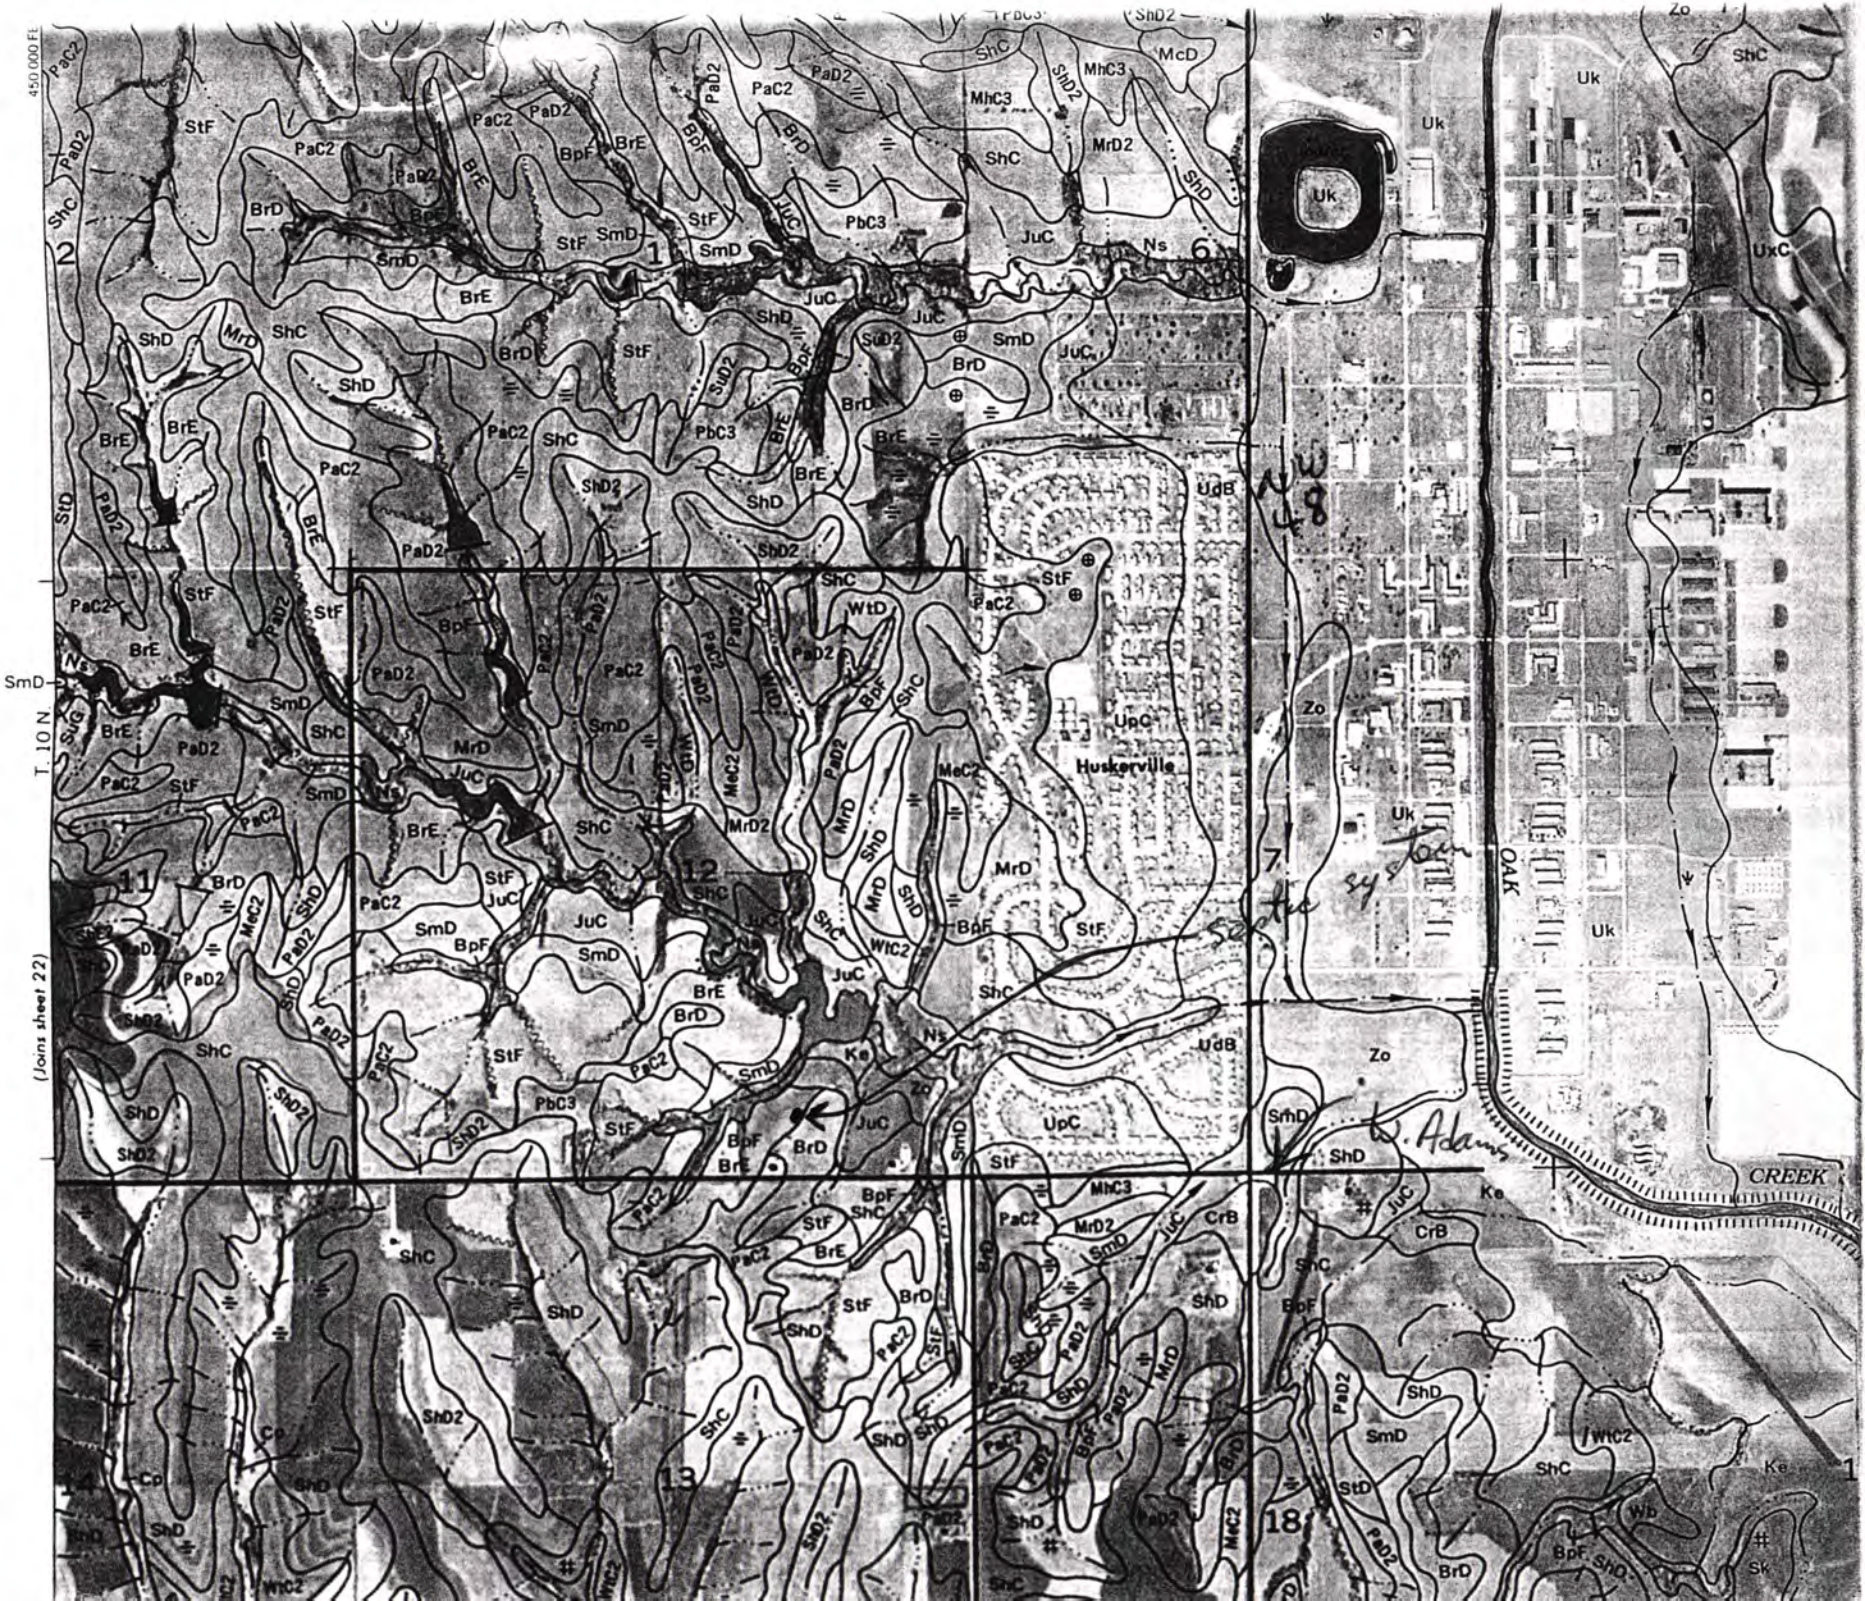
D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round _____ or Perforated Pipe 4" .
Material: fiberglass ☐ ; plastic ☒ ; concrete ☐ ; other _____.
2. Lateral Lines:
Number 2; Length of each line 100', 100', _____, _____, _____ ft.;
Total length of laterals 200 ft.;
Distance between lateral lines 12 ft.
3. Trench dimensions: Width 3 ft.; Slope Less than 6" in/100 ft.; Average Depth 18 in.
4. Filter Material: Road gravel
Depth of Material 12 in.
5. Distances to:
Well or Suction Line 300 ft.; Stream 400 ft.; Pressure Line 75 ft.; Property Line 120 ft.

Diagram on back →



TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN


Property line
120'
20'
septic Tank
330'
well
300'
Percolation tests indicated by X
Lateral
100'
12'
Lateral
100'
Bottom of trenches are level


450,000 FI
T. 10 N
(Joins sheet 22)
Huskerville
CREEK
OAK
Ns
Zo
Uk
UdB
UpC
Ke
JuC
ShC
ShD
ShD2
PaC2
PaD2
BrE
BrD
StF
SmD
MhC3
MrD2
PbC3
MeC2
WtC2
WtD
BpF
CrB
SmD
StD
Wb
Sk
UxC
McD
Cp