1750-E

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO._____

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

August 2, 1981 — THIS PERMIT EXPIRES

VILLAGE MANOR CONSTRUCTION — ISSUED TO

501 W. A Suite 103 LINCOLN NE 68461 — ADDRESS

T10, R5E, Section SW¼-22 — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

HEALTH — ISSUING OFFICER

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO._____

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

A

FILING FEE: $ 60.00

FILE NO. 1750-C

DATE: 1-30-81

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 10N ; Range SE ; Section SW¼-22
   Block _____ : Lot 88II : Addition _____
   Street Address 600 N.W. 98th, RR6, Lincoln 68502

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 3 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒ Lagoon

4. Distance to public sewer: _____ ft.

Village Manor Constructors by Bill Rode
Signature of Applicant (Owner or Lessee)

SUITE 103, 501 WEST "A" ST.
Address

68522

(Do not write below this double line)

1. Health Department: Date Rec'd. 1/30/81 . Date Frwd. 2/2/81 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 2-4-81 . Date Frwd. _____ . ACTION: Approved ☒ Disapproved ☐ Signature: Gary Hammond

3. City or County Engineer : Date Rec'd. 2/2/81 . Date Frwd. _____ . ACTION: Approved ☒ Disapproved ☐ Signature: Allan L. Abbott for gm

REMARKS OR REASONS FOR DISAPPROVAL approved for 20+ acres, 1 main building

Site Visits:
Date: 2-26-81 by: J.M.A.
Date: 3-17-81 by: J.M.A.
Date: 8-26-81 by: J.M.A.

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

INSTALLATION FINAL WRITTEN APPROVAL
Date: 10-20-82 By: John Nelson

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township_____; Range_____; Section & ¼ Section_____.
Property Dimensions: _____ft. x _____ft. Area:_____acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests:_____to_____. Weather: Precip._____Temp._____.

OWNER: _____

Address: _____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

_____
Signature of Person Conducting Test

Address_____ Phone_____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Sharpsburg Silty Clay Loam
Date: January 30, 1981

Approved Percolation Rate (a)
A._____min./inch
B._____min./inch
C._____min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20102-0477
PRELIMINARY PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐


LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

C

Sketch of property showing Percolation Test hole locations, well, residence, direction and property line.

FILE NO. _____

Indicate on sketch if residence and well are exisiting or proposed.

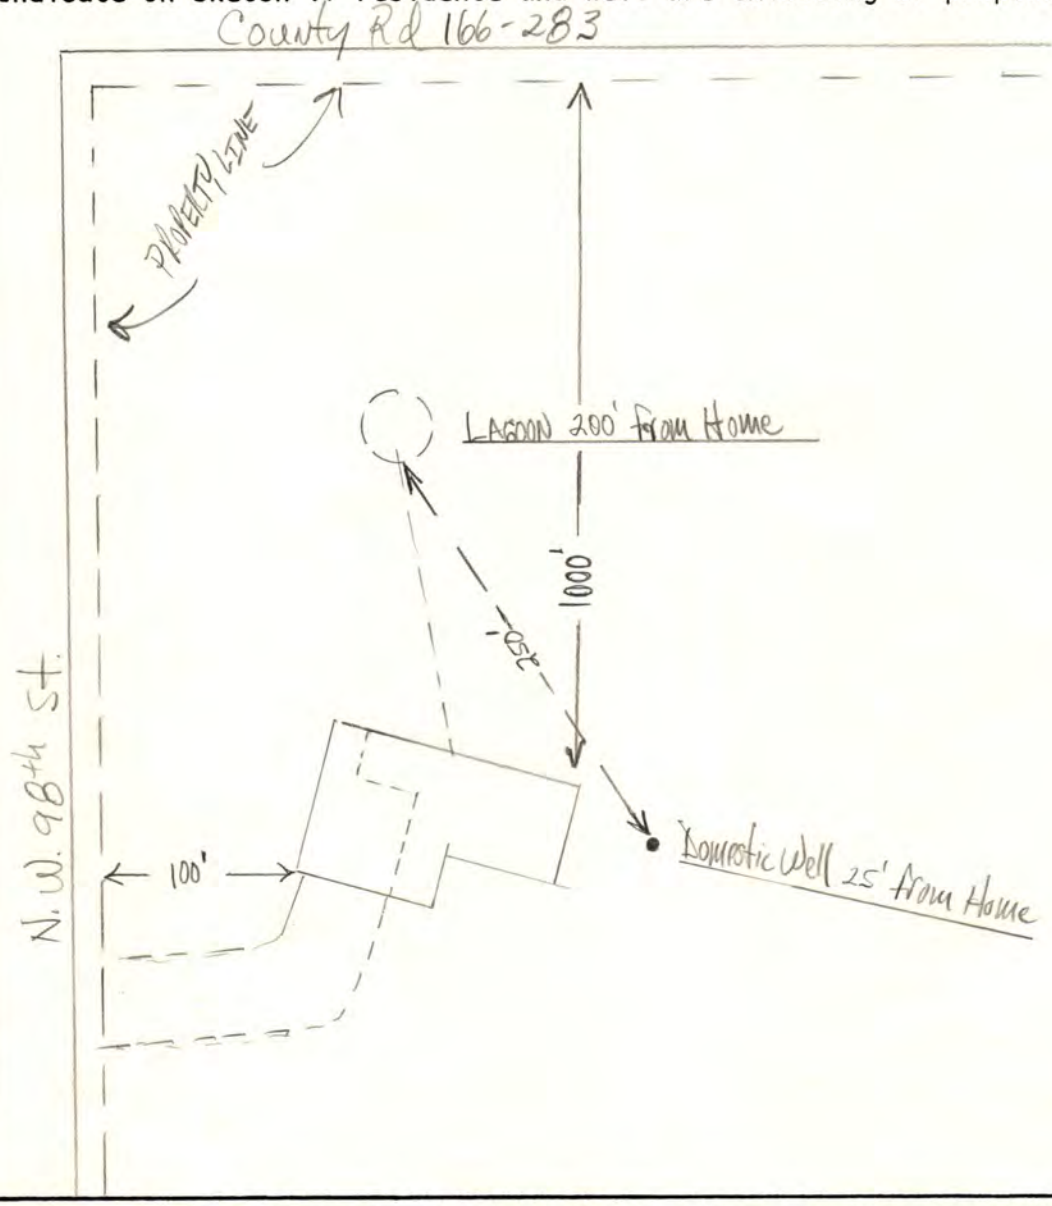

REVIEWING ACTION

Remarks: LAGOON TO BE LINED


Date: JANUARY 30, 1981

Minimum Design Requirement
1. Capacity of Septic Tank _____ gals.
2. Total Length of Laterals _____ ft.
3. With a Trench Width of _____ in.
4. Total Area of Lateral needed _____ sq.ft.

_____
Signature of Reviewing Official

AS BUILT DRAWING OF SYSTEM

DATE Sept 26 1981 INSTALLER Bowers Bldg Co.
Wm Bowers

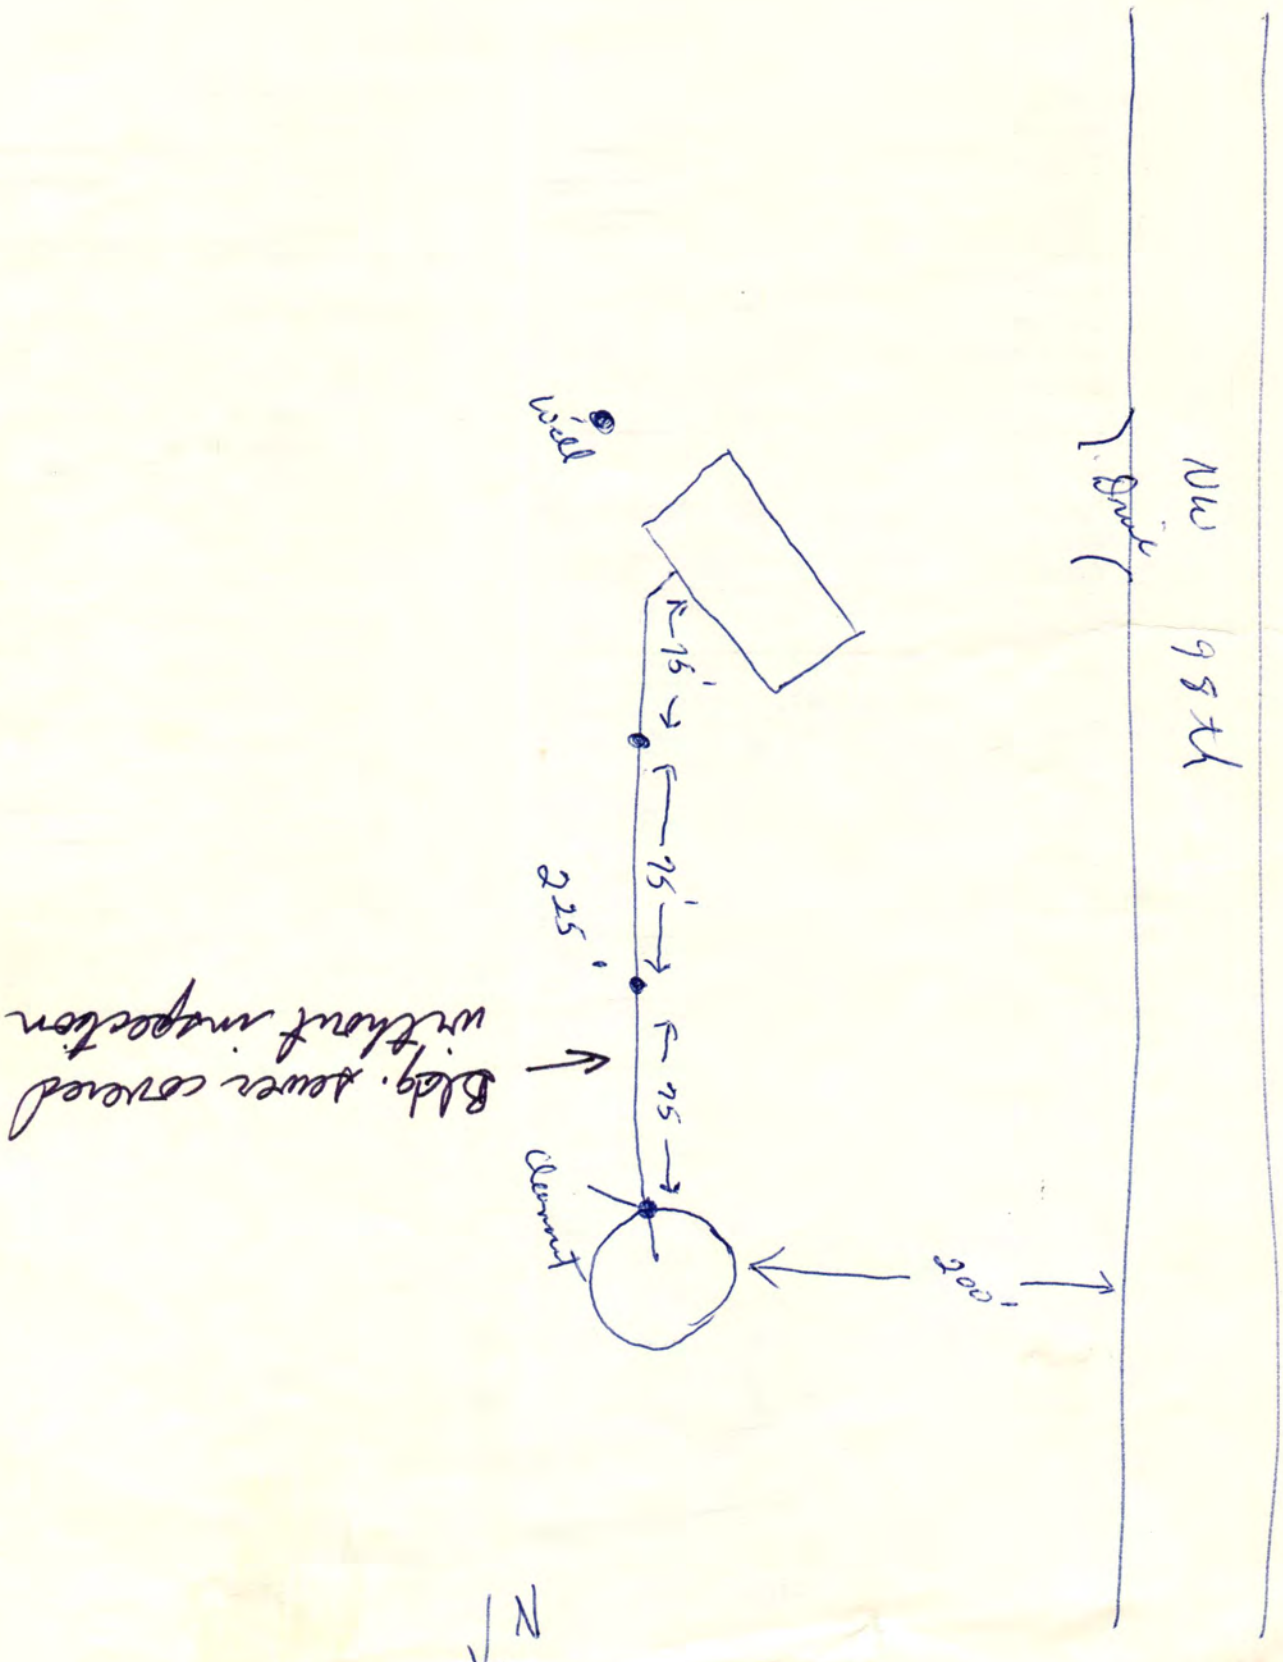

Lincoln-Lancaster County Health Department

3140 "N" Street, Lincoln, Nebraska 68510 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

FOR PROPERTY IN **LANCASTER COUNTY** ONLY

This form must be completed and returned with payment to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: "Lincoln-Lancaster County Health Department" or "LLCHD"

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

Legal Description of Property: Street Address 600 NW 98TH ST., LINCOLN, NE 68528
Twp 10 Range 5 Section 22 1/4 SW 1/4 Block Lot 144 Addition
Directions to Property ONE-FOURTH MILE NORTH OF HWY 6 ON NW 98TH STREET.

Location of Well SOUTH OF HOUSE Tap Location: Inside ☐ Outside ☒
Location of Sewage System LAGOON IS NORTH OF HOUSE Year Installed 1981

	NAME	ADDRESS	PHONE
Present Owner:	KENNETH E. & NANCY BRAUER	600 NW 98TH ST. LINCOLN, NE 68528	474-3006
Tenant/Buyer:			
Return to:	KENNETH E. BRAUER	600 NW 98TH ST. LINCOLN, NE 68528	474-3006 OR 488-2400

Signature of Applicant Kenneth E. Brauer Address 600 NW 98TH ST. LINCOLN, NE 68528 Date 7 / 1 / 97

HEALTH DEPARTMENT USE ONLY

RECEIVED
Date 07 / 01 / 97
Initials
Amount 150 =
Check No. 2996

DATA ENTRY
Date / /
Case No.
Initials

PRELIMINARY STATUS--By John Chen **DATE:** 7 / 10 / 97

WATER SYSTEM:	Approved	Disapproved
Construction	☒	☐
Bacteria	☒ 0 /ml	☐ /ml
Nitrate	☒ 3.5 ppm	☐ ppm

SEWAGE SYSTEM	
Approved	☐
Provisional	☐
Disapproved	☐

Additional Site Visits
Date 7 / 10 / 97 by JC
Date 7 / 14 / 97 by JC
Date / / by

Comments: ANIMALS, Poultry moved. FENCE replaced with new, Signed, locked gate. Vegation + Trees within 100 feet of Lagoon, hence provisional/Approval. At this time, Trees visable do not seem to be affecting the function of Lagoon. INSIDE OF DIKE mowed. See Attached Letter ☒

FINAL STATUS

WATER SYSTEM: Approved ☐ **SEWAGE DISPOSAL SYSTEM:** Approved ☐ Provisional Approval ☒

Approved by John Ehrig REHS Date 7 / 16 / 97

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

White - Applicant after approval Yellow - Environmental Health Pink - Business Office

Revised/Reprint: 10-95

A phone