LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 1735-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

MAY 24, 1981 — THIS PERMIT EXPIRES

Quality Septic Service — ISSUED TO

5850 Fletcher Ave. Lincoln, NE 68507 — ADDRESS

Lot 15

T12N, R6E, Section 15 I.T. R.F.D. Raymond NE — LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

Health — ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1735-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 11/21/80

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☒, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. T12N; Range R6E; Section 15
Block _____; Lot 15 I.T.; Addition _____
Street Address RFD Raymond

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. Bedrooms 2 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: add 100' of lateral Cleaned & Inspected tank

5. Work to be done by: Owner ☐; or Contractor ☒, Quality Septic Serv
Contractor's Name

6. Estimated cost of project:

a. Materials	$	
b. Labor	$	
c. Other	$	Owner
TOTAL	$	400.00

Janice Bulling
Signature of Applicant (owner or lessee)

RFD Raymond, Ne
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Site Visits:
Date: 11-21-80 by: RM
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold E. Hood
PROVISIONAL *

4. INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 11-24-80 by: Lon Mayeux

* A percolation test should have been done in order to determine the size of the subsurface leaching lateral field.

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 474-1541

D

DATE: 11/21/80

FILE NO. _____


SPECIFICATIONS AS BUILT — Janice Bulling

A. BUILDING SEWER:
1. Material _____; Diameter _____ in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank _____ ft.
4. Number of clean-outs _____.
5. Distances to:
Well or Suction Line _____ ft.;
Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material _____; No. of compartments _____.
2. Capacity _____ gals.;
3. Factory Built: Yes ☐ No ☐
(Company _____)
4. Manholes: Over Inlet; diam. _____ in.
Over Outlet; diam. _____ in.
Riser Above ☐ Below ☐ Grade ____ in.
5. Inlet: Baffle ☐ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☐
7. Depth of top of tank below finished grade _____ in.
8. Distances to:
Well or Suction Line _____ ft.;
Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material _____; Number - available outlets _____.
2. Factory Built: Yes ☐ No ☐
(Company _____)
3. Distance from Septic Tank _____ ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☐ Perforated Pipe ☒
Diameter of Half Round _____ or
Perforated Pipe 4" .
Material: fiberglass ☐ ; plastic ☒ ;
concrete ☐ ; other _____.
2. Lateral Lines:
Number 1 ; Length of each line 100', _____, _____, _____, _____ ft.;
Total length of laterals 238' ft.;
Distance between lateral lines ____ ft.
3. Trench dimensions: Width 3' ft.;
Slope 0 in/100 ft.; Average Depth 30 in.
4. Filter Material: Road Gravel
Depth of Material 14" in.
5. Distances to:
Well or Suction Line 106' ft.;
Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

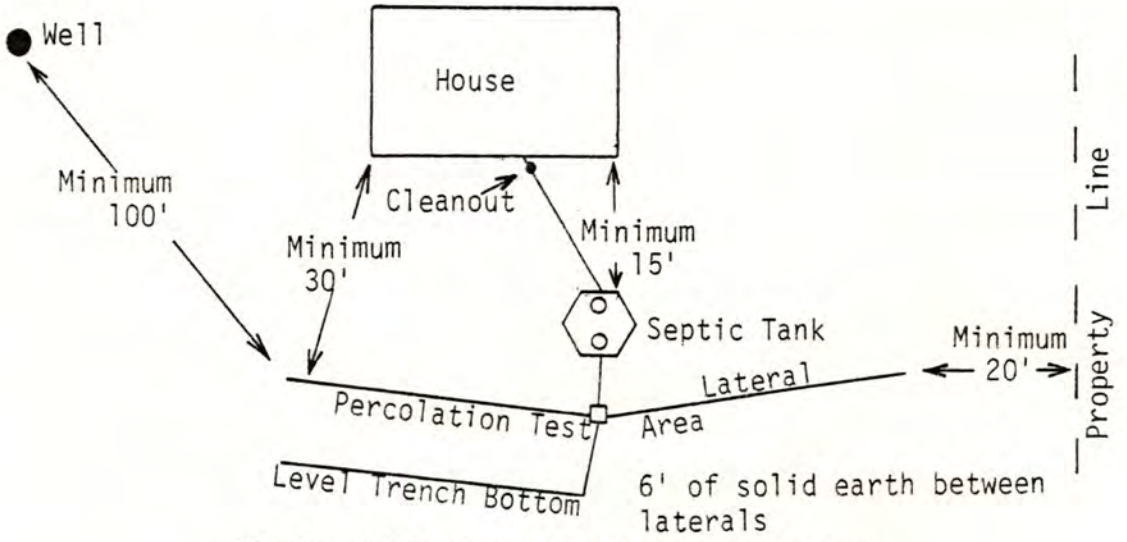

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

AS BUILT DRAWING OF SYSTEM

DATE 11/22/80 INSTALLER Quality Septic Service
Paul von Gillern

