LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

ENVIRONMENTAL HEALTH DIVISION

2200 St. Marys Ave Lincoln, NE 68502-3785 (402) 441-8000

NON TRANSFERABLE

PERMIT

Permit
SEWAGE SYSTEM REPAIR

No. 93390035201

Issued 11/02/93
Expires 05/02/94
Revenue Code 18754

Establishment
BRAD SOUTHWICK
T12N R5E SEC 27
8700 W BRANCHED OAK ROAD

FEES: $50.00

TOTAL $50.00

Permittee
BRAD SOUTHWICK
701 E 4TH ST
HICKMAN NE 68372

Issued By M. Jane Ford
Health Director

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW
"POST IN A PROMINENT PLACE"

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 471-7800)

FILE NO. _____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 10-28-93

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☒, or REPAIR ☒ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 12 ; Range 5 ; Section 27 ;
Block _____; Lot _____; Addition _____
Street Address 8700 W. Bromfield Oak

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. Bedrooms 3 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: 100' perforated pipe Lateral

5. Work to be done by: Owner ☐ ; or Contractor ☒, Southwick Sewer & Drain
Contractor's Name

6. Estimated cost of project:

a. Materials	$ _____
b. Labor	$ _____
c. Other	$ _____
TOTAL	$ ~~over~~ 400.00

Brad Southwick
Signature of Applicant (owner or lessee)

701 E. 4
Address
Hickman, Ne 68372

(Do not write below this line)

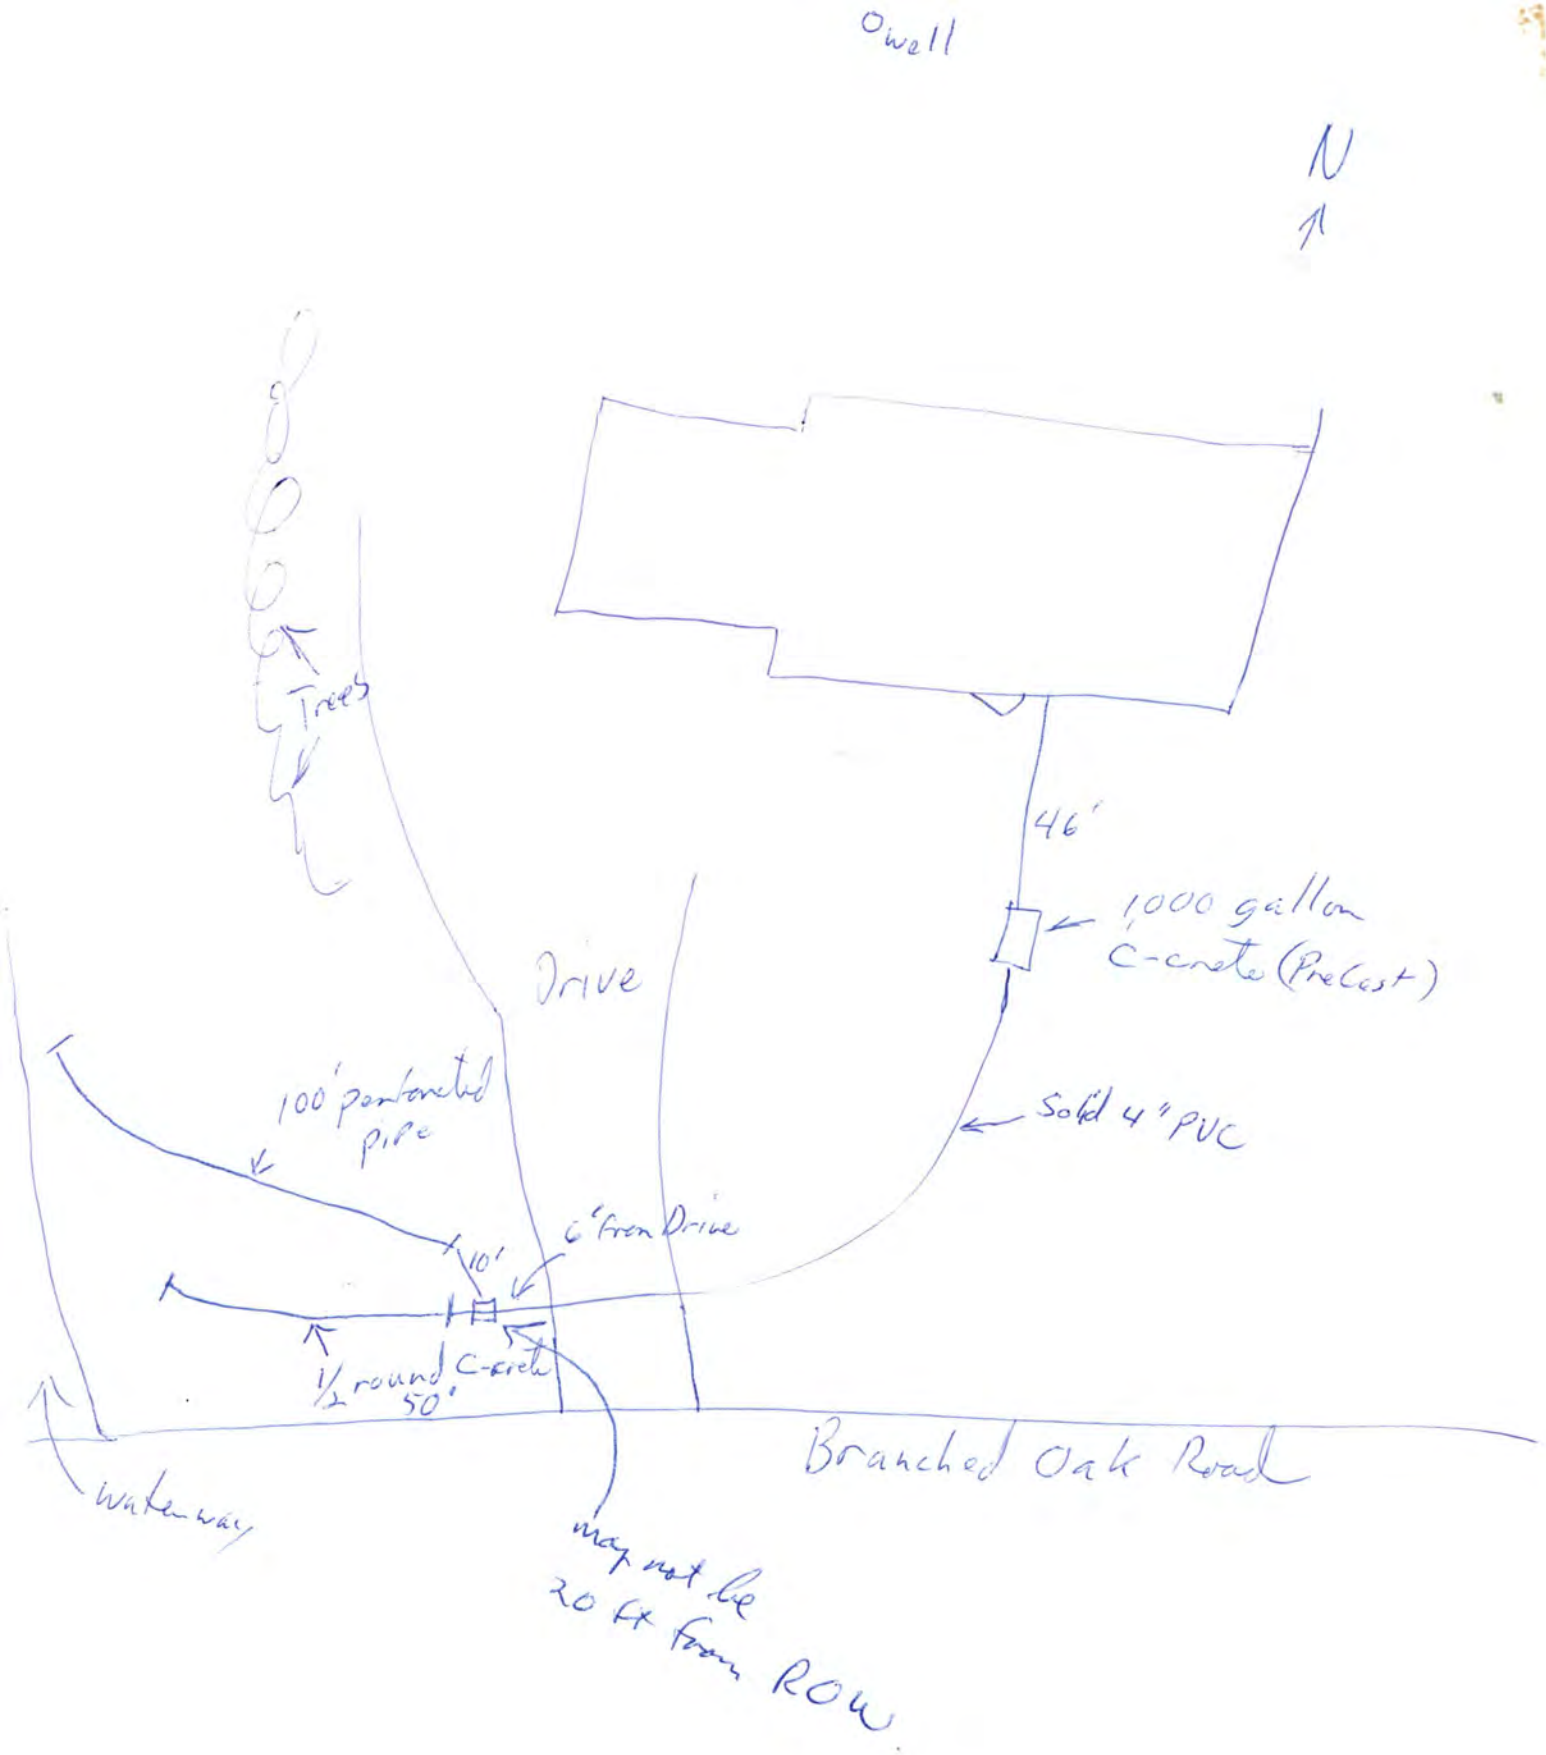
REVIEWING ACTION

1. Date Rec'd: 10-28-93
Filing Fee: $ 50.00

2. Site Visits:
Date: 10-28-93 by: rm
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Ron Moyer

4. INSTALLATION ~~FINAL~~ Provisional WRITTEN APPROVAL
Date: 10-28-93 by: Ron Moyer


well
N
Trees
46'
1,000 gallon
C-crete (PreCast)
Drive
100' perforated
pipe
Solid 4" PVC
10'
6' from Drive
1½ round C-crete
50'
Branched Oak Road
waterway
may not be
20 ft from ROW

Buyer (CK)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

004

2200 St Marys Avenue Phone (402) 471-7800 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 8-24-92

☒ Evaluation of the Sewage Disposal System ☐ Enclosed is $150.00

Legal Description of Property: TWP. 12 ; RANGE 5 ; SECTION 27 ; BLOCK ____

LOT ____; ADDITION _____; Street Address 8700 West Branched Oak Rd.

Directions to Property Take I180-w34 to 79- go north to Branched Oak Rd, West 2 1/4 miles. Homestead on the north side.

Location of Well Straight N. past windbreak Tap Location: Inside ☐ Outside ☒

Location of Sewage System Septic straight So. of house Year Installed 1975

	NAME	ADDRESS	PHONE
Present Owner:	Richard L. Young	8700 W. Branched Oak Rd. Raymond	438-5199 ~~783-2199~~ Clare
Tenant/Buyer:	Greg Johnson	14620 Danvers, Waverly 68462	786-2179
Return to:	Buyer BUYER AT ABOVE ADDRESS ~~Eugene Division of Farm Credit Services~~		W467-8766

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Richard L Young Address PO Box 34 Raymond Neb. 68428

206 So. 19th St. Omaha, NE 68102-1255 Attn: Kristi Loomis

==========

HEALTH DEPARTMENT USE ONLY

Date Received SEPTEMBER 25, 1992 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--DATE 9-28-92

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☐	Date 9-28-92 by RM
Bacteria	☒	☐	Provisional:	☒	Date _____ by ____
Nitrate	☒ 10.1 ppm	☐	Disapproved:	☒ Corrected	Date _____ by ____

Comments: Repairs made & Permit taken out on 10-28-93. However, the original installation of this septic system violated County regulations. Thus, a provisional approval. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☐	Provisional Approval: ☒

APPROVED BY Ron Mangum, R.S DATE 12-27-93

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832