LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2077-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

OCTOBER 6, 1984 — THIS PERMIT EXPIRES

RUSS SCHAFFER — ISSUED TO

ROUTE #1, BOX 28 — ADDRESS

RAYMOND, NE 68428

T12N; R5E; Sec 35; Lot 1 I.T.; NW 70 and Raymond Road — LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY	DATE	AMOUNT
CB	4/6/84	

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 2077-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 5 APRIL 1984

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☒, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 12 N ; Range 5 E ; Section 35 ;
Block ; Lot 1 I.T. ; Addition
Street Address NW 70TH AND RAYMOND RD.

2. Property Use: Residential ☑; Commercial ☐
No. Bedrooms 3
Describe
Other Use ☐
Describe

3. Type of existing Individual Sewage Disposal System: Septic Tank ☑; Other ☐

4. Description of proposed alteration, extension or repair: INSTALL 4 ON DISTRABUTION BOX AND INSTALL 100' OF NEW LATERAL; PROPERLY ABANDON OLD WELL

5. Work to be done by: Owner ☐ ; or Contractor ☑, BURESH PLUMBING
Contractor's Name

6. Estimated cost of project:

a. Materials	$ 1200	-
b. Labor	$ 150	-
c. Other	$	
TOTAL	$ 1350	-

Russ Schaffer
Signature of Applicant (owner or lessee)

RT 1 Box 28 RAYMOND NE. 68428
Address

(Do not write below this line)


REVIEWING ACTION

1. Date Rec'd:
Filing Fee: $ 30.00

2. Site Visits:
Date: 4/19/84 by: J.C.H.
Date: by:
Date: by:

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 4/19/84 by: J.C. Hood

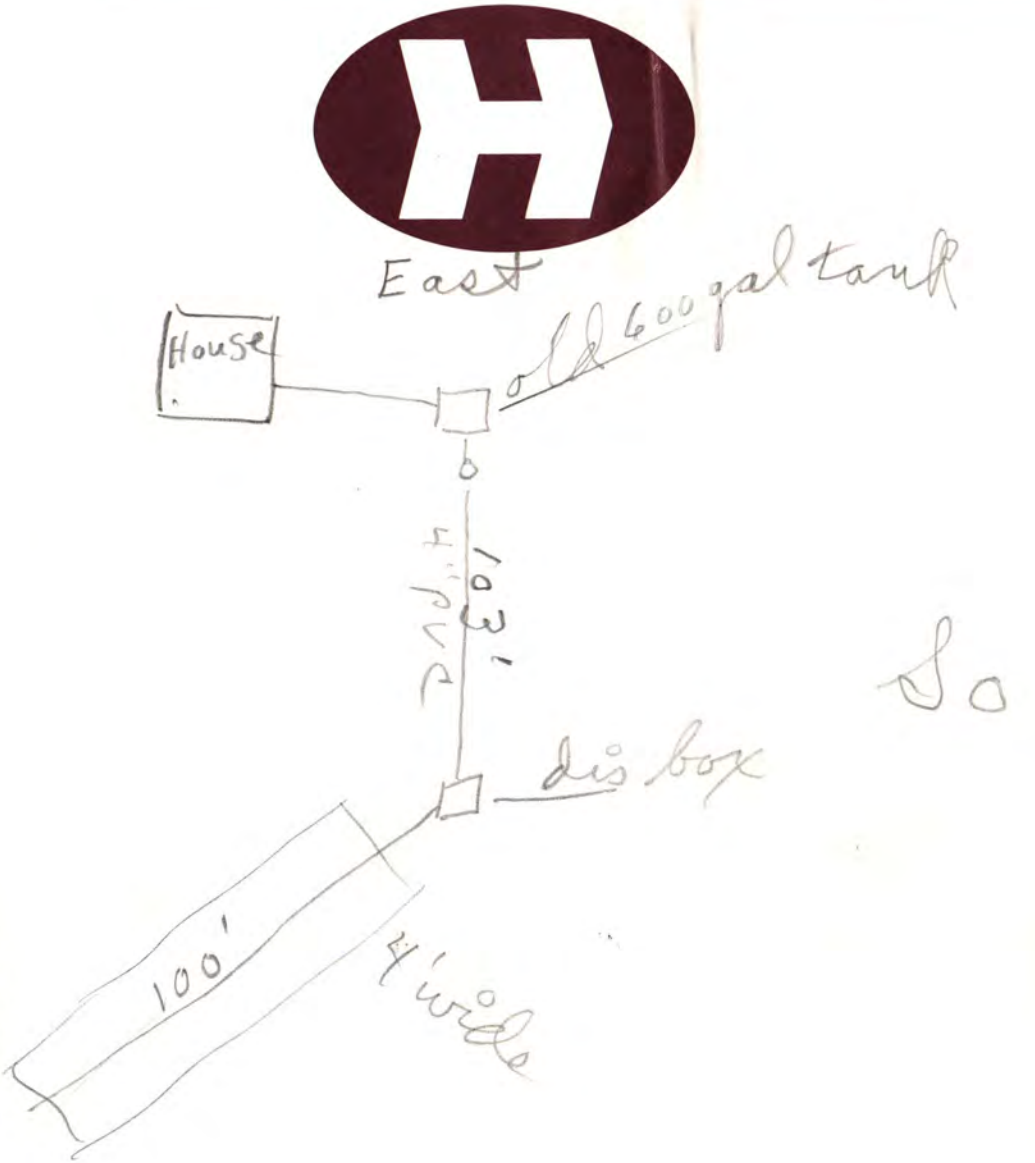

HOLMES
FREIGHT LINES, INC.

009

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 15505 N.W 70th Street

Twp 12N Range 5 Section 35 1/4 ___ 1/4 ___ Block ___ Lot 7 Addition ___

Directions to Property At Hwy 79 + Raymond Road, head west on Raymond Road 1 mile, then North - it's the first house on west side

Location of Well 20 yds N.W of the N.W. corner of house Tap Location: Inside ☒ Outside ☐

Location of Sewage System south of house - about 20 yds + laterals run west of tank Year Installed ??

	NAME	ADDRESS	PHONE
Present Owner:	Richard Schaffer	same as above Raymond NE 68428	783-2552
Tenant/Buyer:	N/A Rental		
Return to:	Richard Schaffer	15505 N.W 70th Raymond, NE 68428	

Signature of Applicant Richard Schaffer Address 15505 N.W. 70th Raymond, NE 68428 Date 8/30/93

HEALTH DEPARTMENT USE ONLY

Date Received 8/30/93 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--By R Margrave **DATE:** 8/30/93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	☒	☐	Approved ☐	Date 9/7/93 by ___
Bacteria	☒ 0 /ml	☐ ___ /ml	Provisional ☒	Date ___/___/___ by ___
Nitrate	☒ <0.1 ppm	☒ 4.0 ppm	Disapproved ☐	Date ___/___/___ by ___

Comments: Construction of septic system apparently predates County regulations. Have a provisional approval. Recommend chlorinating to one of septic tanks to be used + pumping. Infants must not be fed the raw water which is high in nitrate level. ☐ See Attached Letter

---

FINAL STATUS

* Approval applies to treated water for nitrate removal, not the raw water.

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Ron Margrave, R.S. Date 9/13/93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

Original not signed. Signed copy given to Richard Schaffer personally 9/30/93 RS

794