LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

FILE NO. 1171-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — March 22, 1978

TYPE OF PERMIT — THIS PERMIT EXPIRES

Mrs. Bob Gilliam, RFD, Pleasant Dale, NE

ISSUED TO — ADDRESS

T 10N, R5E, Section 31

LEGAL DESCRIPTION

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2
RECEIPTED BY	DATE	AMOUNT	

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH

ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒

County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1171-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-22-77

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

SEE ATTACHED

1. Legal description of property: Twp. 10N ; Range 5E ; Section 31
Block ____; Lot 15 I.T. ; Addition ____
Street Address ____

2. Property Use: Residential ____ ☒ ; Commercial ____ ☐
No. of Bedrooms 3 . Describe: ____
Other Use ____ ☐
Describe: ____

3. Type of Individual Sewage Disposal System: Septic Tank ☐ ; Other ☒

4. Distance to public sewer: ____ ft. Lagoon

Mrs. Bob Gilliam
Signature of Applicant (Owner or Lessee)

RFD Pleasant Dale Nebr.
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 9/22/77 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 9/22/77 . Signature: Jerrold E. Pool

2. Supt. Bldg. Insp.: Date Rec'd. 9-22-77 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 9-22-77 . Signature: A Williamsen

3. City ~~or County~~ Engineer : Date Rec'd. 9-22-77 . ACTION: Approved ☒ Disapproved ☐
Date Frwd. 9-22-77 . Signature: Henry Graff
10-11-77

REMARKS OR REASONS FOR DISAPPROVAL ____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1171

DATE: 9-22-77

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto. SEE ATTACHED

1. Legal description of property: Twp. 10N ; Range 5E ; Section 31 ; Block ; Lot ; Addition .
Street Address .

2. Property Use: Residential [X]; Commercial [ ]
No. of Bedrooms 3
Describe:
Other Use
Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [ ]; Other [X] Lagoon

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Mrs. Bob Gilliam
Signature of Applicant (owner or lessee)

RED Pleasant Dale, Neb.
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
Filing Fee: $ 30.00


2. Site Visits:
Date: 9-20-79 by: rm *
Date: by:
Date: by:

* Installed + sewer line covered without Health Dept. Inspection

3. Date: Approved [X]; Disapproved [ ] 9/23/77
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: by:

6-29-93
P.D.

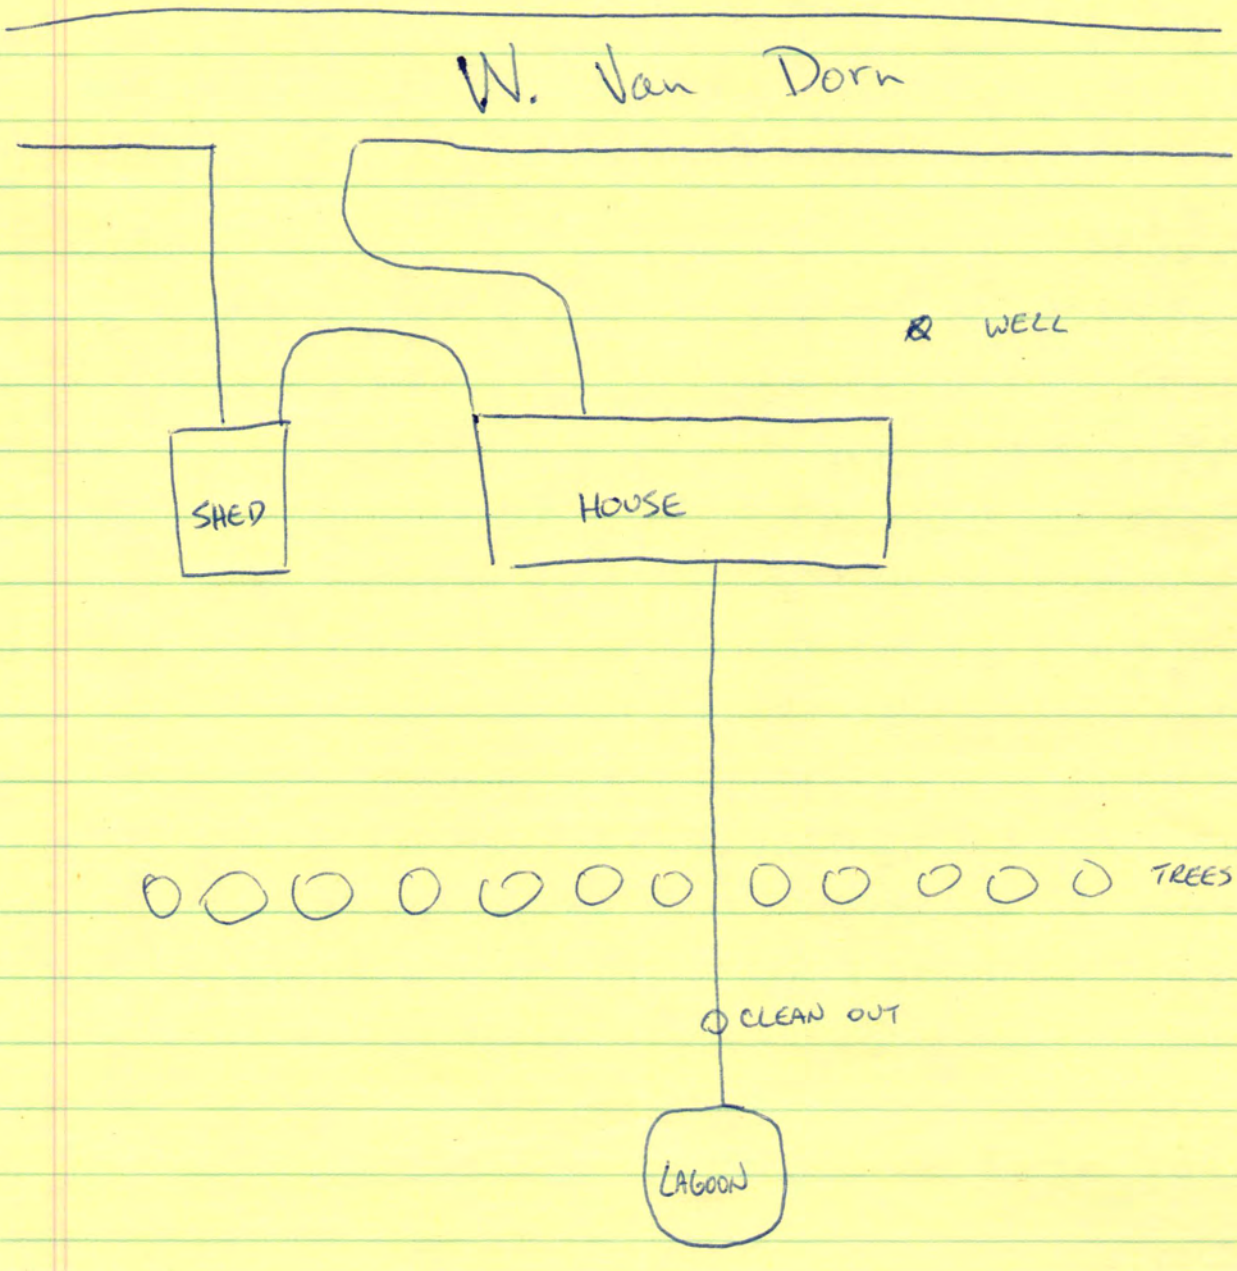

Part of the West 1/2 SE 1/4 Sec 31 - T 10 N - R 5 E of 6th P.M. Lancaster Co. Nebr. Further described as: The East 500' of the South 871.2' said West 1/2 SE 1/4 Sec 31 Containing 10.0 ± acres

004

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue · Phone (402) 471-7800 · Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 6/6/93

☒ Evaluation of the Sewage Disposal System ☐ Enclosed is $150.00

Legal Description of Property: TWP. 10N ; RANGE 5E ; SECTION SE¼ of 31 ; BLOCK ___

LOT 15 ; ~~ADDITION~~ Irregular tracts ; Street Address 13,000 W. Van Dorn St.

Directions to Property From flashing yellow at Emerald, go south on S.W. 84th for 2 mi. to Van Dorn St. Turn right (west) - proceed for 3.3 miles. Brick ranch w/white trim - north side of road.

Location of Well directly S-S.W. of front of house Tap Location: Inside ☐ Outside ☐

Location of Sewage System north of shelterbelt, which is north of house Year Installed 1978

	NAME	ADDRESS	PHONE
Present Owner:	Thomas & Melinda Esch	13000 West Van Dorn, Denton NE	795-5195
Tenant/Buyer:	Same		
Return to:			

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Melinda Mauch Esch Address R.R. #1 - Box 26A - Denton NE 68339

==========

HEALTH DEPARTMENT USE ONLY

Date Received 06/17/93 Received $150.00 Check ☑ #453619 Cash ☐

PRELIMINARY STATUS--DATE 6-21-93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☐	Date 6-21-93 by PD
Bacteria	0 ☒ 6-28-93	☐	Provisional:	☐	Date 6-23-93 by PD
Nitrate	0.3ppm ☒ 6-28-93	☐	Disapproved:	☒	Date 6-29-93 by PD

Comments: Aquatic weeds need to be removed.
6-29 weeds removed Noticed water outside dike NW corner. May be due to excessive rain this spring + summer. Place bentonite on inside edge of NW corner at earliest possible time. See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☐	Provisional Approval: ☒ *

APPROVED BY Paul Dryman DATE 6-29-93

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

* Sewer line was never inspection in 1979, according to department records.

192

This form is to be completed and returned to the Health Department to initiate a request for loan approval.
Make Checks Payable to: Lincoln-Lancaster County Health Department

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, NE 68502
Phone: 474-1541

Enclosed is $45.00 Fee ☒

DATE: September 19, 1979

The undersigned hereby requests evaluation of the following for loan approval on the below described property:

☒ Evaluation of the Individual Water Supply
☒ Evaluation of the Sewage Disposal System

Legal description of property: Twp. 10 N ; Range 5E ; Section 31 ;
~~Block~~ Part of the ; ~~Lot~~ West ½ SE ¼ ; Addition _____ .
Street Address 13000 West Van Dorn (2nd house west on North side of 126th & W. Van Dorn
Directions on how to get to property _____ .

Location of well Front yard - left .
Where is tap: Inside ☐ Outside ☒ North & South .

	NAME	ADDRESS	PHONE
Present Owner:	Orrel Reich	Out of State	
Tenant:	Vacant		
Lending Agency:	1st Federal S&L	Crete, Nebraska	475-0521

~~Indian Creek, Inc. - Developer~~

(Do not write below double lines)

Health Department: Date Received 9/19/79
Received $45.00 Check ☒ Cash ☐
Site Visits: Date 9-20-79 by rm
* Date 9-24 79 by rm
Date _____ by _____

Orrel E. Boyce 467-3545
Signature of Applicant
Firestone Construction Co. Inc.
555 North Cotner Blvd.
Address Lincoln

* Need Gate & lock, weeds at water edge must be removed, seed grass as soon as possible, Clean out pipe top & cap required

PRELIMINARY STATUS -- DATE 9-20-79

Water System:
Approved ☒ Disapproved ☐

Sewage Disposal System:
Approved ☐ Provisional Approval ☐
Disapproved ☒

Corrections Required or Reasons for Disapproval Lawn needs fence, seed with grass, property lines?, Cross-connection of hose in lagoon. Cleanout pipe should be repaired.
☒ See Attached Letter.

FINAL APPROVAL -- DATE 10-30-79

Water System ☒ . Sewage Disposal System ☒ *. BY Ron Mayhew

Form Number 20215-0878

* Provisional pipe
* Sewer line was covered without Health Dept inspection.