LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2162-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

MAY 30, 1985 — THIS PERMIT EXPIRES

GERALDINE AULT — ISSUED TO

1500 SW 98TH STREET LINCONN, NE 68532 — ADDRESS

T10N; R5E; Sec 33; Lot 7 I.T.; RR #1; Denton; So. 112th & Van Dorn — LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY	DATE	AMOUNT
[illegible]	1/30/84	30.00

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. _____

20109-0977

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. F 2162-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: _____

The undersigned hereby applies for a permit to ALTER ☒, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 10N ; Range 5E ; Section 33 ;
Block _____ ; Lot 7 I.T. ; Addition _____
Street Address RR#1 Denton, Ne 68339 (12th & Van Dorn)

2. Property Use: Residential _____ ☒; Commercial _____ ☐
No. Bedrooms 3 Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: altered for lagoon

5. Work to be done by: Owner ☐ ; or Contractor ☒ , _____
Contractor's Name

6. Estimated cost of project:

a. Materials	$
b. Labor	$
c. Other	$
TOTAL	$

Geraldine Ault
Signature of Applicant (owner or lessee)

1500 SW 98th Lincoln, Ne.
Address 475-3551 68532

(Do not write below this line)

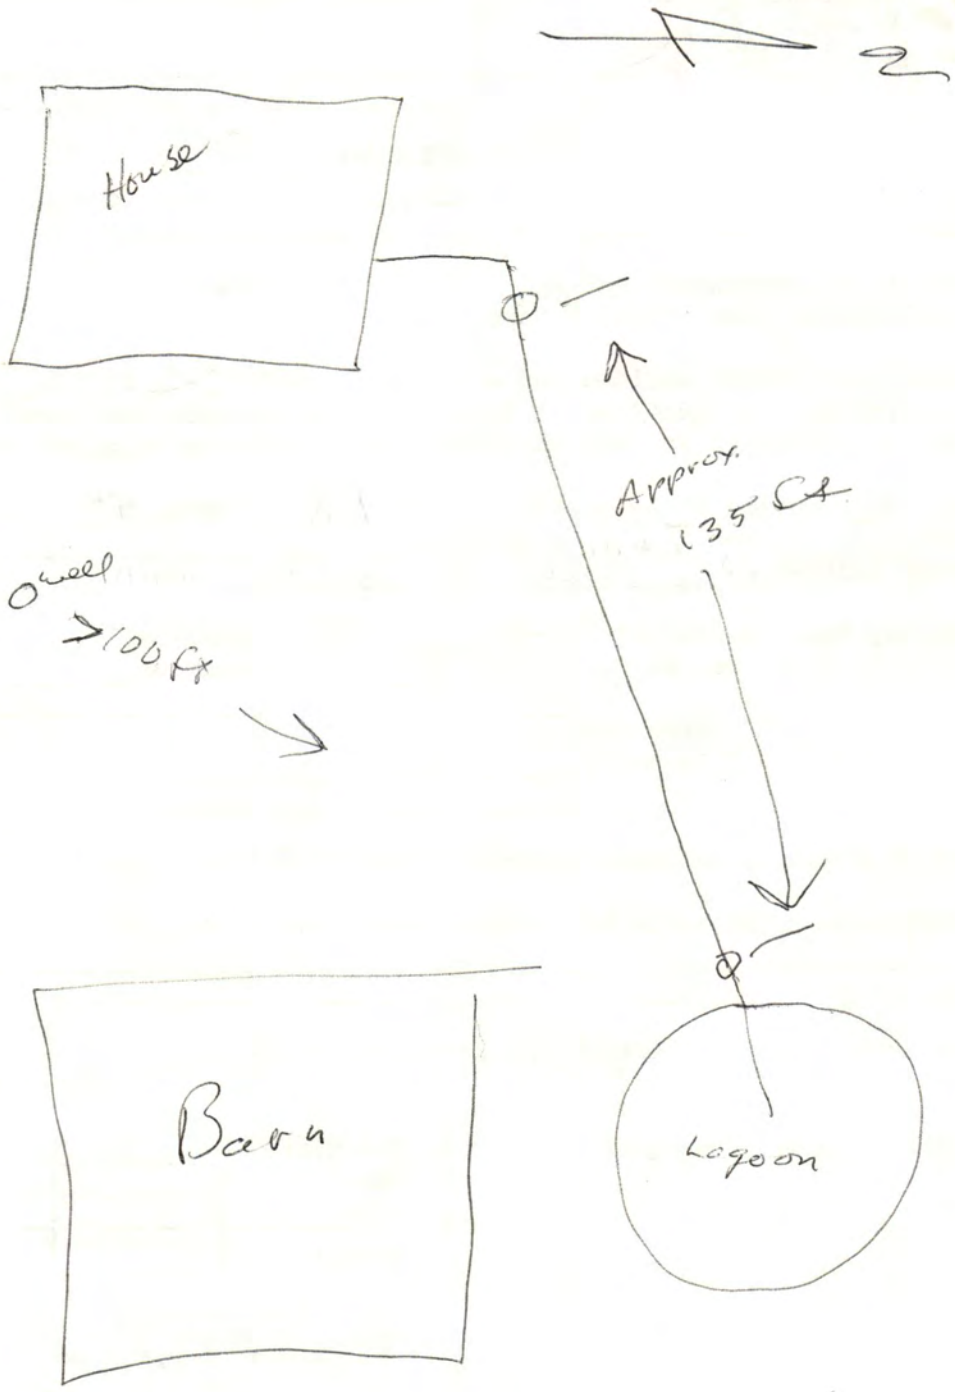
REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Site Visits:
Date: 11-30-84 by: nm Sewer line covered before inspection
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Jerrold E. Heed
PROVISIONAL

4. INSTALLATION ~~FINAL~~ WRITTEN APPROVAL
Date: 12-3-84 by: Ron Maynard


House
Approx.
135 Ft
Well
>100 Ft
Barn
Lagoon

006

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN APPROVAL FORM

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☑ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☐ Evaluation of the Individual Water System ☐ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 1600 West Vandorn

Twp 10N Range 5E Section 33 1/4 ___ 1/4 ___ Block ___ Lot 7TH Addition ___

Directions to Property West on Vandorn. House on north side road site on hill grey-red barn

Location of Well In back of driveway Tap Location: Inside ☐ Outside ☒ IN BARN

Location of Sewage System north of Barn Year Installed 1992

	NAME	ADDRESS	PHONE
Present Owner:	Margaret Bond	Rt 1 Box 37 Denton, Ne. 68339	475-2423
Tenant/Buyer:			
Return to:			

Signature of Applicant Margaret Bond Address Rt 1 Box 37 Denton Ne 68339 Date 5/14/93

HEALTH DEPARTMENT USE ONLY

Date Received 5/14/93 Received $150.00 Check ☒ Cash ☐

PRELIMINARY STATUS--By Jerrold Wood **DATE:** 5/18/93

WATER SYSTEM:	Approved	Disapproved	**SEWAGE SYSTEM**	**Additional Site Visits**
Construction	☐	☒	Approved ☐	Date 5/21/93 by L.C.H.
Bacteria	☒ ____/ml	☐ ____/ml	Provisional ☐	Date ___/___/___ by ___
Nitrate	☒ 0.1 ppm	☐ ____ppm	Disapproved ☒	Date ___/___/___ by ___

Comments: NEED GOOD 4 FOOT HIGH FENCE AROUND LAGOON WITH WARNING SIGNS AND LOCKED GATE. NEED TREES REMOVED AND WEEDS KILLED OUT AROUND AND IN LAGOON. NEED SLIGHT DEPRESSION FILLED IN EAST OF WELL. Old cesspool filled in. See Attached Letter ☐

FINAL STATUS PROVISIONAL APPROVAL IS GIVEN ON SEWAGE SYSTEM BECAUSE A PREVIOUS OWNER HAD APPARENTLY INSTALLED IT WITHOUT A PERMIT OR INSPECTION.

WATER SYSTEM: Approved: ☒ **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: ☒

Approved by Jerrold C. Wood R.E.H.S. Date 5/24/93

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

93