Might want to close as soon as possible. 022 thank you

Lincoln-Lancaster County Health Department

2200 St. Mary's Avenue, Lincoln, Nebraska 68502 Phone: 441-8022

REAL ESTATE TRANSFER/LOAN API

ORIGINAL LOAN APPROVAL FILE
PREVIOUS HISTORY UNKNOWN

This form must be completed and returned to request a

MAKE CHECK PAYABLE TO: Lincoln-Lancaster County Health Department or LLCHD

☒ Enclosed is $150.00. Allow two weeks for processing. Incomplete information will delay processing.

☒ Evaluation of the Individual Water System ☒ Evaluation of the Sewage Disposal System

Legal Description of Property: Street Address 9000 West Middle Rd., Raymond, Ne.
Twp 12N Range 5E Section 34 1/4 ___ 1/4 ___ Block ___ Lot ___ Addition ___
Directions to Property Go to Hiway 79 and West Raymond Rd., then go 1/2 mile West to NW 70th St., then go 1/2 mile North to West Middle Rd., go West 1 ½ miles, property on North side

Location of Well Inside small house Tap Location: Inside ☒ and Outside ☒
Location of Sewage System septic tank SE of larger house 60-80 feet latterals run to the SE Year Installed 1985

	NAME	ADDRESS	PHONE
Present Owner:	Charles E. Olson		
Tenant/Buyer:	Bryan L. & Stacey E. Brandenburgh	residing in the property	Stacey at work 437-4334
Return to:	Crowne Closing Company	6940 O St., Ste. 312 Lincoln, Ne. 68510	464-1200

Signature of Applicant Bill Langdon for Buyer as Escrow Agent Address 6940 O St., Ste. 312 Lincoln, Ne. 68510 Date 8 / 17 / 95

HEALTH DEPARTMENT USE ONLY

Date Received 08/18/95 jp Received $150.00 ✓ Check ☐ ✓ #5458 Cash ☐

PRELIMINARY STATUS--By Ron Marquart **DATE:** 8/21/95

WATER SYSTEM:	Approved*	Disapproved	SEWAGE SYSTEM	Additional Site Visits
Construction	☒	☐	Approved ☐	Date 8/28/95 by RM
Bacteria	☒ 0 /ml	☐ ___ /ml	Provisional ☒	Date ___/___/___ by ___
Nitrate	☒ 0.1 ppm	☐ ___ ppm	Disapproved ☐	Date ___/___/___ by ___

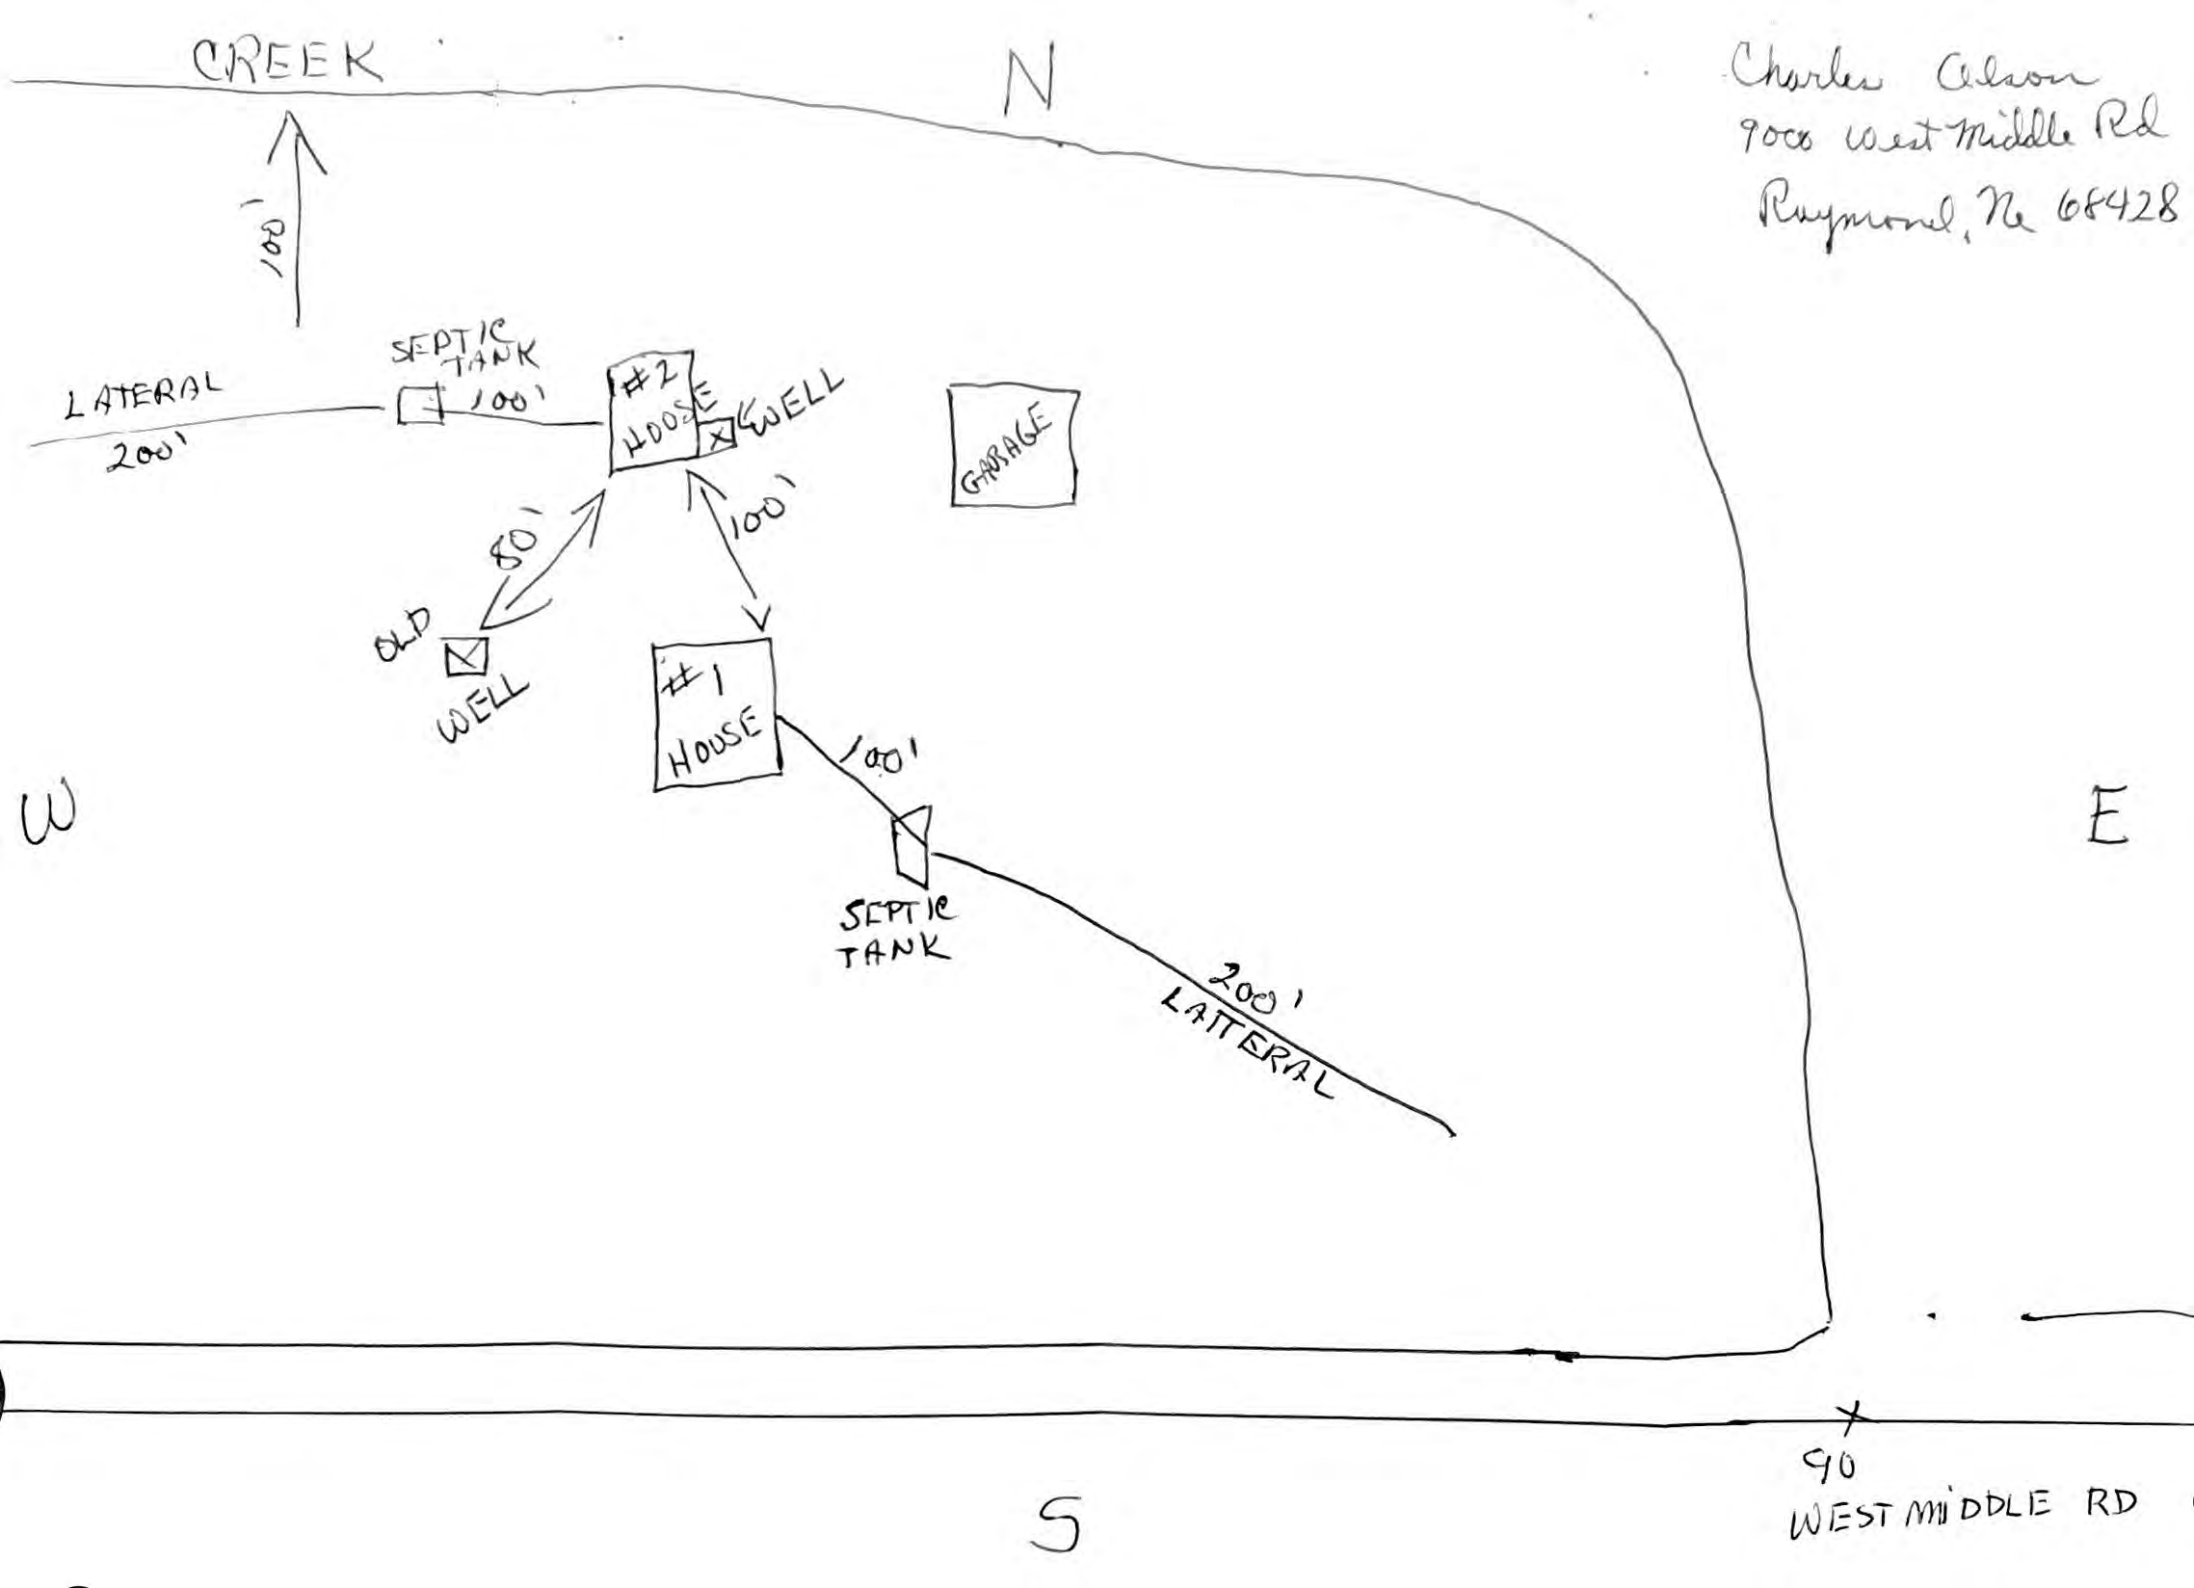
*Comments: Flood plain map evidence indicates the north house and thus the in-use well are probably in the 100 yr. flood plain. Approval applies provided old, unused well is properly abandoned this fall, the top of the in-use well must be 12 inches above the 100 yr. flood plain. See Attached Letter ☐

FINAL STATUS
WATER SYSTEM: Approved: ☒* **SEWAGE DISPOSAL SYSTEM** Approved: ☐ Provisional Approval: **☒

Approved by Ron Marquart, RS Date 8/29/95

Approval or disapproval is based on State and local standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operations.

** Recommend checking to see if septic tanks need pumping.


CREEK
N
Charles Olson
9000 West Middle Rd
Raymond, Ne 68428
100'
LATERAL
200'
SEPTIC TANK
100'
#2 HOUSE
WELL
GARAGE
80'
100'
OLD WELL
#1 HOUSE
100'
SEPTIC TANK
200' LATTERAL
W
E
S
90
WEST MIDDLE RD