FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐

County Resolution No. 2832 ☒

Lincoln-Lancaster County HEALTH DEPARTMENT

3140 "N" STREET LINCOLN, NE 68510-1514

FILE NO._____

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 9-13-96

The undersigned hereby applies for a permit to ALTER ☒, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 11N ; Range 8E ; Section 34 SW 1/4 of SW 1/4;
Block_____; Lot_____; Addition N 148th + Fletcher NE of intersection
Street Address 14800 Fletcher Ave.

2. Property Use: Residential_____ ☒; Commercial_____ ☐
No. Bedrooms 2 Describe_____

Other Use ☐
Describe_____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: Sewer line connecting house to septic system.

5. Work to be done by: Owner ☐ ; or Contractor ☒ , Mike Dietze
Contractor's Name

6. Estimated cost of project:

a. Materials	$ Less than	$400.
b. Labor	$	
c. Other	$	
TOTAL	$	

Dave Dietze for Mike Dietze

Signature of Applicant (owner or lessee)

Address

(Do not write below this line)

REVIEWING ACTION


1. Date Rec'd: NO FEE
Filing Fee: $_____

2. Site Visits:
Date: 9-13-96 by: sm
Date:_____ by:_____
Date:_____ by:_____

3. Date: Approved ☐ ; Disapproved ☐
by:_____

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 9-13-96 by: Lon Mangum

14800

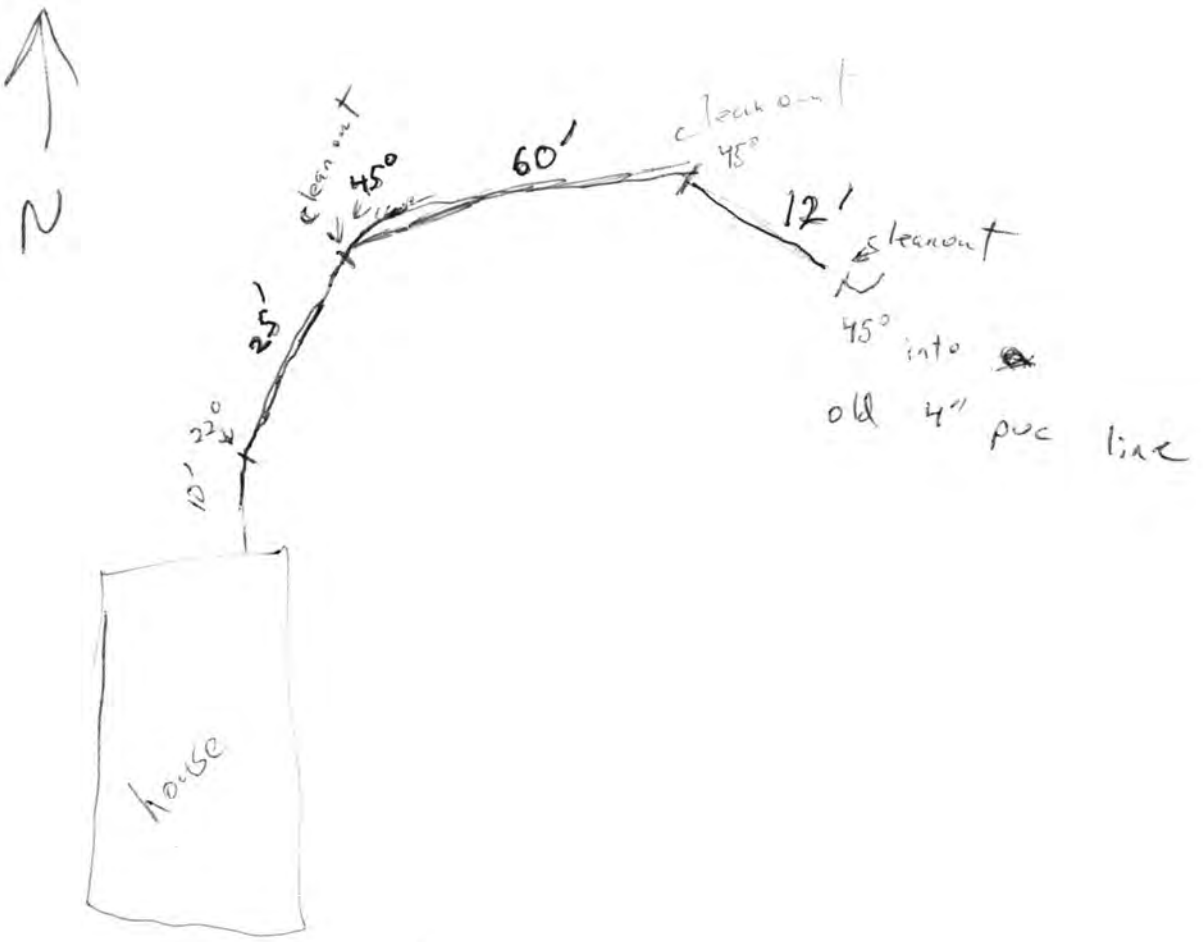

o
well
greater
Than
50'
from
Sewer

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2139-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF PERMIT

APRIL 12, 1985
THIS PERMIT EXPIRES

CHARLES BECKER — 2729 DUDLEY — LINCOLN, NE 68503
ISSUED TO — ADDRESS

T11N; R8E; Sec 34 SW¼; No. 148th & Fletcher Ave.
LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE NEW CONSTRUCTION

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 60.00	$	$	$ 60.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY	DATE	AMOUNT
JM	10-15-84	60.00

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2139-C

DATE: 10-2-84

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 11 N ; Range 8E ; Section 34 SW/4 ;
   Block _____ : Lot 20 I.T. : Addition _____
   Street Address NE CORNER OF N. 148th & Fletcher Ave

2. Property Use: Residential ☒ ; Commercial ☐ Other Use ☐
   No. of Bedrooms 2 . Describe _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

CHARLES BECKER
Signature of Applicant (Owner or Lessee)
2729 DUDLEY
LINCOLN, NE
Address

(Do not write below this double line)

1. Health Department: Date Rec'd. 10/12/84 . Date Frwd. 10/15/84 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Nood

2. Supt. Bldg. Insp.: or Village Clerk Date Rec'd. 10-15-84 . Date Frwd. 10-15-84 . ACTION: Approved ☑ Disapproved ☐ Signature: Paul Baumo

3. City or County Engineer: Date Rec'd. _____ . Date Frwd. _____ . ACTION: Approved ☑ Disapproved ☐ Signature: Don R. Thomas

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 10-2-84 by: pm
Date: _____ by: _____
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 10-15-84 By: Ron Mayant

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2139-C

PROPERTY WHERE SOIL TESTED:

Location: Township 11N ; Range 8E ; Section & ¼ Section 34 SW/4
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☒ ; Clay Loam ☐ .
Dates of Tests: 6-21 to 6-22/84. Weather: Precip. _____ Temp. 80's.

OWNER: CHARLES BECKER

Address: _____

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36	6/21	11:00	6/22	11:50	6/22	1:50	16 7/8	6/22	16 7/8	30	3/4	40
2			AM		AM			14	2:20	14 3/4		3/4	40
3							PM	15	PM	15 7/8		7/8	34
4								17 7/8		19 1/4		1 3/8	24
5								14 1/4		15 1/2		1 1/4	24
6								28 1/4		29 7/8		1 5/8	16
7								29 7/8		30 3/4		7/8	34
8								21 3/4		22 1/4		1/2	60
9								18 3/4		20 1/4		1 1/2	20
10								15 3/4		17		1 1/4	24

Brad Southwick
Signature of Person Conducting Test

Address 7012 4th Hickman NE Phone 792-2462

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

Remarks: _____

Soil Type (SCS): _____

Date: _____

Approved Percolation Rate (a)
A. 28 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

FORM 20104-0477
PLANS & SPECIFICATIONS FOR SEWAGE DISPOSAL SYSTEM (Annex to Application)
City Ordinance No. 9150 ☐
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

D

DATE: _____

FILE NO. 7139-C


SPECIFICATIONS AS BUILT

A. BUILDING SEWER: MOBILE HOME
1. Material _____; Diameter _____ in.
2. Distance above basement floor _____ in., or below basement floor _____ in.
3. Distance between dwelling and septic tank _____ ft.
4. Number of clean-outs _____.
5. Distances to:
Well or Suction Line _____ ft.; Stream _____ ft.; Pressure Line _____ ft.; Property Line _____ ft.

B. SEPTIC TANK:
1. Material FIBERGLAS; No. of compartments 1.
2. Capacity 1,000 gals.;
3. Factory Built: Yes ☒ No ☐
(Company CORR-A-GLAS Co.)
4. Manholes: Over Inlet; diam. 12 in.
Over Outlet; diam. — in.
Riser Above ☐ Below ☐ Grade ___ in.
5. Inlet: Baffle ☒ ; or Tee ☐
6. Outlet: Baffle ☐ ; or Tee ☒
7. Depth of top of tank below finished grade 15 in.
8. Distances to:
Well or Suction Line 100 ft.; Stream 200 ft.; Pressure Line _____ ft.; Property Line _____ ft.

C. DISTRIBUTION BOX:
1. Material PLASTIC; Number - available outlets 7.
2. Factory Built: Yes ☒ No ☐
(Company _____)
3. Distance from Septic Tank 7 ft.

D. ABSORPTION FIELD: (Provide as built drawings on back of this form)
1. Type: Half Rounds ☒ Perforated Pipe ☐
Diameter of Half Round 12 or Perforated Pipe _____.
Material: fiberglass ☒ ; plastic ☐ ; concrete ☐ ; other _____.
2. Lateral Lines:
Number 2 ; Length of each line 92, 92, _____, _____, _____ ft.;
Total length of laterals 184 ft.;
Distance between lateral lines 10-15 ft.
3. Trench dimensions: Width 4 ft.;
Slope 4 in/100 ft.; Average Depth 34 in.
4. Filter Material: ROAD GRAVEL
Depth of Material 20 in.
5. Distances to:
Well or Suction Line 108 ft.; Stream 150 ft.; Pressure Line 45 ft.; Property Line 300 ft.

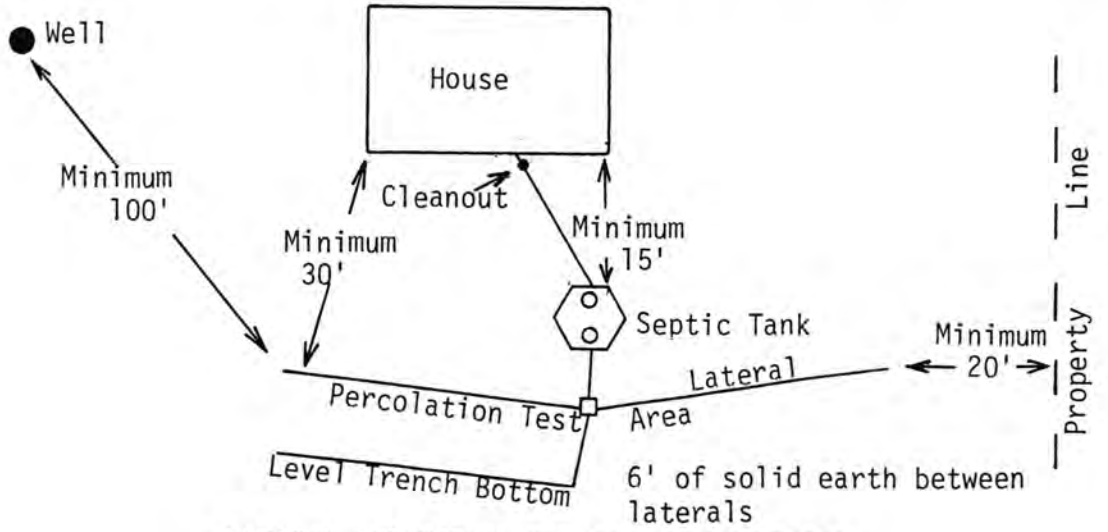

TYPICAL INDIVIDUAL SEWAGE SYSTEM DESIGN

AS BUILT DRAWING OF SYSTEM

DATE 10-2-84 INSTALLER SOUTHWICK SEWE & DRAIN

