LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 2156-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF PERMIT

MAY 15, 1985 — THIS PERMIT EXPIRES

KENNETH STICKNEY — ISSUED TO

BOX 475 — ADDRESS

WALTON, NE 68461

T11N; R8E; Sec 6; Lot 17 I.T.
LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE ALTER, EXTEND OR REPAIR

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 39.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY — DATE — AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2832

20109-0977

REC'D NOV 15 1984

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 2156-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 11-7-84

The undersigned hereby applies for a permit to ALTER ☑, EXTEND ☐, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 11N ; Range 8E ; Section 6 ;
Block ; Lot 17 IT; Addition
Street Address

2. Property Use: Residential ☒; Commercial ☐
No. Bedrooms 2
Describe
Other Use ☐
Describe

3. Type of existing Individual Sewage Disposal System: Septic Tank ☐; Other ☑

4. Description of proposed alteration, extension or repair: New One
Repair & Replace

5. Work to be done by: Owner ☐; or Contractor ☒, Wayne Heitbrink
Contractor's Name

6. Estimated cost of project:

a. Materials	$ 1459.00
b. Labor	$ 666.00
c. Other	$
TOTAL	$ 2125.00

Kenneth Stickney
Signature of Applicant (owner or lessee)

Box 475 Walton Ne 68461
Address

(Do not write below this line)

REVIEWING ACTION

1. Date Rec'd:
Filing Fee: $ 30.00

2. Site Visits:
Date: 11/20/84 by: J.C.H.
Date: by:
Date: by:

3. Date: Approved ☒; Disapproved ☐
by: Jerrold C. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 12/19/84 by: J.C. Hood

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. _____

PROPERTY WHERE SOIL TESTED:

Location: Township _____; Range _____; Section & ¼ Section _____.
Property Dimensions: _____ ft. x _____ ft. Area: _____ acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ☐ .
Dates of Tests: 11-6-84 to 11-7-84. Weather: Precip. 0 Temp. 4[illegible]-55. Low - 30°

OWNER: Kenneth Stickney
Address: Box 475 Walton NE 68461

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	12"	11-6	4:00	11-6	8:00	11-7	4:10	6"	4:40	5 1/16"	30	1/2	
2	12"	11-6	4:01	11-6	8:01	11-7	4:10	6"	4:40	5"	30	1	
3	12"	11-6	4:02	11-6	8:02	11-7	4:10	6"	4:40	5"	30	1	
4	12"	11-6	4:03	11-6	8:03	11-7	4:10	6"	4:40	5 1/4"	30	3/4	
5	12"	11-6	4:04	11-6	8:04	11-7	4:10	6"	4:40	5 1/2"	30	1/2	
6	12"	11-6	4:05	11-6	8:05	11-7	4:10	6"	4:40	4 3/4"	30	1 1/4	

Sum of Percolation Rates: _____
Average of Rates: _____
Mean of Rates: _____

Thomas J. Stickney
Signature of Person Conducting Test

Address RT 3 Lincoln NE 68505 Phone 786-5996


(Do not write below this line)

REVIEWING ACTION

Remarks: _____
Soil Type (SCS): Marshsburg Silty Clay Loam
Date: NOVEMBER 9, 1984
CONFIRMED 11/20/84

Approved Percolation Rate (a)
A. 37 min./inch
B. _____ min./inch
C. _____ min./inch

Jerrold C. Hood
Signature of Reviewing Official

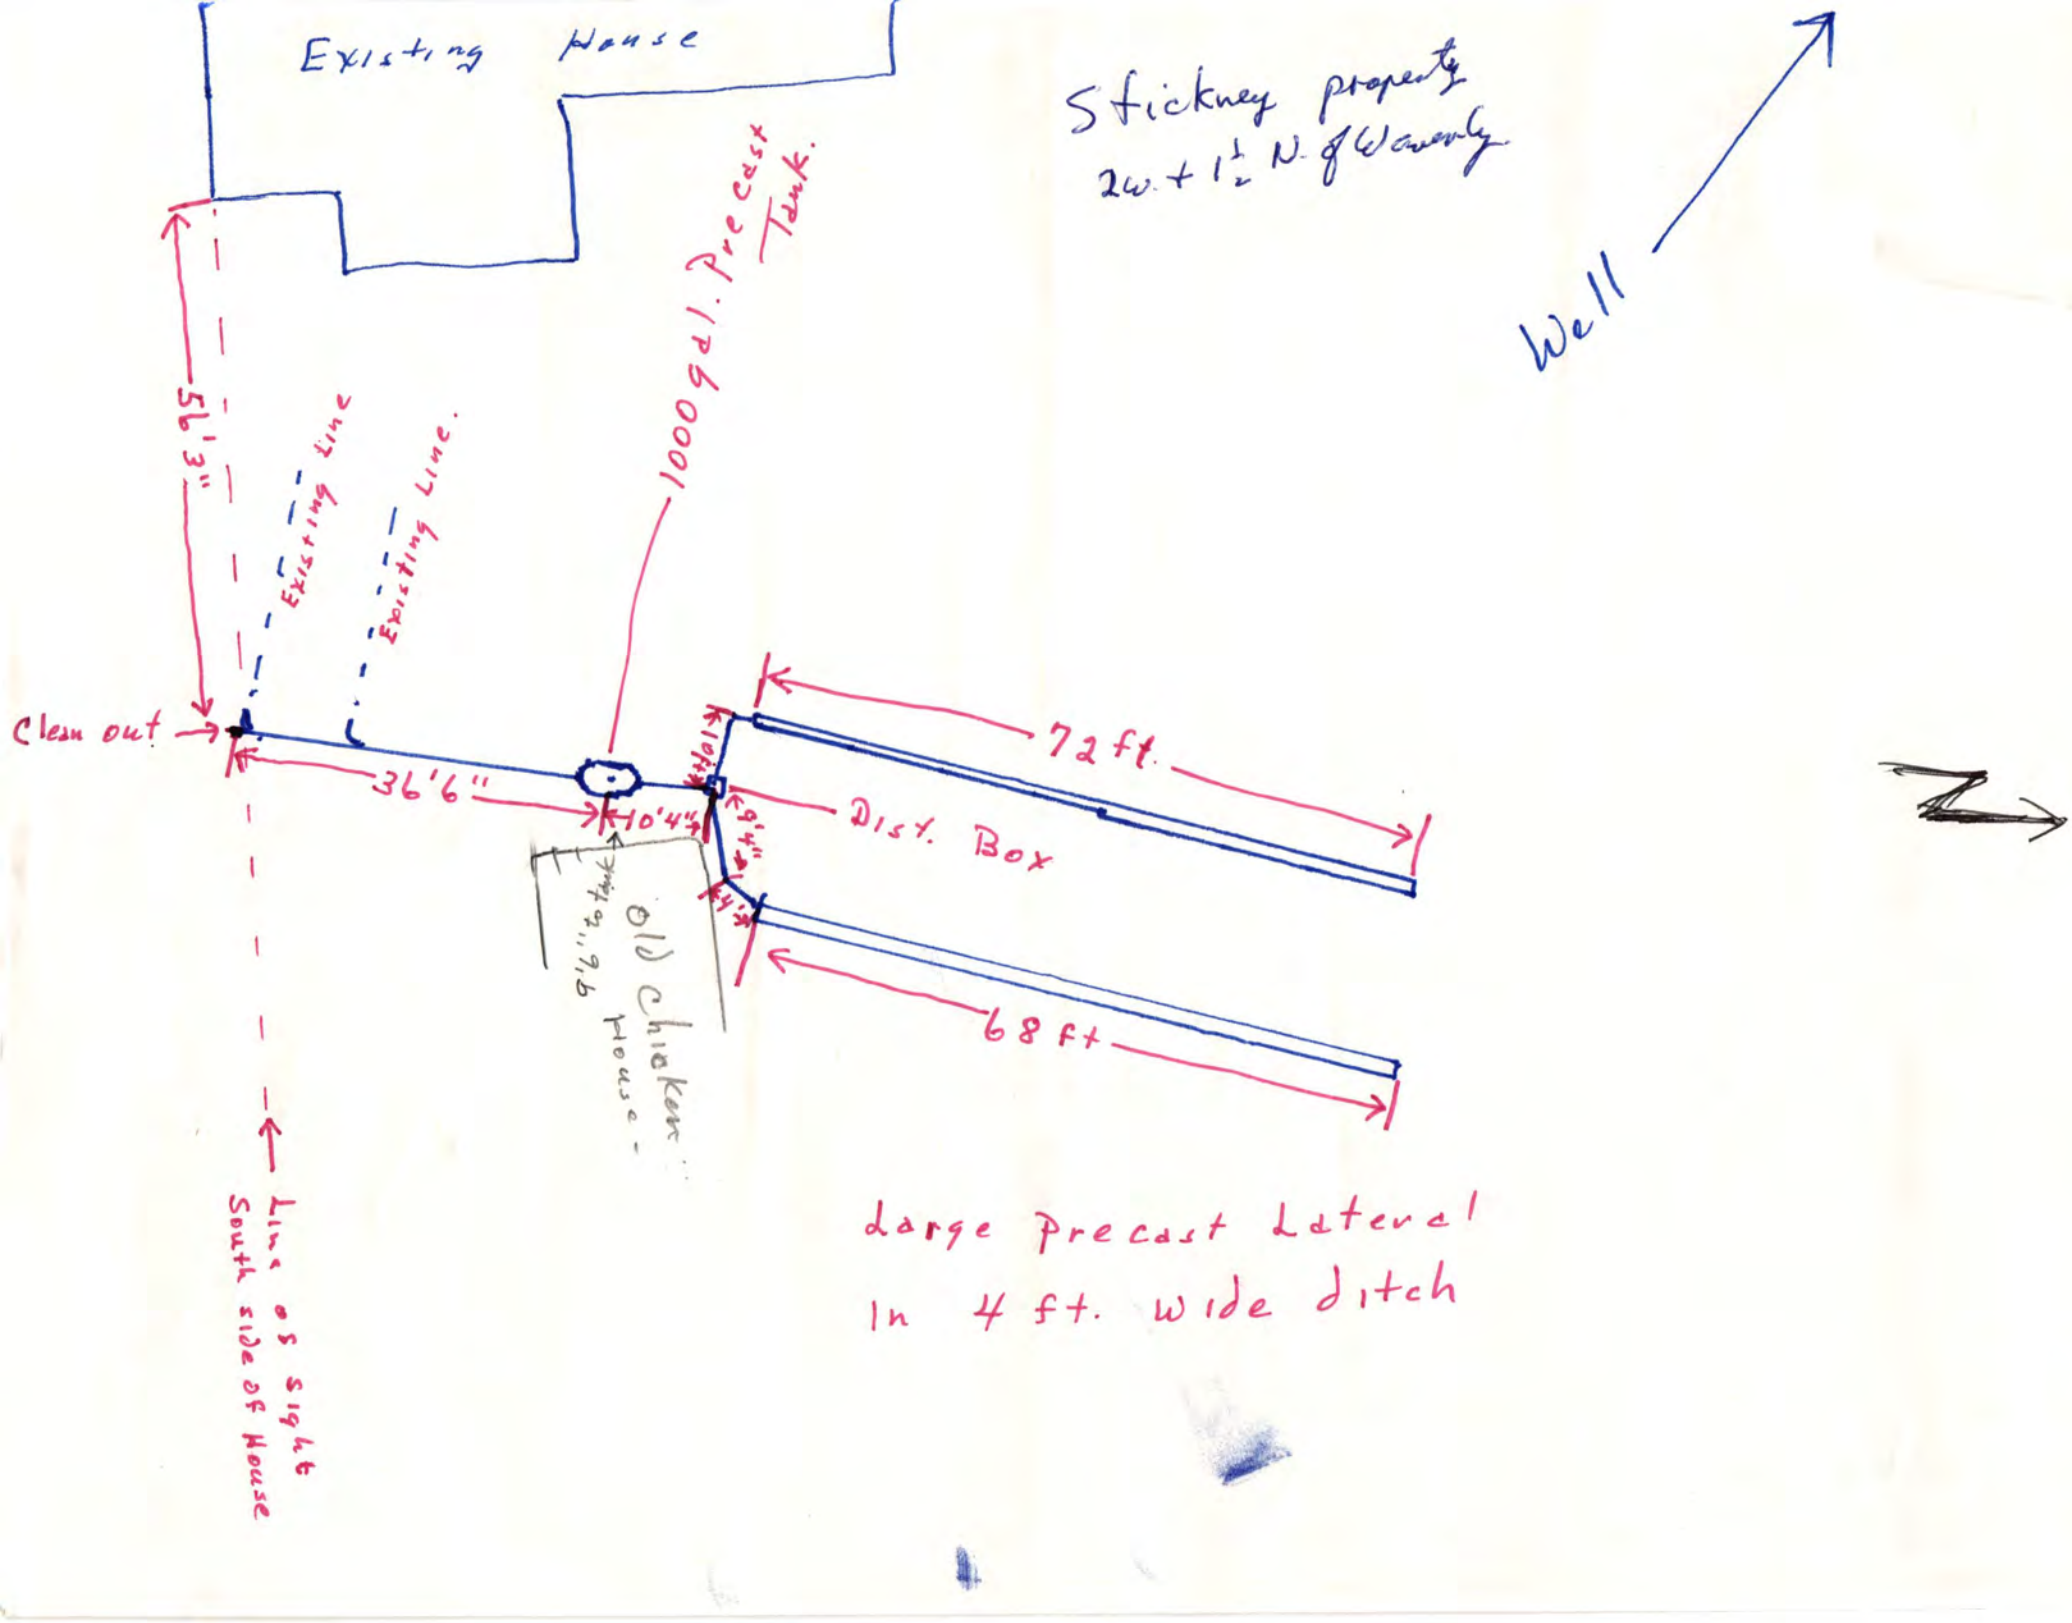

large Precast Lateral
In 4 ft. wide ditch