ILE #2088

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

NDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

NOVEMBER 15, 1984 — THIS LICENSE OR PERMIT EXPIRES

W. SCHINSTOCK, LINCOLN TELEPHONE COMPANY, PO BOX 81309, LINCOLN, NE 68501 — LICENSEE OR PERMITTEE / ADDRESS

10N; R6E; Sec 2; Lot 28 — NAME OF ESTABLISHMENT, IF ANY / ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 60.00	018754	$ 60.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

REC'D MAY 15 1984

FORM 20103-0477
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

A

FILING FEE: $ 60.00

FILE NO. 2088

DATE: May 14, 1984

The undersigned hereby requests SITE CLEARANCE and PERMIT to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. T-10-N; Range R-6-E; Section 2;
   Block X : Lot 28 : Addition _____
   Street Address _____

2. Property Use: Residential ☐ ; Commercial ☒ Other Use ☐
   No. of Bedrooms _____. Describe One present toilet & one future toilet for an unattended bldg. housing telephone equipment

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: unknown ft.

D. W. Schmidt
Signature of Applicant (Owner or Lessee)
The Lincoln Telephone Co.
P.O. Box 81309
Address
Lincoln Nebr. 68501

(Do not write below this double line)

1. Health Department: Date Rec'd. 5/15/84. Date Frwd. 5/16/84. ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood

2. Supt. Bldg. Insp.: or Village Clerk: Date Rec'd 5/16/84. Date Frwd. 5/16/84. ACTION: Approved ☒ Disapproved ☐ Signature: Gary N. Skinner

3. City ~~or County~~ Engineer: Date Rec'd. 5-16-84. Date Frwd. 5-16-84. ACTION: Approved ☒ Disapproved ☐ Signature: [signature]

REMARKS OR REASONS FOR DISAPPROVAL THE SOIL PERCOLATION TEST INDICATES UNACCEPTABLE FOR SEPTIC SYSTEM HOWEVER THE VERY CASUAL USE OF THIS SYSTEM WILL NOT CREATE A PROBLEM UNLESS THE CASUAL USE BECAMES MORE FREQUENT.

Site Visits:
Date: 12-3-84 by: [illegible] (no sewer line in yet)
Date: 12-4-84 by: [illegible]
Date: _____ by: _____

INSTALLATION FINAL WRITTEN APPROVAL
Date: 12-4-84 By: Ron Maynard

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM 20105-0477
SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502
Phone: 471-7800

B

FILE NO. 2088

PROPERTY WHERE SOIL TESTED:

Location: Township T-10-N ; Range R-6-E ; Section & ¼ Section 2 .
Property Dimensions: 511 ft. x 511 ft. Area: 6 acres. (Attach Sheet C with sketch of property).
Soil Type: Silty Clay ☐ ; Silty Clay Loam ☐ ; Sandy Loam ☐ ; Silt Loam ☐ ; Clay Loam ■ .
Dates of Tests: 5-9-84 to 5-10-84 . Weather: Precip. 0 Temp. 79° .

ALL Hole's had Water in From Pre-Test.

OWNER: Daniel W. Schinstock The Lincoln Telephone Co.
Address: P.O. Box 81309 Lincoln, Nebraska 68501 476-5254

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings						Results	
		Start		End		Start			End				
Hold No.	Hole Depth (in.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Date (Mo./ Day)	Time (Hr./ Min.)	Water Level (in.)	Time (Hr./ Day)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./in.)
1	36"	5-9	4:30 pm	5-10	5:00 pm	5-10	5:00 pm	6"	5:30 pm	5 7/8"	30m	1/8"	
2	36"	5-9	4:30 pm	5-10	5:00 pm	5-10	5:00 pm	6"	5:30 pm	5 7/8"	30m	1/8"	
3	36"	5-9	4:30 pm	5-10	5:00 pm	5-10	5:00 pm	6"	5:30 pm	5 7/8"	30m	1/8"	
4	36"	5-9	4:30 pm	5-10	5:00 pm	5-10	5:00 pm	6"	5:30 pm	5 7/8"	30m	1/8"	
5	36"	5-9	4:30 pm	5-10	5:00 pm	5-10	5:00 pm	6"	5:30 pm	5 7/8"	30m	1/8"	
6	36"	5-9	4:30 pm	5-10	5:00 pm	5-10	5:00 pm	6"	5:30 pm	5 7/8"	30m	1/8"	

William M. Hoagland
Signature of Person Conducting Test
Address 2701 N^th 27^th Phone

Sum of Percolation Rates:
Average of Rates:
Mean of Rates:


(Do not write below this line)

REVIEWING ACTION

Remarks: Unsatisfactory for ordinary septic system
Soil Type (SCS): Sharpsburg Silty Clay with Morrill Clay Loam close
Date: May 15, 1984


Approved Percolation Rate (a)
A. 240 min./inch
B. min./inch
C. min./inch

Jerrold C. Hood
Signature of Reviewing Official

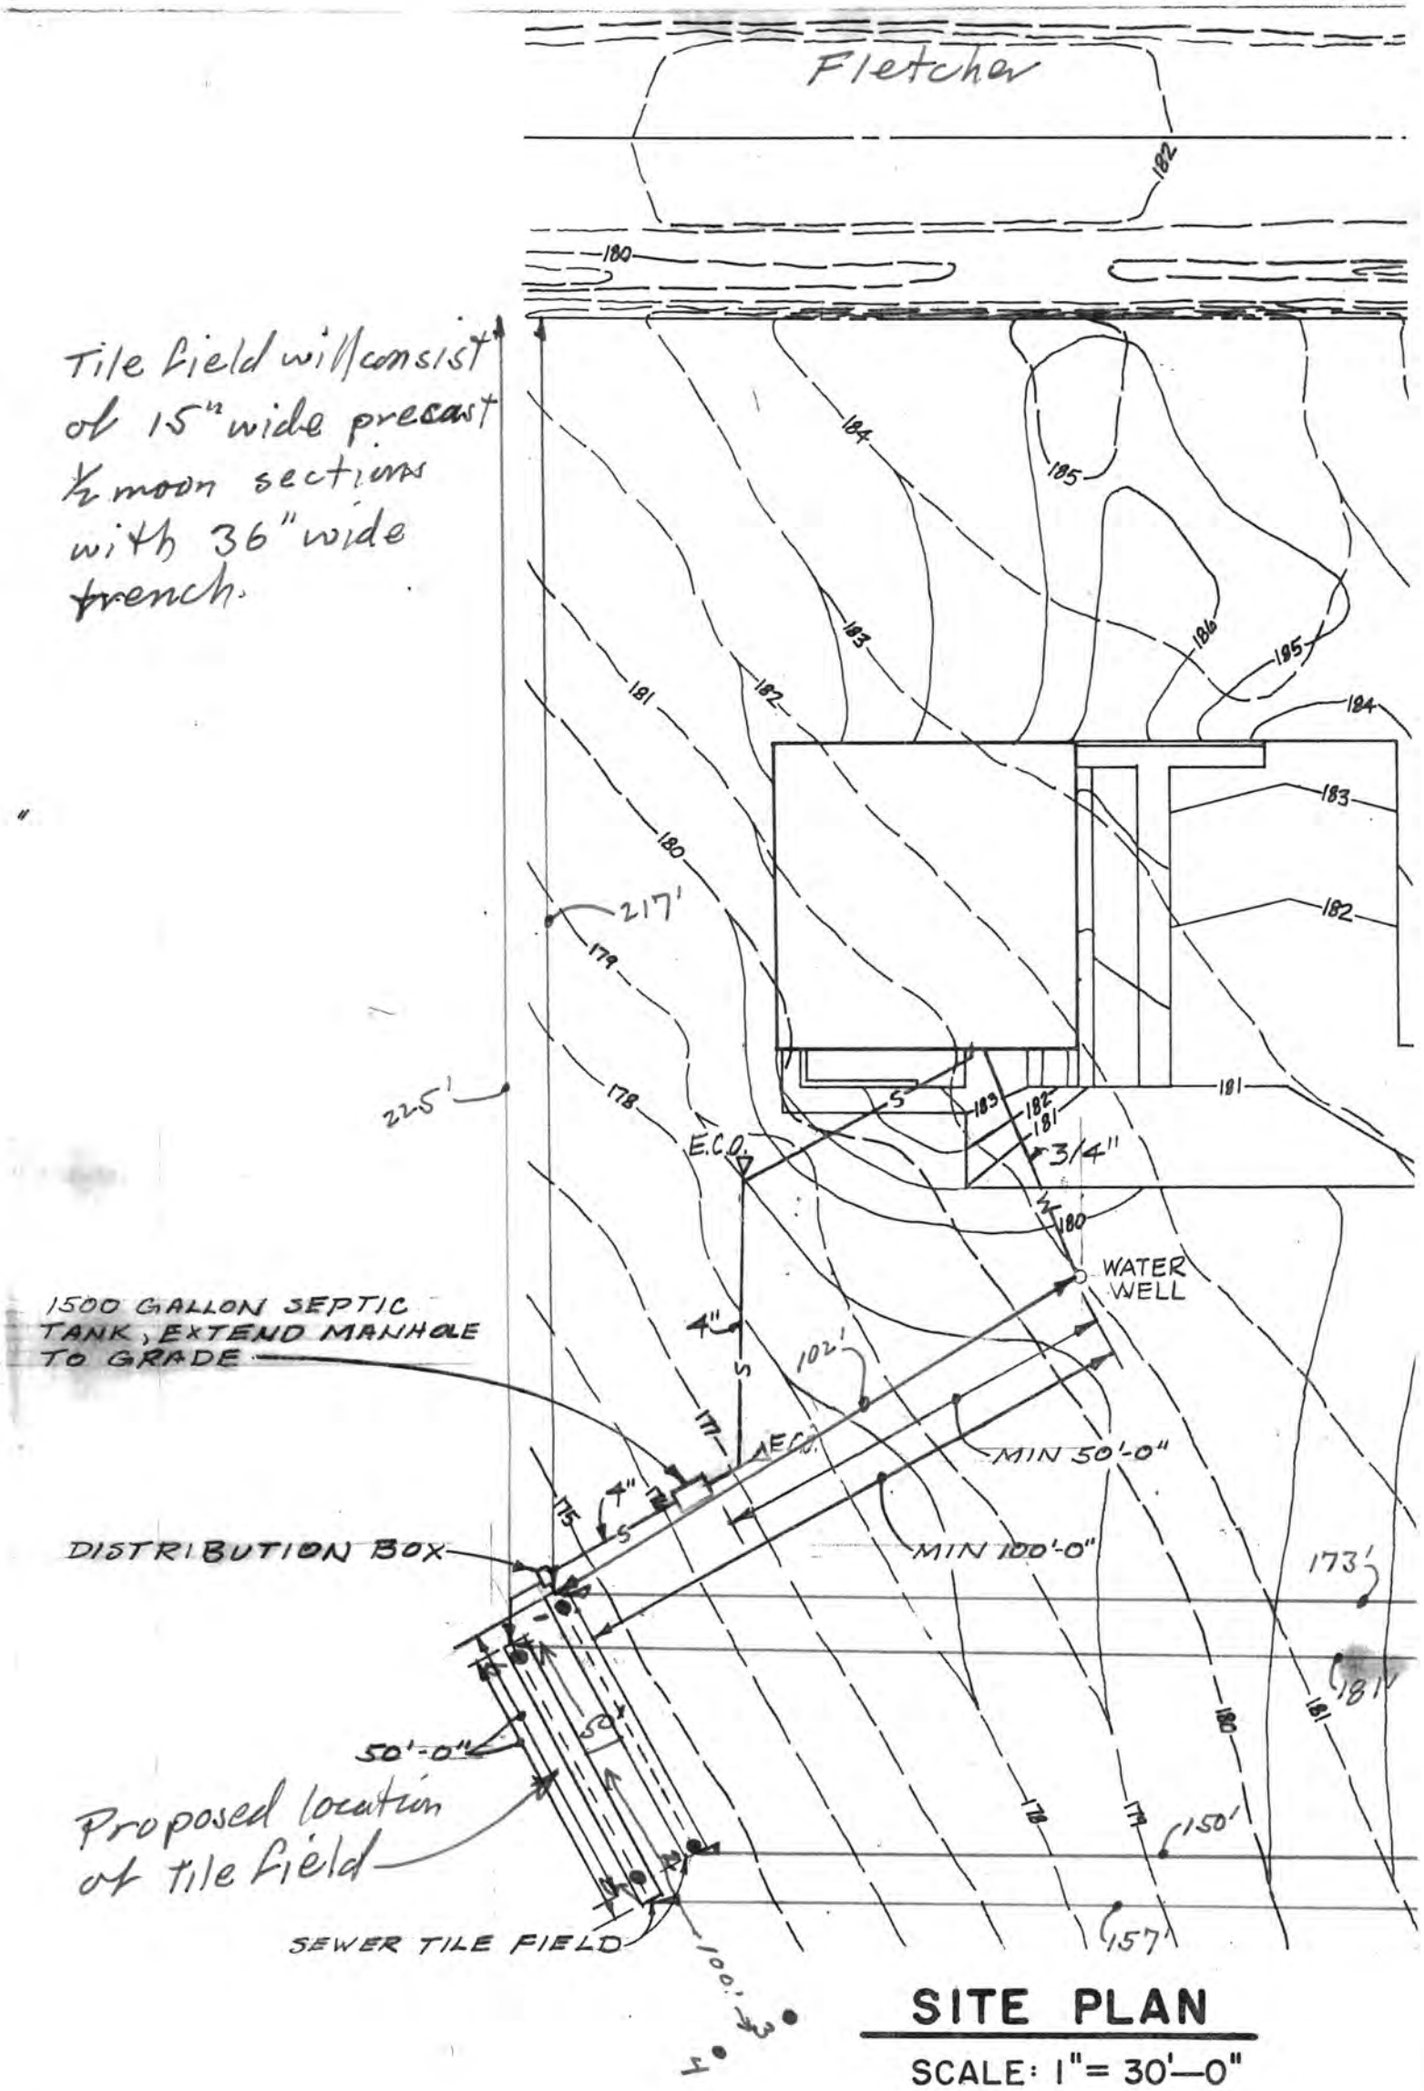

SITE PLAN

SCALE: 1"= 30'—0"

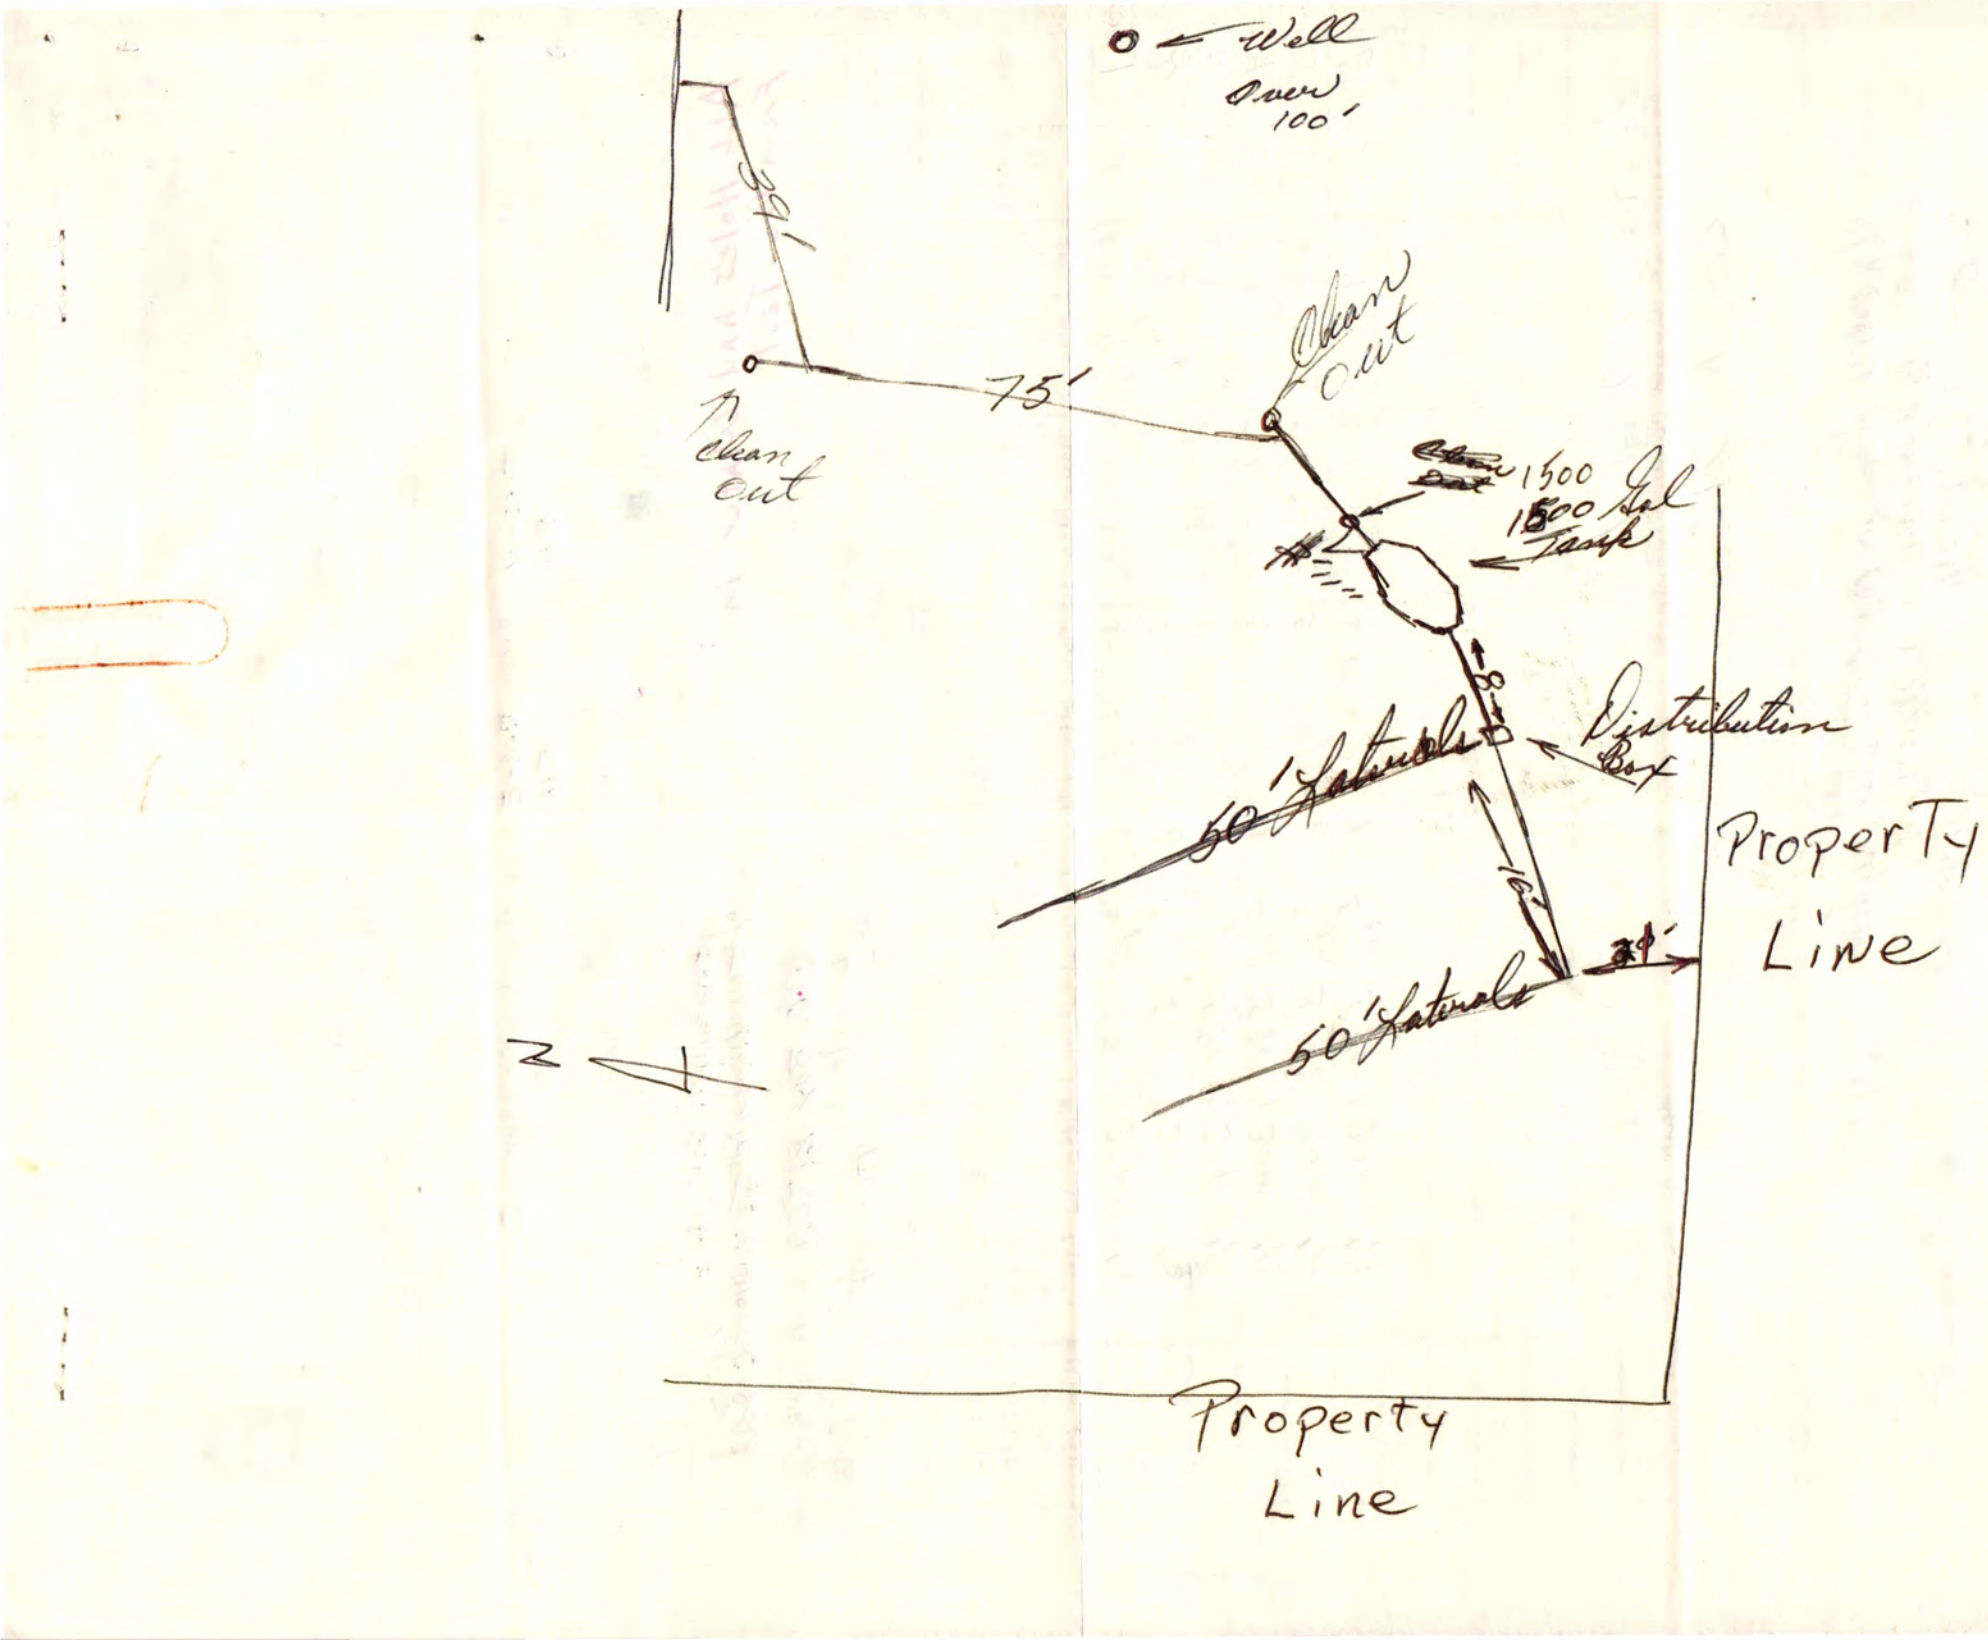
Well
Over 100'
39'
75'
Clean Out
Clean Out
1500 Gal Tank
8-10
Distribution Box
50' Laterals
16'
24'
50' Laterals
Property Line
Property Line

FILE #W-52

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL WATER WELL CONSTRUCTION — NOVEMBER 4, 1984

TYPE OF LICENSE OR PERMIT — THIS LICENSE OR PERMIT EXPIRES

B. W. SCHINSTOCK, LINCOLN TELEPHONE CO., P.O. Box 81309, LINCOLN, NE 68501

LICENSEE OR PERMITTEE — ADDRESS

T10N; R6E; Sec 2; Lot 28 I.T.

NAME OF ESTABLISHMENT, IF ANY — ADDRESS

REMARKS: NON TRANSFERABLE NEW CONSTRUCTION

PERMIT	ACCOUNTING NUMBER	TOTAL
$ 45.00	019851	$ 45.00

Valid Receipt Only if Machine Receipted In This Space

Serial No. — Date and Amount

APPLICATION

HEALTH

ISSUING OFFICER OR DEPARTMENT

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM: 20222-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL

LINCOLN LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN, NEBRASKA 68502
PHONE: 471-7800

FILING FEE $ 45.00

FILE NO. W-52

DATE: _____

The undersigned hereby requests: Site Clearance and Permit to construct a new individual water well ☒ ; Permit existing well ☐ ; well repair or alteration involving opening of well ☐ ; in conformance with appropriate ordinance, as described herein: East 511 ft. of the North 511 ft.

1. Legal description of property: Twp. T-10-N : Range R-6-E : Section 2
   Block X : Lot 28 I.T. Addition _____
2. Well use: Residential ☐ ; Commerical ☒ ; Other Use ☐
   Describe _____
3. Distance to Public Water Supply: _____ Ft. unknown
4. Intended use of well Toilet & drinking water for new bldg to be constructed in 1984

D.W. Schwartzkopf
Signature of Applicant (owner or lessee)
The Lincoln Telephone Co
P.O. Box 81309
Address
Lincoln, Nebr 68501

Sewage Permit Applied For Yes ☐ No ☒ not at present time Not Applicable ☐

1. Health Department: Date Rec'd 5/4/84. Date Frwd. 5/4/84. Action: Approved ☒ Disapproved ☐ Signature: Jerrold C. Hood
2. Supt. Bldg. Insp.: Date Rec'd 5/4/84. Date Frwd. 5/4/84. Action: Approved ☐ Disapproved ☐ Signature: _____
3. City or County Engineers: Date Rec'd 5/4/84. Date Frwd. 5/4/84. Action: Approved ☒ Disapproved ☐ Signature: Jerome D. Morse

REMARKS OR REASONS FOR DISAPPROVAL _____

Site Visits:
Date: 5/8/84 by J.C.H.
Date: 9/9/85 by J.C.H.
Date: _____ by _____

Nitrate Level <0.1 PPM
Bacteriological Analysis Satisfactory
Yes ☒ No ☐

INSTALLATION FINAL WRITTEN APPROVAL
Date: 9/10/85 By: J.C. Hood

Health Department copy: White
Engineers Copy: Light Green
Building Inspectors Copy: Light Blue

3-13

FORM: 20223-0483
REQUEST FOR SITE CLEARANCE AND PERMIT
FOR INDIVIDUAL WATER WELL
CITY ORDINANCE NO. 13558
FILE NO. W-52

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
DIVISION OF ENVIRONMENTAL HEALTH
2200 ST. MARYS AVENUE
LINCOLN NE 68502
Phone: 471-7800

DATA SHEET FOR WATER WELLS

Legal Description: Sec. 2 T. T-10-R R. R-6-E Block X Lot 28 I.T. Addition

Owner The Lincoln Telephone Co Address P.O. Box 81309, Lincoln, Nebr. 68501 Attn. D.W. Schinstock

LOG OF WELL	
Depth Ft. to	Description
0 - 1	Topsoil
1 - 4	Clay Brown
4 - 38	Clay tan & brown
38 - 130	Clay Blue
130 - 168	Clay blue & silty blue
168 - 175	Silt and Silty fine sand
175 - 184	Sand fine to medium Blue

WELL COMPLETION RECORD

Drilling Method: Water Rotary
Depth (from ground level), Ft. 183
Date Completed april 28, 1984

Casing: Length, Ft. 178 ; Dia. In. 4
Wall Thickness, Inc. 200 ; type PVC

Screen: Length, Ft. 5 Dia. In. 4
Type Johnson , slot Size 18

Drop Pipe: Length, Ft. 160 Dia. In. 1¼

Water Level, Surface to top of water, Ft.:
Static 133 , Pumping 155

Yield: 8 ggm, Measured ☐ , Est. ☒
Chlorination Completed Yes ☒ No ☐

The above information including "Log of Well" is a true record of the job performed by me.

Driller Richard Hedges (Signed)

Address R+6 Lincoln


Date may 3, 1984

REMARKS

DO NOT WRITE BELOW THIS DOUBLE LINE

Health Department forwarded copy of record to Nebraska Conservation and Survey Department for Scientific Record ☒

FORM 23-4

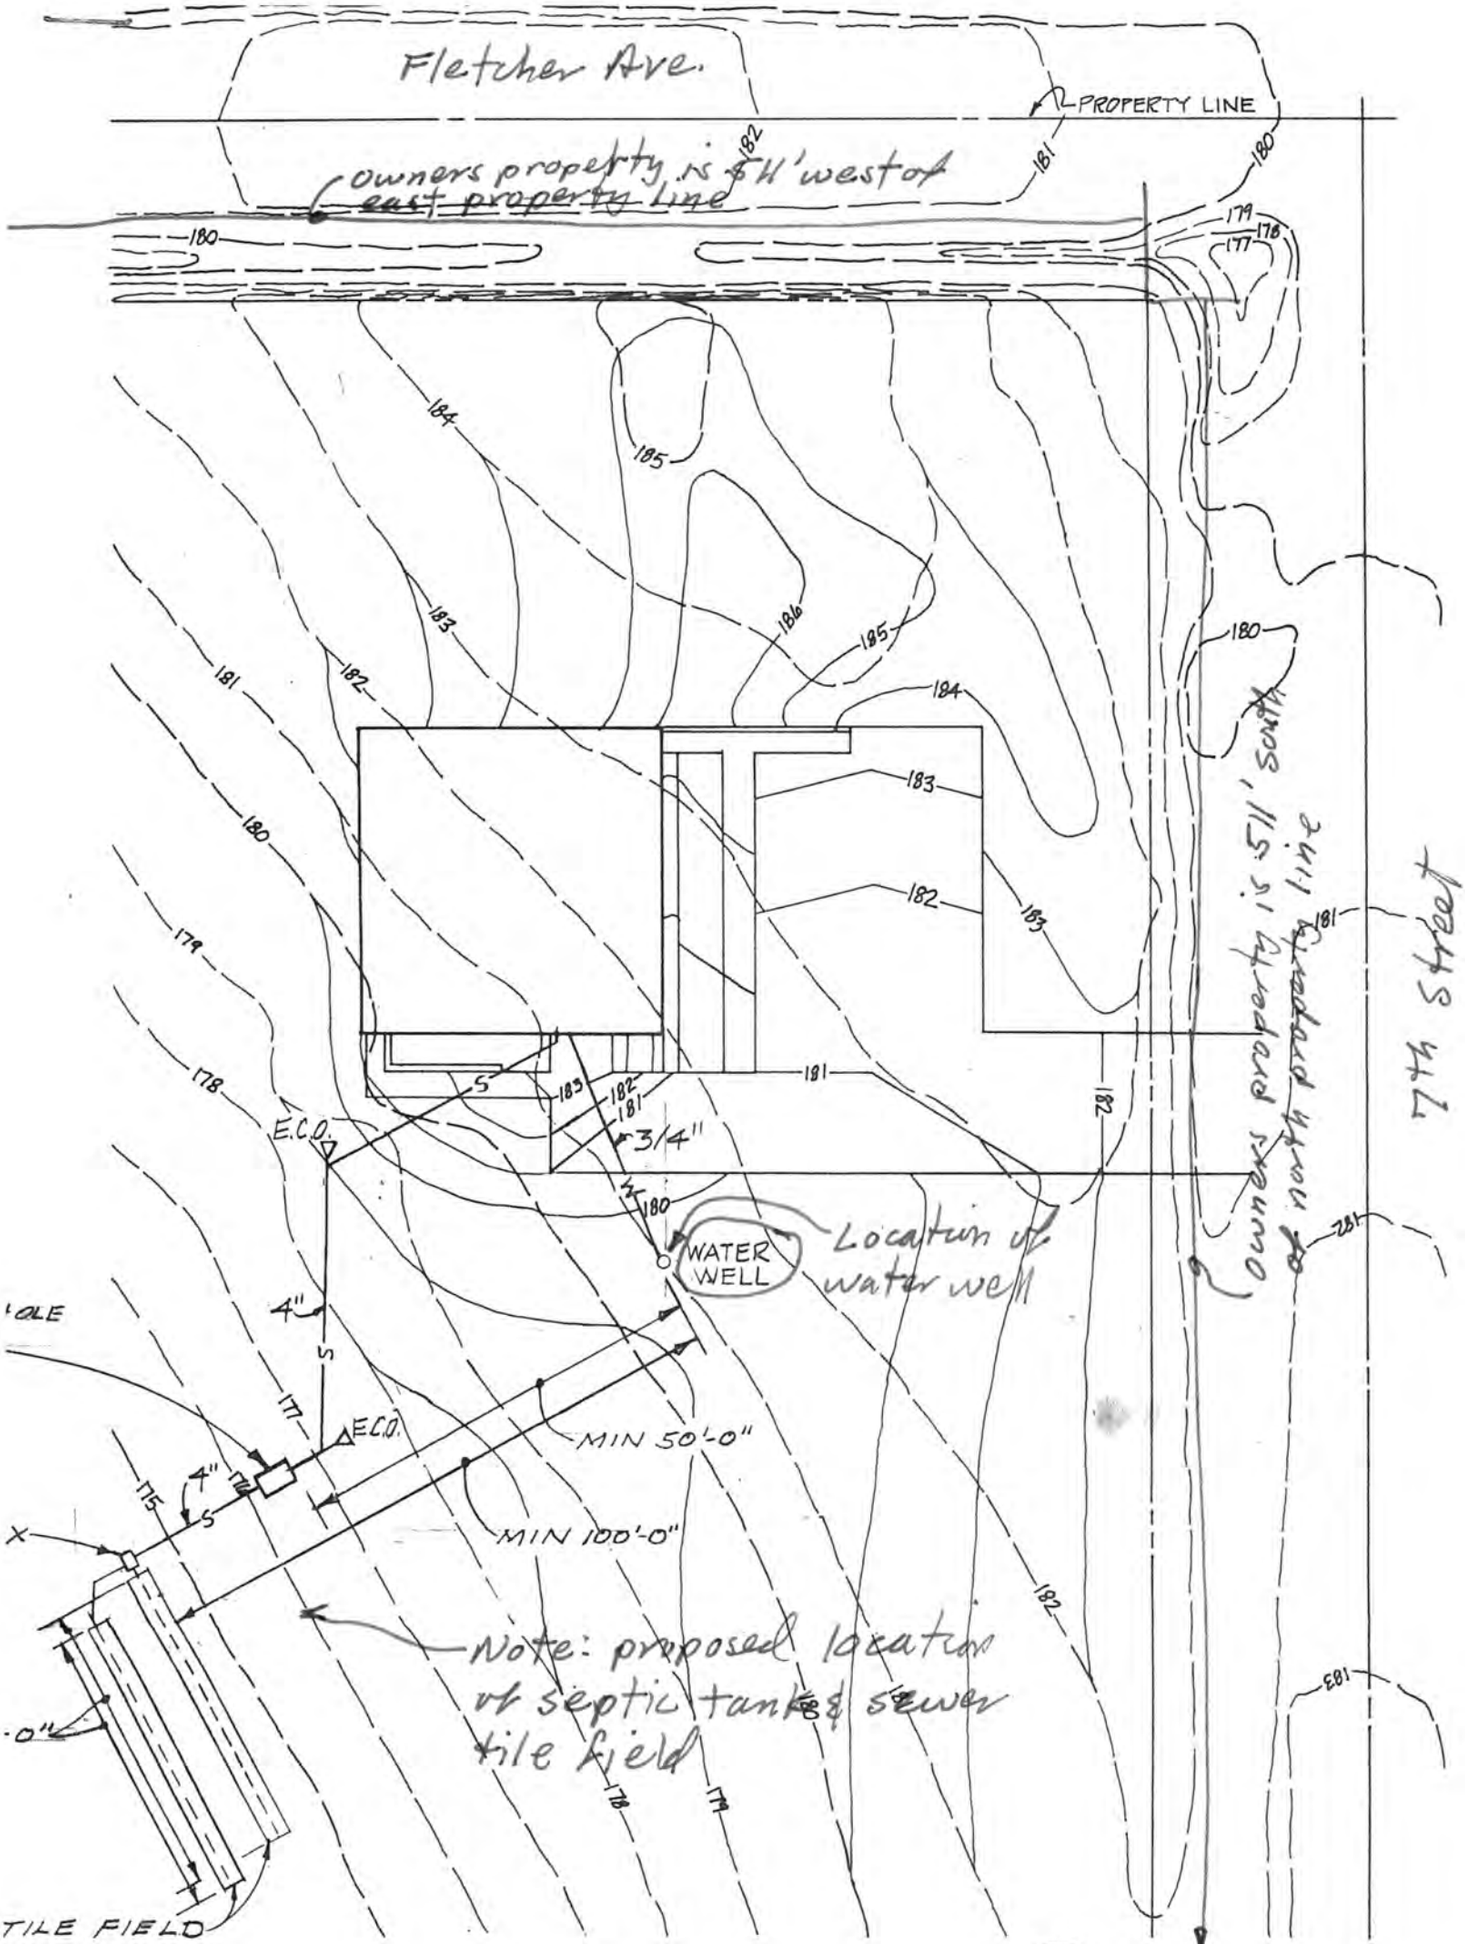

SITE PLAN

SCALE: 1"= 30'—0"