FILE NO. 351

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

February 20, 1974 — THIS LICENSE OR PERMIT EXPIRES

City Parks Department — LICENSEE OR PERMITTEE

2740 "A" Street — ADDRESS

T10N; R6E; Sec. 11-NW1/4; Lot 48 I. T.

NAME OF ESTABLISHMENT, IF ANY — LEGAL DESCRIPTION — ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ No Fee	$	$	$	$ No Fee

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624-5535 110.15	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT
	2/20/73	

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

INTERSTATE PARK RESTROOM

FILE NO. 351

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 6E; Section 11-NW¼;
Block —; Lot 48 I.T.; Addition —;
Street Address — (3rd & Fairfield).

2. Property Use: Residential ____ ☐; Commercial ____ ☐
No. of Bedrooms ____. Describe: ____

Other Use ____ ☒
Describe: PUBLIC PARK USE

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: 1900 ft.

John H Schwers
Signature of Applicant (owner or lessee)

2740 'A' ST. - LINCOLN
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 8/17/73. ACTION: Approved ☒ Disapproved ☐
Date Frwd. 8/20/73. Signature: Gerrald C. Hoak

2. Supt. Bldg. Insp.: Date Rec'd. 8-20-73. ACTION: Approved ☑ Disapproved ☐
Date Frwd. ____. Signature: Charles Seale By RS

3. City Engineer: Date Rec'd. 8/20/73. ACTION: Approved ☒ Disapproved ☐
Date Frwd. ____. Signature: R. Rex Smith

REMARKS OR REASONS FOR DISAPPROVAL ____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: ____ Signature ____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

INTERSTATE PARK RESTROOM

FILE NO. 351

DATE: July 16, 1973

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10N; Range 6E; Section 11-NW¼;
Block —; Lot 48 I.T.; Addition —;
Street Address —.

2. Property Use: Residential ____ ☐; Commercial ____ ☐
No. of Bed Rooms ____ Describe: ____

Other Use ____ ☒
Describe: PUBLIC PARK USE.

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

John H Schweers
Signature of Applicant (owner or lessee)

2740 'A' ST. — LINCOLN
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: ____
Filing Fee: $ No Fee

2. Date Site Clearance ____

3. Site Visits:
Date: ____ by: ____
Date: ____ by: ____
Date: ____ by: ____

4. Date: Approved ☒; Disapproved ☐: 8/20/73
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: ____
Date Issued: ____ Serial ____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: ____ by: ____

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

INTERSTATE PARK

FILE NO. 351

PROPERTY WHERE SOIL TESTED:
Location: Township 10 N, R6E
Section & ¼ Sect. 11-NW¼
Property Dimensions: ____ ft. x ____ ft.
TOTAL Area: 103.0 acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☑
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☑

Owner: LINCOLN PARKS & REC. DEPT.
Address 2740 'A' ST. LINCOLN, NB.

Dates of Tests: 4/11/73 to 4/12/73. Weather: Precip. 0 Temp. 43°F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	21"	4/11	10:00	4/12	8:45	4/12	9:34	26	9:44	26½	10	½	20
2	12"	4/11	10:00	4/12	8:45	4/12	9:54	13¾	10:18	14⅜	24	⅝	38.4
3	17"	4/11	10:00	4/12	8:45	4/12	9:45	19⅜	9:55	19⅝	10	¼	40
4	14"	4/11	10:00	4/12	8:45	4/12	9:40	14⅛	9:50	16½	10	1⅝	6.7
5	18"	4/11	10:00	4/12	8:45	4/12	9:56	17¾	10:15	18¼	19	½	38
6	19"	4/11	10:00	4/12	8:45	4/12	9:38	17⅛	9:48	18¼	10	⅜	26.7

Sum of Percolation Rates 169.8
Average of Rates: 28.3
Mean of Rates: 23.4

John R. Amund JRA
Signature of Person Conducting Test

Address 2740 'A' ST. LINCOLN, NB.
Phone: 475-6734 EXT. 35

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

DATE: _____

_____
Signature of Reviewing Official

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

Interstate Park

FILE NO. 351

SPECIFICATIONS

DATE: 7/20/73


A. BUILDING SEWER:
1. Material Cast Iron; Diameter 4 in.
2. Distance above basement floor — in.; or below ~~basement~~ Finished floor 30 in.
3. Distance between dwelling and septic tank 50 ft.
4. Number of clean-outs 1.
5. Distances To:
Well or Suction Line — ft.;
Stream 200 ft.; Pressure Line — ft.;
Property Line 180 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Conc.; No. of compartments ~~two~~ 1.
2. Capacity 1,000 gals.; Liquid depth 47 in.
3. Factory Built: Yes ☒ (Company _____)
No ☐
4. Manholes: Over Inlet; diam. 9 in.
Over Outlet; diam. 9 in.
Below Grade 12 in.
5. Inlet: Baffle ☐; or Tee ☒
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet 1 in.
7. Depth of top of tank below finished grade 12 in.
8. Distances To:
Well or Suction Line — ft.;
Stream 160 ft.; Pressure Line — ft.;
Property Line 180 ft.

C. DISTRIBUTION BOX
1. Material Conc; No. available outlets 2.
2. Factory Built: Yes ☐, (Company _____)
No ☒
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in. As Reqd.
4. Distance from Septic Tank 5 ft.
5. Serial Distribution: Yes ☐, No ☒
(If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: Horizontal
2. Lateral Lines: Depth below grade 24 in.
Number 2; Length of each line 100 ft
Total length of Laterals 160 ft.;
Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape Half-Round
Material: concrete ☒; fiber asbestos ☐; clay ☐; other _____
Distance between lateral lines ___ ft.
3. Trench Dimensions: Depth 34 in.; Width 48 in.
4. Filter Material: 1/4" to 1 1/2" S&G.
Depth of material from trench bottom 22 in.
5. Distances To:
Well or Suction Line — ft.;
Stream 150 ft.; Pressure Line — ft.
Property Line 120 ft.
6. Percolation Rate: ~~120~~ 28.3 minutes/inch

TYPICAL SKETCHES

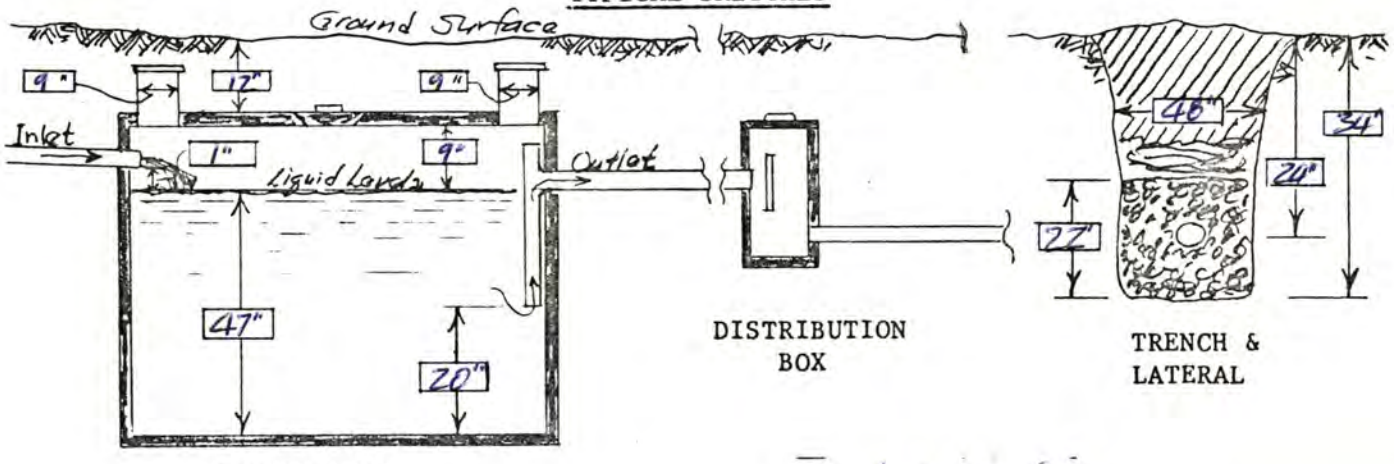


SEPTIC TANK

DISTRIBUTION BOX

TRENCH & LATERAL

John H. Schweers
Signature of Applicant

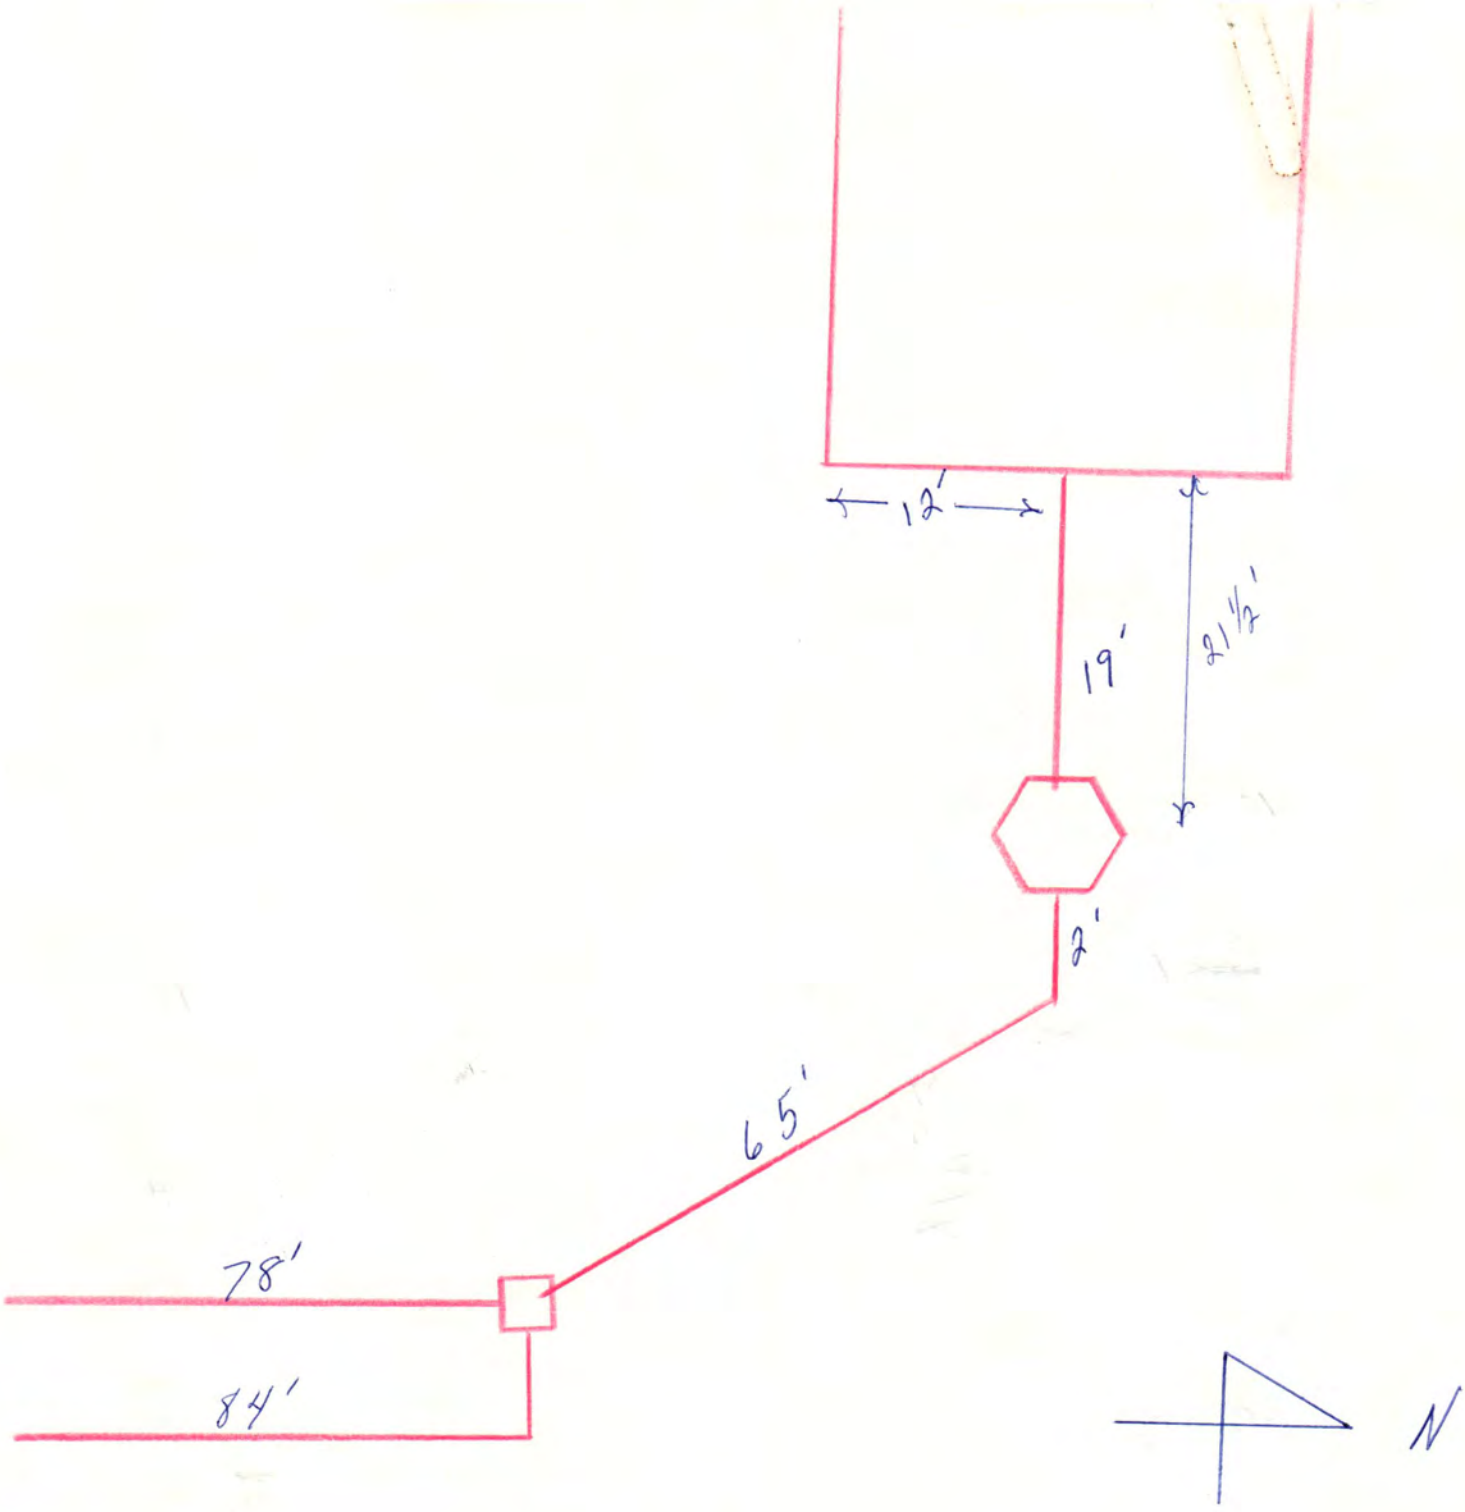

jw 4-26-74