LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 ST. MARYS
LINCOLN, NEBRASKA 68502

FILE NO. 1888-C

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF PERMIT

DECEMBER 14, 1982
THIS PERMIT EXPIRES

DON DIXON WAVERLY NE
ISSUED TO ADDRESS

T11N, R8E, SECTION 4, ADDITION: N.E.¼ OF NW ¼
LEGAL DESCRIPTION

REMARKS: NONTRANSFERABLE EXTENSION

PERMIT	INSPECTION FEE	OCCUPATION TAX	TOTAL
$ 30.00	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
	110.16	148.14	6-2

RECEIPTED BY DATE AMOUNT

VALID RECEIPT ONLY IF RECEIPTED IN THIS SPACE

HEALTH
ISSUING OFFICER

THIS PERMIT IS ISSUED AS PROVIDED BY COUNTY RESOLUTION NO. 2382

20109-0977

FORM HD-41(73) APPLICATION FOR PERMIT TO ALTER, EXTEND OR REPAIR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☐
County Resolution No. 2832 ☒

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Ave.
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 1888-C

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 6-14-82

The undersigned hereby applies for a permit to ALTER ☐, EXTEND ☒, or REPAIR ☐ an existing Individual Sewage Disposal System, in conformance with appropriate Ordinance or Resolution, as described in this application and drawings attached hereto.

1. Legal description of property: Twp. 11N ; Range 8E ; Section 4 ;
Block _____ ; Lot _____ ; Addition N.E. Quarter of N.W. Quarter
Street Address 14 1st. and Raymond Road

2. Property Use: Residential X ☐; Commercial _____ ☐
No. Bedrooms 3
Describe _____
Other Use ☐
Describe _____

3. Type of existing Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Description of proposed alteration, extension or repair: New septic tank
Replacement + 200' Extend

5. Work to be done by: Owner ☐ ; or Contractor ☒, Waverly Lbly-Well Co.
Contractor's Name

6. Estimated cost of project:

a. Materials	$
b. Labor	$
c. Other	$
TOTAL	$2,000

Ernie Dietz for Don Dixon
Signature of Applicant (owner or lessee)

Waverly, Nebraska
Address

(Do not write below this line)

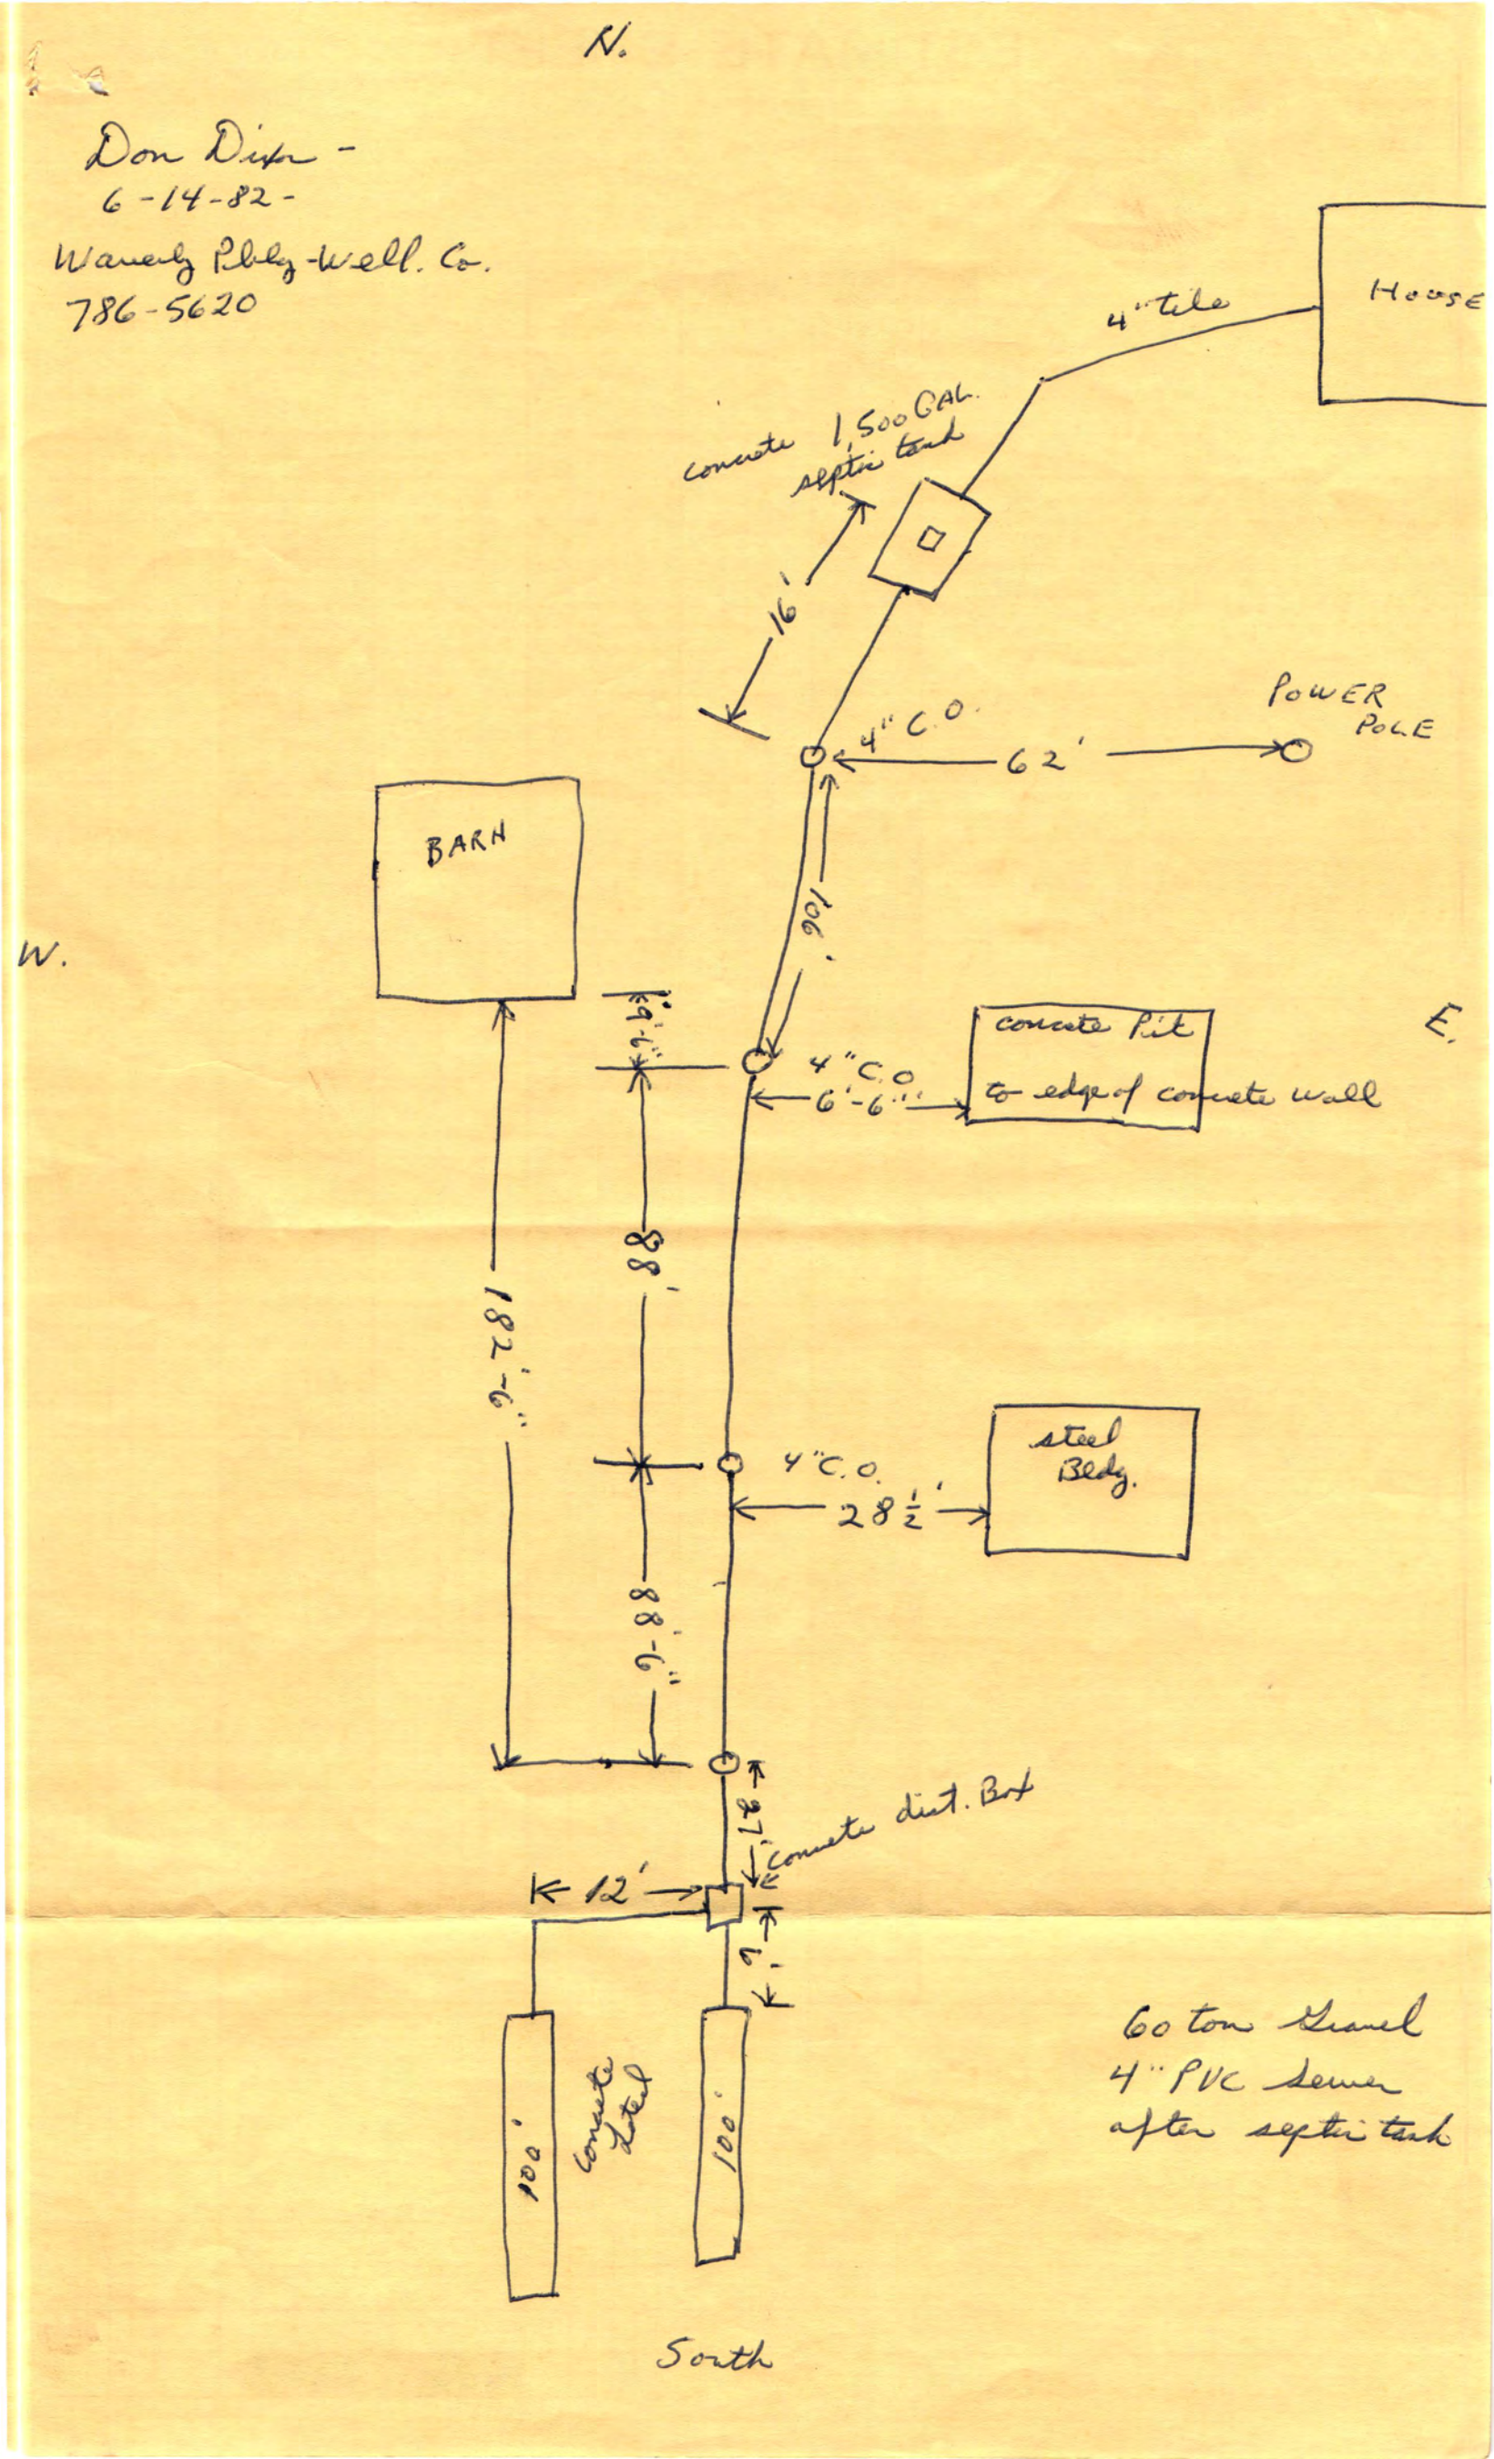
REVIEWING ACTION

1. Date Rec'd: 6-14-82
Filing Fee: $ 30.00

2. Site Visits:
Date: 6-14-82 by: DM
Date: _____ by: _____
Date: _____ by: _____

3. Date: Approved ☒; Disapproved ☐
by: Ron Maynard

4. INSTALLATION FINAL WRITTEN APPROVAL
Date: 6-14-82 by: Ron Maynard


N.
Don Dixon -
6-14-82-
Waverly Bldg-Well. Co.
786-5620
4" tile
House
concrete 1,500 GAL. septic tank
16'
4" C.O.
62'
POWER POLE
BARN
W.
90'
E.
6'-6"
4" C.O.
6'-6"
concrete Pit
to edge of concrete wall
88'
182'-6"
steel Bldg.
4" C.O.
28½'
88'-6"
7'
concrete dist. Box
12'
4'
100'
concrete Lead
100'
60 ton Gravel
4" PVC Sewer
after septic tank
South