Lincoln-Lancaster County Health Department

ENVIRONMENTAL HEALTH DIVISION
3140 N STREET · LINCOLN, NE 68510-1514 (402) 441-8000

Permit

SEWAGE SYSTEM REPAIR
SEWER REPAIR

Establishment

PAT BOWMAN
T10N R6E SEC 19
801 NW 40 ST

Permitee

PAT BOWMAN
BOX0000065
BOX 0000065
BRUNING NE 68322-0065

Permit # 99390063201

Issued 09/03/99
Expires 03/03/00
Revenue Code 3157

FEES: $50.00

TOTAL: $50.00

Leon F. Vinci, MPH, Health Director

• POST IN A PROMINENT PLACE • NOT TRANSFERABLE

010909

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

"REPAIR"

A

Permit Number: 99390063 2

Sewage Disposal System

Request for Site Clearance and Permit

Include Form B, Form C and Applicable Fees with this Application.

☑ Septic System ☐ Lagoon ☐ Other (Refer to Form C)

The undersigned hereby requests site clearance and permit to construct a Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

PLEASE PRINT OR TYPE

A. System Location (Indicate correct number and street)

Address 801 NW 40th (no rural route) City Lincoln NE, Zip

Legal Description 1/4 1/4 Section 19 Township 10N Range 6E Subdivision Addition Block Lot

Geographical Location (if known): Longitude Latitude

☐ Check if system mail address is not the same as the owner's address

B. Owner

Name Pat Bowman Signature

Address Box 65 City/State/Zip Bruning, NE 68322

☐ Check if owner designed system Home Phone Work Phone

C. Contractor

Name Larry Schwarck Company Name Schwarck Trenching

Address City/State/Zip

☒ Check if contractor designed system Work Phone

D. Engineer/Installer ☐ Check and complete if engineer designed system

Designer Name Firm Work Phone

E. This System Will Serve a

☒ Residential Dwelling Number of Bedrooms 3 Is there a Whirlpool Bathtub YES NO

☐ Commercial Establishment/Other Facility Specify

Design flow in gallons per day Type of Wastewater: ☒ Domestic ☐ Non-Domestic.

DO NOT WRITE BELOW THIS LINE

Approval Process ☒ Municipal Code 24.38 ☐ County Resolution No. 2832

1. Health Department	Date rec'd 9-1-99	ACTION ☒ Approved	☐ Disapproved
	Date frwd	Signature Paul Ottaman	
2. Supt. Bldg. Insp. or Village Clerk	Date rec'd	ACTION ☐ Approved	☐ Disapproved
	Date frwd	Signature N/A	
3. City or County Engineer	Date rec'd	ACTION ☐ Approved	☐ Disapproved
	Date frwd	Signature N/A	

Installation Final Written Approval

By Paul Ottaman

Date 9-3-99

Business Office Use Only

Date Rec'd 09/03/99 REPAIR

Amt Paid 50.00

Rec'd By LS ~~Cash~~/Check No. 2165

FORM 23-100 10-96 White - Health Dept. Yellow - Engineer Pink - Bldg. Inspector

Lincoln-Lancaster County Health Department
Environmental Health Division
3140 "N" Street • Lincoln, NE 68510-1514
Phone: 402-441-8022

D

Permit Number: 99390063 2

Sewage Disposal System

As Built Plans & Specifications

Date 9-1-99

System Location (Indicate correct number and street)

Address 801 NW 40th (no rural route) City LINCOLN NE, Zip 68524

A. Building Sewer

1. Material: _____
   Diameter: _____ in.
2. Distance above basement floor: _____ in.
   or distance below basement floor: _____ in.
3. Distance between dwelling and septic tank: _____ ft.
4. Number of clean-outs: _____
5. Distances to: well or suction line _____ ft.
   stream _____ ft.
   pressure line _____ ft.
   property line _____ ft.

B. Septic Tank

1. Material: _____
   Number of compartments: _____
2. Capacity: _____ gal.
3. Factory built: ☐ Yes ☐ No
4. Manholes: Over inlet, diameter _____ in.
   Over outlet, diameter _____ in.
   Riser: ☐ above ☐ below grade _____ in.
5. Inlet: ☐ baffle ☐ tee
6. Outlet: ☐ baffle ☐ tee
7. Depth to top of tank, below unfinished grade: _____ in.
8. Distances to: Well or suction line _____ ft.
   Stream _____ ft.
   Pressure line _____ ft.
   Property line _____ ft.

C. Distribution Box

1. Material: 3 Plastic Drop Boxes
   Number available outlets: _____
2. Factory built: ☑ Yes ☐ No
3. Distance from septic tank: _____ ft.

D. Absorption Field


(Provide as-built drawings on back of this form)

1. Type: ☐ Half rounds ☑ Perforated pipe
   Diameter of half round: _____
   or perforated pipe: _____
   Material: ☐ fiberglass ☑ plastic ☐ concrete
   ☐ other _____
2. Lateral lines: Number 3
   Length of each line: 100 ft. 100 ft.
   100 ft. _____ ft., _____ ft.
3. Trench dimensions: Width 3 ft.
   Slope 3 in/100 ft.
   Average depth 28 in
4. Filter material: Road Gravel
   Depth of material 15 in.
5. Distances to: Well or suction line _____ ft.
   Stream _____ ft.
   Pressure line _____ ft.
   Property line _____ ft.

Indicate North with Arrow

Complete "As Built" drawing on back of this form.


Individual Sewage System Design (Example)

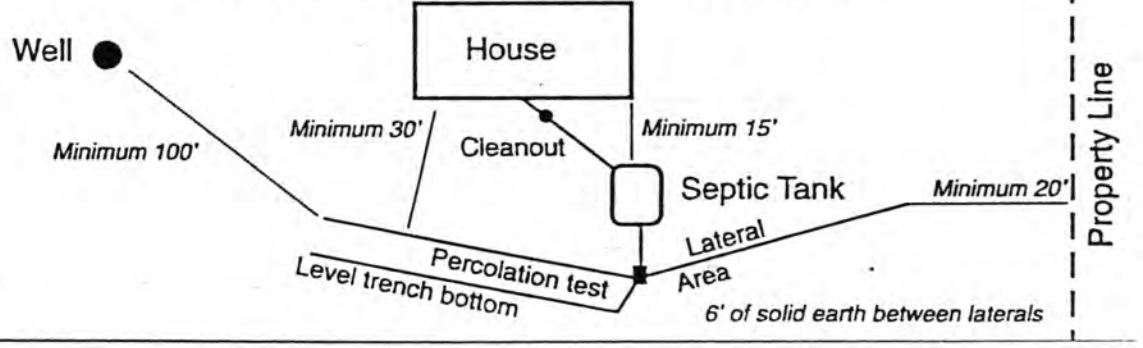

FORM 23-103 10-96

As Built Drawing by Larry Schwark

9-1-99 add 300' perf. pipe lateral

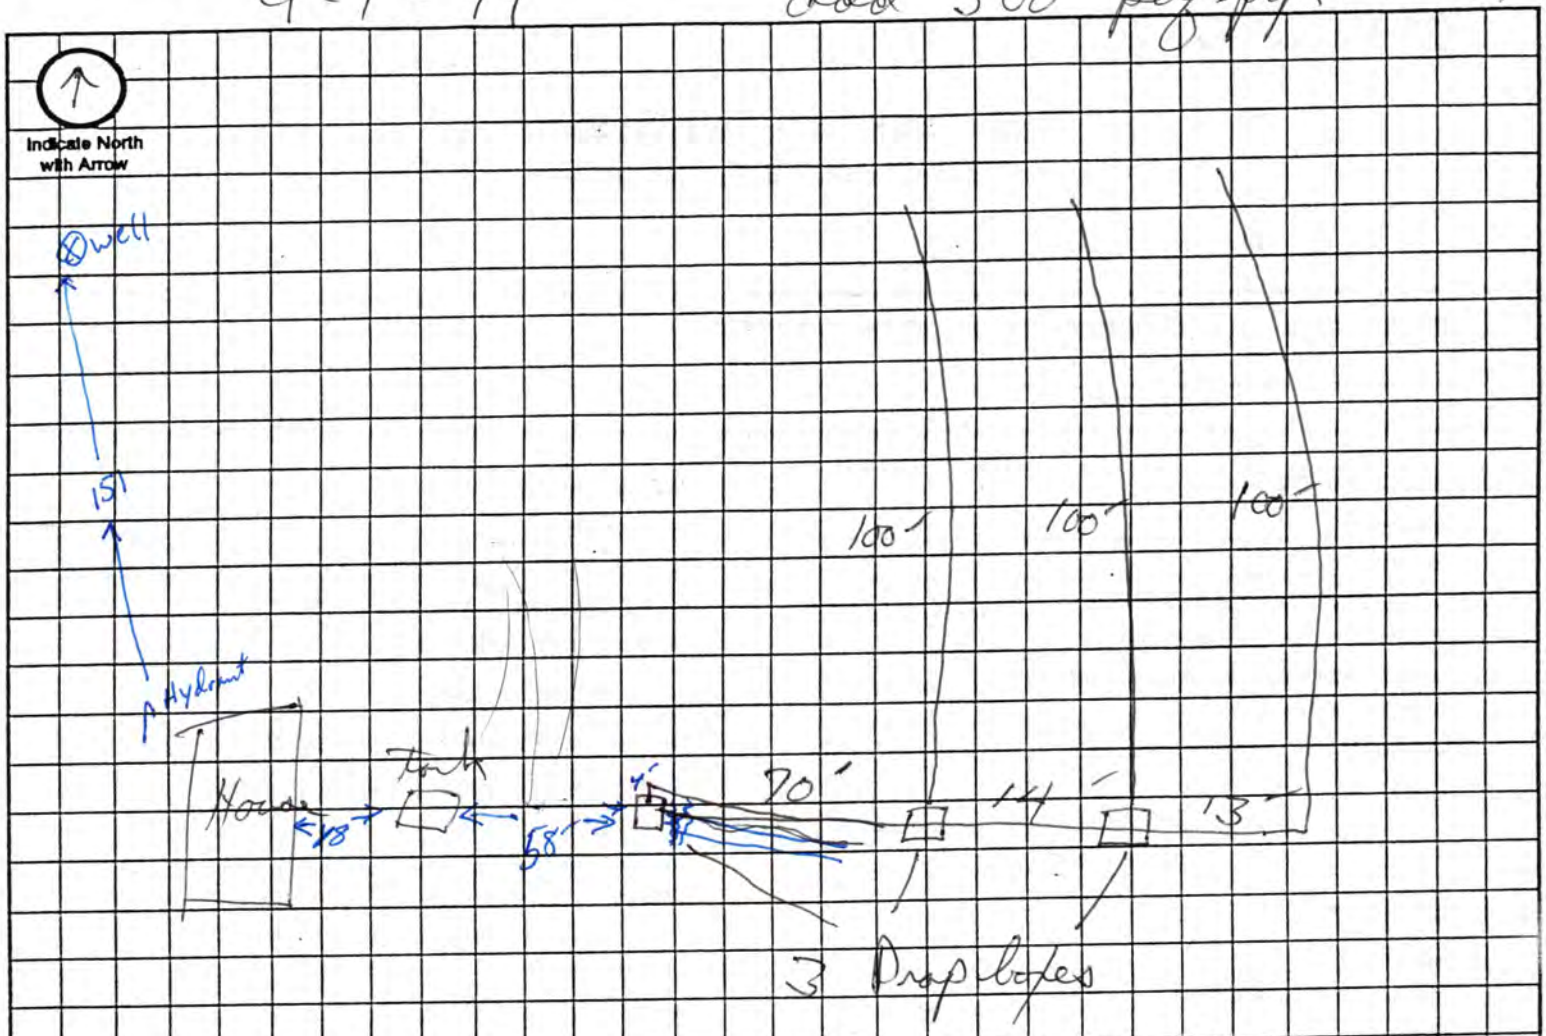

Approximate Scale: _____ ft. = _____ grid line/s