FILE NO. 634

CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION — TYPE OF LICENSE OR PERMIT

December 4, 1975 — THIS LICENSE OR PERMIT EXPIRES

Roger C. Patterson — LICENSEE OR PERMITTEE

Route #3, Lincoln, Nebr. 68505 — ADDRESS

T11N; R7E; Sec. 35-NE¼; — NAME OF ESTABLISHMENT, IF ANY

ADDRESS

REMARKS: NON-TRANSFERABLE

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00
ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE	
110.15	110.16	148.14	6-2	
SERIAL NO.	DATE	AMOUNT		
624-1535				

APPLICATION

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-40(73) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. 634

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

DATE: 3/25/75

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with appropriate resolution or ordinance, as described herein:

1. Legal description of property: Twp. 11N ; Range 7E ; Section 35 NE¼
   Block _____; Lot _____; Addition _____
   Street Address _____

2. Property Use: Residential _____ ☒ ; Commercial _____ ☐
   No. of Bedrooms 4 . Describe: 2100 sq. ft. living area all brick home
   Other Use _____ ☐
   Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒ ; Other ☐

4. Distance to public sewer: _____ ft.

Roger C. Patterson
Signature of Applicant (Owner or Lessee)

Rt # 3 Lincoln, Ne 68505
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 6/4/75 . Date Frwd. 6/4/75 . ACTION: Approved ☒ Disapproved ☐ Signature: Jerrold C. Wood

2. Supt. Bldg. Insp.: Date Rec'd. _____ . Date Frwd. _____ . ACTION: Approved ☐ Disapproved ☐ Signature: Chas D. Seale

3. City ~~or County~~ Engineer: Date Rec'd. 6-4-75 . Date Frwd. 6-4-75 . ACTION: Approved ☒ Disapproved ☐ Signature: [illegible]

REMARKS OR REASONS FOR DISAPPROVAL _____

White: Health Dept. Copy
Yellow: Engineers Copy
Pink: Bldg. Inspector's Copy

FORM HD-42(73) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM

City Ordinance No. 9150 [X]
County Resolution No. 2832 [ ]

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO._____

DATE: 3/25/75

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with appropriate Ordinance or Resolution, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 11N ; Range 7E ; Section 35 NE 1/4 ; Block ; Lot ; Addition .
   Street Address .

2. Property Use: Residential [X]; Commercial [ ]
   No. of Bedrooms 4
   Describe:
   Other Use
   Describe:

3. Type of Individual Sewage Disposal System: Septic Tank [X]; Other [ ]

4. Plans and Specifications of Proposed System. (See FORM HD-45(73) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-43(73) SOIL ABSORPTION TEST DATA REPORT, attached hereto).

Roger C. Patterson
Signature of Applicant (owner or lessee)

R.F.D # 3 Lincoln, Ne 68505
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd;
   Filing Fee: $ 30.00

2. Site Visits:
   Date: 9-19-75 by: jw
   Date: 9-24-75 by: jw
   Date: 9-25-75 by: jw

3. Date: Approved [X]; Disapproved [ ] 9/4/75
   by: Jerrold E. Hood

4. INSTALLATION FINAL WRITTEN APPROVAL
   Date: 9-25-75 by: James Wenneker

FORM HD- 43(73) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150 and County Resolution No. 2832)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 475-6221)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Location: Township _____; Range _____
Section & ¼ Sect. _____
Property Dimensions: ____ft. x ____ ft.
Area: _____acres. (Attach sketch of property showing hole location).
Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☐
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Owner: Patterson
Address _____

Dates of Tests: 3-22-75 to 3-23-75. Weather: Precip. 0 Temp. 40° F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36"	3/22	1 PM	3/23	4 PM	3/23	4 PM	12"	5 30	8"	30	1"	
2	"									10"		1/2	
3	"									9 5/8"		3/8	
4	"									9 5/8"		5/8	
5	"									10"		1/2	
6	"									8"		1	

Robert D Johnson
Signature of Person Conducting Test

Address 2618 no 3rd
Phone: 432-3595

Sum of Percolation Rates 4.25
Average of Rates: .71/30
Mean of Rates: _____

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. 44 min./inch
B. _____ min./inch
C. _____ min./inch

DATE: 3-25-75

James Weverka
Signature of Reviewing Official

FORM HD- 45(73) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM

(Annex to Application)
City Ordinance No. 9150 ☒
County Resolution No. 2832 ☐

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 475-6221)

FILE NO. _____

SPECIFICATIONS

DATE: _____


A. BUILDING SEWER:
1. Material transite; Diameter 4 in.
2. Distance above basement floor 4 in.; or below basement floor ___ in.
3. Distance between dwelling and septic tank 28 ft.
4. Number of clean-outs —.
5. Distances To:
Well or Suction Line ___ ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material Concrete; No. of compartments 1.
2. Capacity 1250 gals.; Liquid depth ___ in.
3. Factory Built: Yes ☒ (Company Omaha) No ☐
4. Manholes: Over Inlet; diam. 18 in.
Over Outlet; diam. 6 in.
Below Grade 36 in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☐
Depth of outlet below inlet ___ in.
7. Depth of top of tank below finished grade 36 in. riser to surface
8. Distances To:
Well or Suction Line ___ ft.;
Stream ___ ft.; Pressure Line ___ ft.;
Property Line ___ ft.


C. DISTRIBUTION BOX
1. Material concrete; No. available outlets 6.
2. Factory Built: Yes ☒, (Company Omaha) No ☐
3. Dimension: Length ___ in.; Width ___ in. Depth ___ in.
4. Distance from Septic Tank ___ ft.
5. Serial Distribution: Yes ☐, No ☐ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: perforated pipe trench
2. Lateral Lines: Depth below grade ___ in. Number ___; Length of each line ___ ft Total length of Laterals ~~378~~ 400 ft.; Slope 4 in/100 ft. Diameter of pipe 4 in.; Shape O
Material: concrete ☒; fiber asbestos ☒; clay ☐; other trenchite
Distance between lateral lines 18 ft.
3. Trench Dimensions: Depth 5' in.; Width ~~36~~ 16 in.
4. Filter Material: gravel.
Depth of material from trench bottom 12+ in.
5. Distances To:
Well or Suction Line ___ ft.;
Stream ___ ft.; Pressure Line ___ ft.
Property Line ___ ft.
6. Percolation Rate: 44 minutes/inch

TYPICAL SKETCHES

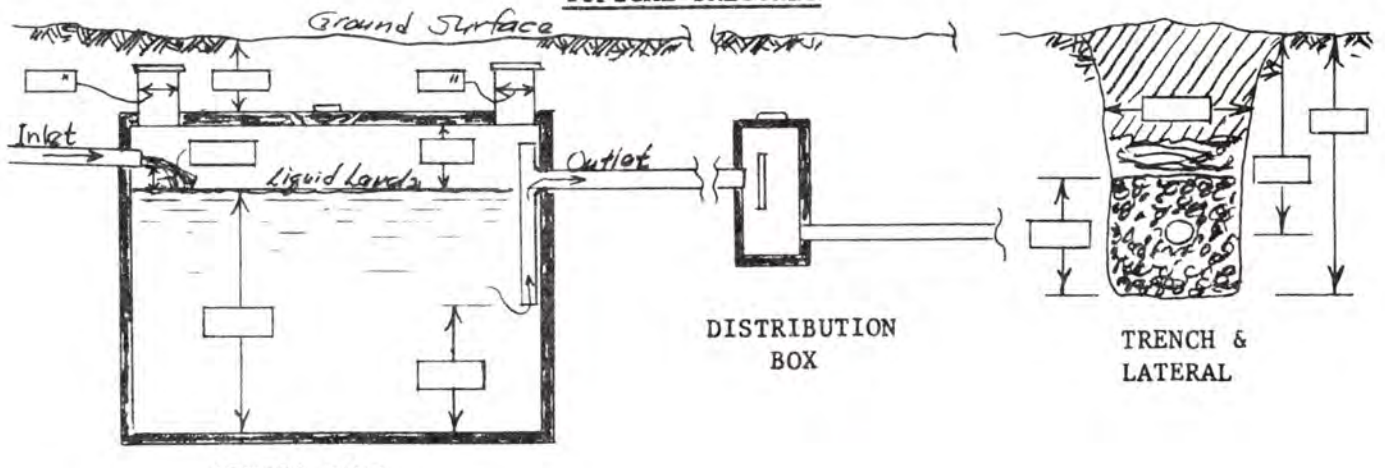

Signature of Applicant

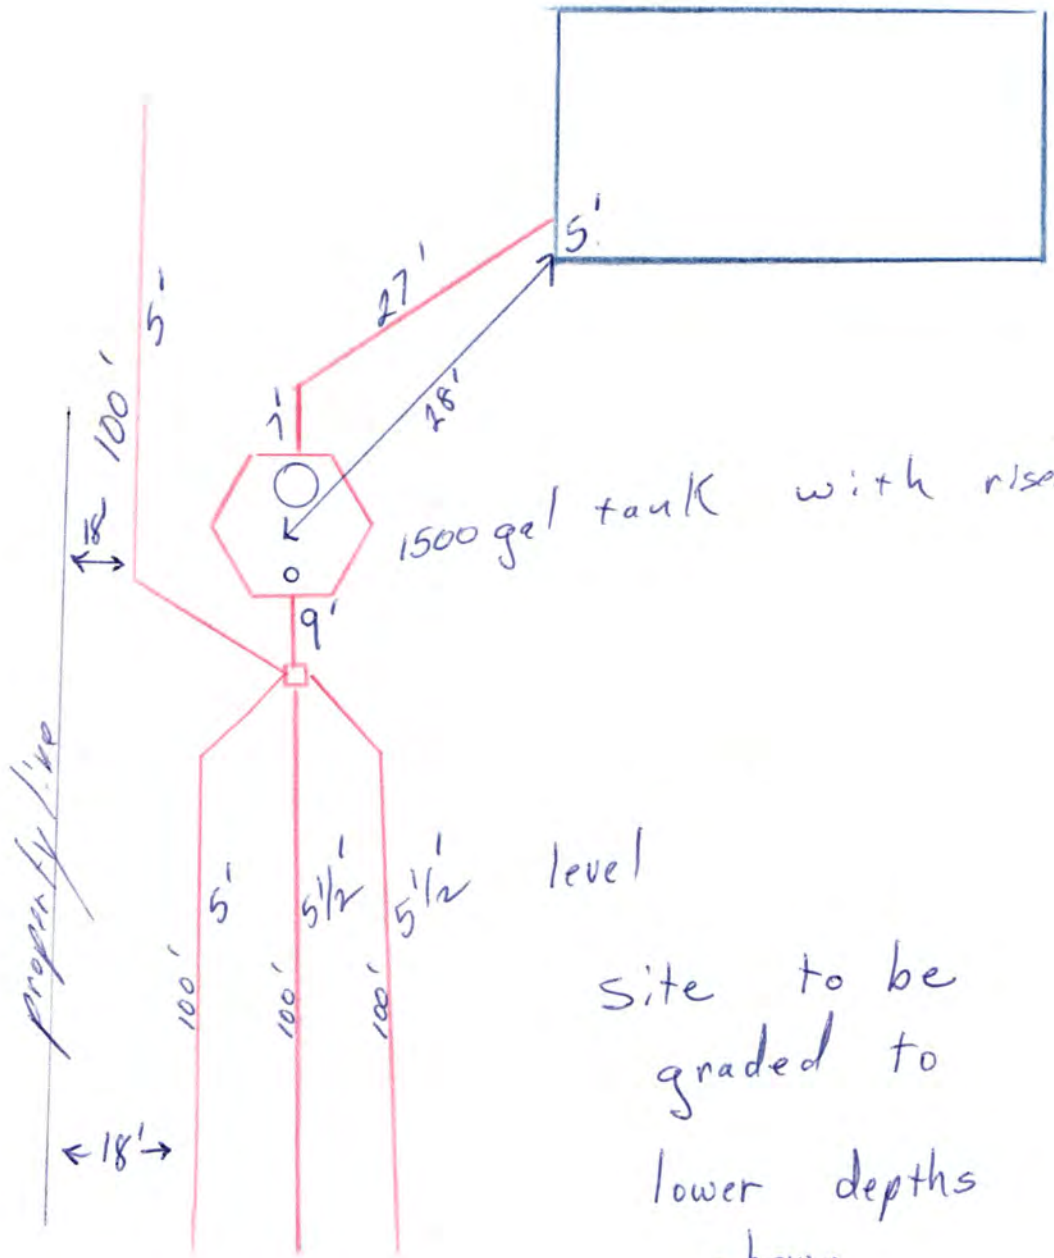
5'
27'
28'
1'
100'
5'
18'
1500 gal tank with riser
9'
property line
5'
5 1/2'
5 1/2'
100'
100'
100'
18'
level
site to be graded to lower depths shown
3' wide
N

INTER-DEPARTMENT COMMUNICATION

TO Charlie Seale

DEPARTMENT Building Inspections

ATTENTION

CARBONS TO

DATE June 4, 1975

FROM Jerrold C. Hood

DEPARTMENT Health

SUBJECT Individual Sewage System Construction - File No. 634
Roger C. Patterson, Route #3

The Application and plans have been reviewed and approved for the construction of an individual sewage disposal system on property legally described as:

T11N; R7E; Sec. 35-NE¼;

Jerrold C. Hood, R.S., Supervisor
County Sanitation Section
Division of Environmental Health

JCH: ch

SURVEY RECORD


LANCASTER County, Nebraska

OFFICE PH.: 466-3637
MOBIL PH.: 475-1506

Darrel W. Simonds & Associates, Inc.
ENGINEERS - LAND SURVEYORS
6900 Leighton Avenue -:- Lincoln, Nebraska 68507

Survey of A tract of land located in the Northeast Quarter of (More fully described on sheet 2) Section 35 T 11N, R 7E of 6th P.M.

Survey No. _____ **(To be assigned by Co. Surveyor) Date** Jan. 1975 **Weather** Fair

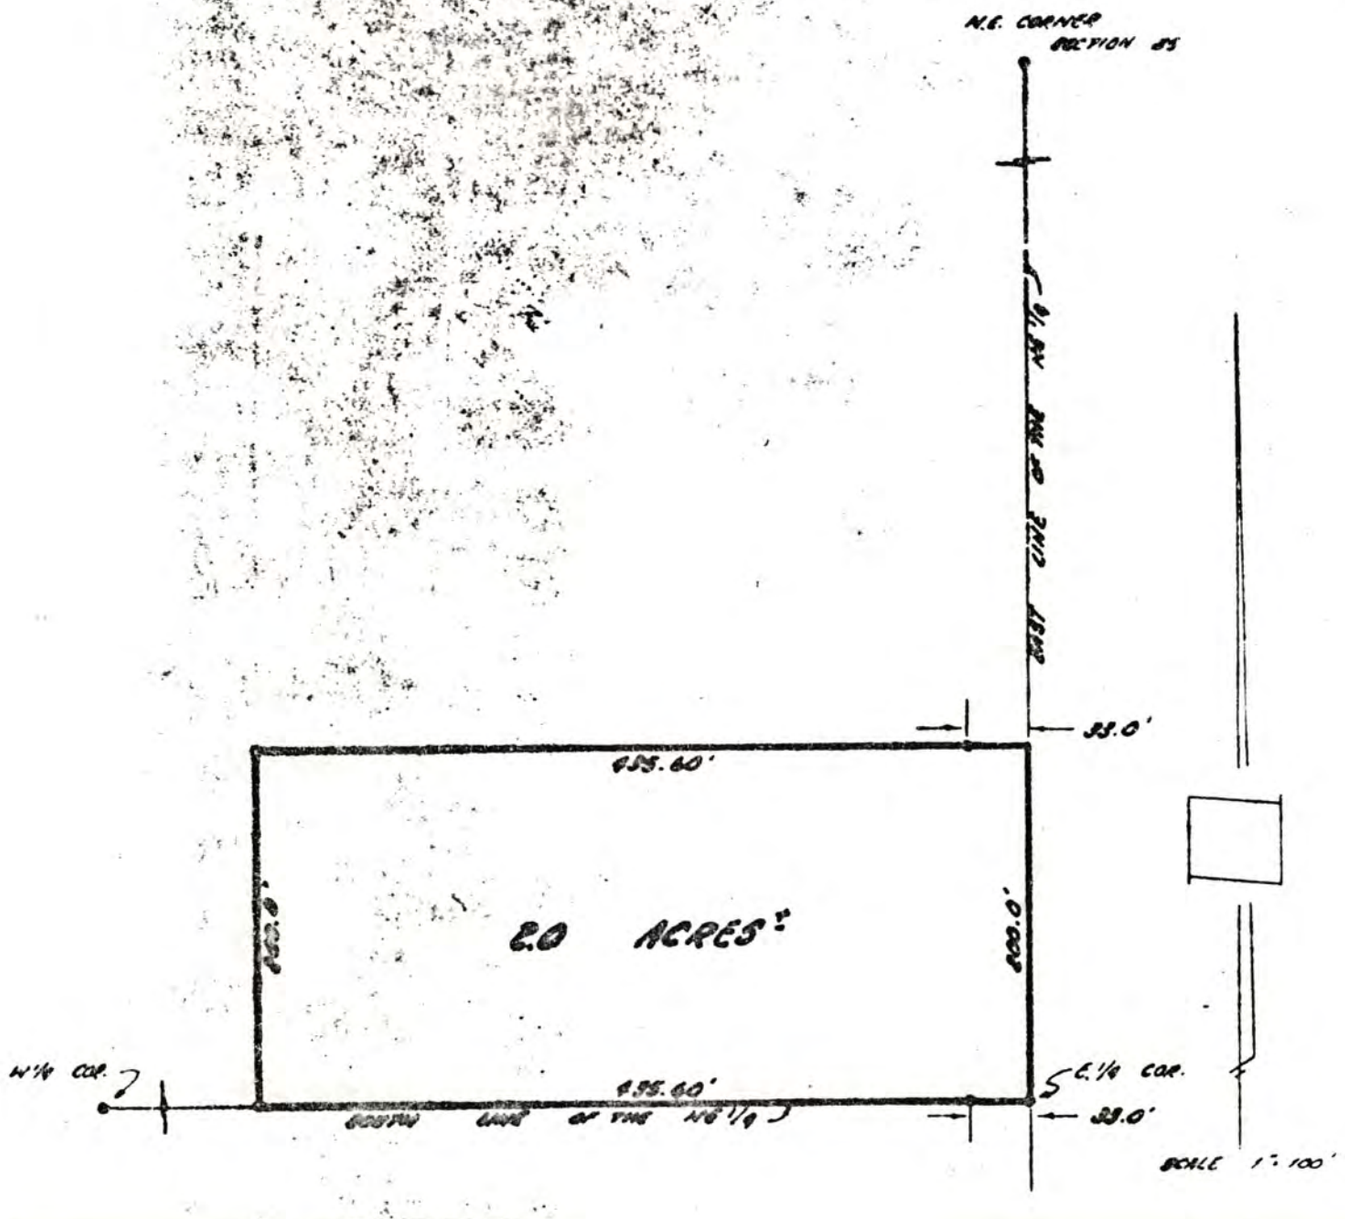

LINCOLN, NEBRASKA

SURVEYORS CERTIFICATE

I hereby certify that I have accurately surveyed the property in the above plat. Iron Bars were set at points marked ○. All dimensions are in feet and deci mals of a foot.

● = MONUMENTS FOUND

Hewlett-Packard Distance Measuring Instrument used.

Signed this 9th day of January 1975

Name Darrel W. Simonds

DARREL W. SIMONDS

Surveyor's License: NEBR. L.S. 161
IOWA L.S. 4967

SURVEY RECORD

LANCASTER County, Nebraska
Darrel W. Simonds & Associates, Inc.
ENGINEERS - LAND SURVEYORS
6900 Leighton Avenue -:- Lincoln, Nebraska 68507
OFFICE PH.: 466-3637
MOBIL PH.: 475-1506

Survey of A tract of land located in the Northeast Quarter of (more fully described below) Section 35 T 11 N. R 7 E of 6th P. M.

Survey No. _____ **(To be assigned by Co. Surveyor) Date** Jan 19 75 **Weather** Fair

LEGAL DESCRIPTION:

Beginning at the East One-Quarter corner of Section 35, Township 11 North, Range 7 East of the 6th P.M. Lancaster County, Nebraska, thence in a Westerly direction along the South line of the Northeast Quarter of said Section 35 a distance of Four Hundred Thirty-Five and Six Tenths (435.6) feet, thence in a Northerly direction parallel to and Four Hundred Thirty-Five and Six Tenths (435.6) feet Westerly of the East line of said Northeast Quarter a distance of Two Hundred and No Tenths (200.0) feet; thence in an Easterly direction parallel to and Two Hundred and No Tenths (200.0) feet Northerly of the South line of said Northeast Quarter a distance of Four Hundred Thirty-Five and Six Tenths (435.6) feet to a point on the East line of said Northeast Quarter, thence in a Southerly direction along the East line of said Northeast Quarter a distance of Two Hundred and No Tenths (200.0) feet to the East One-Quarter corner of Section 35 and the point of beginning and containing a calculated area of 2.00 Acres more or less.

NEBRASKA REGISTERED

Signed this 9th day of January 19 75

Name _____
DARREL W. SIMONDS

Surveyor's License: NEBR. L.S. 161
IOWA L.S. 4967

006

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT

2200 St Marys Avenue Phone (402) 471-~~7800~~ 8000 Lincoln, Nebraska 68502

REAL ESTATE TRANSFER / LOAN APPROVAL

This form must be completed and returned to request a real estate transfer inspection.

MAKE CHECKS PAYABLE TO: Lincoln-Lancaster County Health Department.

☒ Evaluation of the Individual Water System Date: 11-12-93

☒ Evaluation of the Sewage Disposal System ☒ Enclosed is $150.00

Legal Description of Property: TWP. 11N; RANGE 7E; SECTION 35; BLOCK ___

LOT 21; ADDITION _____; Street Address 6701 N 98th, Lincoln, NE

Directions to Property _____

Location of Well _____ Tap Location: Inside ☐ Outside ☐

Location of Sewage System _____ Year Installed ____

	NAME	ADDRESS	PHONE
Present Owner:	Roger & Dianne Patterson	6701 N 98th, Lincoln	466-0535
~~Tenant/Buyer:~~	_____	Dianne (W)	479-2300
Return to:	Security Federal	P.O. Box 80009; Lincoln 68501	474-4444

NOTE: Allow two weeks for processing. Incomplete information will delay processing.

Signature of Applicant Christy Weinhardt Address Security Federal

==========

HEALTH DEPARTMENT USE ONLY * Please RUSH

Date Received 11/15/93 Received $150.00 Check ☑ Cash ☐ #49137

PRELIMINARY STATUS--DATE 11-16-93

WATER SYSTEM:	Approved	Disapproved	SEWAGE SYSTEM:		SITE VISIT:
Construction	☒	☐	Approved:	☒	Date 11-16-93 by rm
Bacteria	☒	☐	Provisional:	☐	Date _____ by ____
Nitrate	☒ 2.1	☐	Disapproved:	☐	Date _____ by ____

Comments: Recommend not allowing livestock over subsurface disposal field. Recommend checking to see if septic tank needs pumping.

See Attached Letter ☐

FINAL STATUS

WATER SYSTEM:	SEWAGE DISPOSAL SYSTEM:	
Approved: ☒	Approved: ☒	Provisional Approval: ☐

APPROVED BY Ron Magnuson, RS DATE 11-23-93

Approval or disapproval is based on written standards for construction, location and water quality. Inspection is based on visible construction and operation at the time of inspection. Approval or provisional approval does not imply or express a guarantee of system operation. WELLS - Nebraska Safe Drinking Water Act,
- Standards for A Private Well in Nebraska

FG.4120 INDIVIDUAL SEWAGE SYSTEMS - County Resolution #2832

283