CITY OF LINCOLN NEBRASKA

DEPARTMENT OF LICENSES AND PERMITS

FILE NO. 230

INDIVIDUAL SEWAGE SYSTEM CONSTRUCTION
TYPE OF LICENSE OR PERMIT

April 28, 1972
THIS LICENSE OR PERMIT EXPIRES

Gerald B. Lewis — Route #6 Lincoln
LICENSEE OR PERMITTEE — ADDRESS

T10N; Range 6E; Section N.E. 1/4 of 30; Bl. 1,2,15,16
NAME OF ESTABLISHMENT, IF ANY — ADDRESS

LEGAL DESCRIPTION

REMARKS: Non-Transferable

PERMIT	INSPECTION FEE	OCCUPATION TAX	LICENSE	TOTAL
$ 30.00	$	$	$	$ 30.00

ACCOUNTING NO.	ACCOUNTING NO.	ACCOUNTING NO.	CODE
624 110.15 ~~1535~~	110.16	148.14	6-2

SERIAL NO.	DATE	AMOUNT

VALID RECEIPT ONLY IF MACHINE RECEIPTED IN THIS SPACE

APPLICATION

THIS LICENSE OR PERMIT IS ISSUED SUBJECT TO REVOCATION AS PROVIDED BY LAW

FORM HD-30(67) REQUEST FOR SITE CLEARANCE FOR INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 230

TO: Division of Environmental Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby requests SITE CLEARANCE to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described herein:

1. Legal description of property: Twp. 10N; Range 6E; Section N.E¼-30
Block 1-2-15-16 Lot _____; Addition _____;
Street Address RT-6.

2. Property Use: Residential _____ ☐; Commercial _____ ☒
No. of Bedrooms _____. Describe: Truck-Sales & Service.

Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Distance to public sewer: 5500 ft.

Gerald B. Lewis
Signature of Applicant (owner or lessee)

Rt. 6 Lincoln
Address

(Do not write below this double line)

REVIEWING ACTION

1. Health Department: Date Rec'd. 10/28/71. Date Frwd. 10/28/71. ACTION: Approved ☐ Disapproved ☒ Signature: Gerald E. Hoob

2. Supt. Bldg. Insp.: Date Rec'd. 10/28/71. Date Frwd. 10/28/71. ACTION: Approved ☐ Disapproved ☒ Signature: Chas. Seal By Bob Skinner

3. City Engineer: Date Rec'd. 10-28-71. Date Frwd. _____. ACTION: Approved ☐ Disapproved ☒ Signature: J. T. Blessing

REMARKS OR REASONS FOR DISAPPROVAL _____

FINAL ACTION ON SITE CLEARANCE: Approved ☐ Disapproved ☐

Date Applicant Notified: _____ Signature _____

FORM HD-32(67) APPLICATION FOR PERMIT TO CONSTRUCT INDIVIDUAL SEWAGE DISPOSAL SYSTEM
City Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 230

DATE: _____

TO: Director of Health
Lincoln-Lancaster County Health Dept.

The undersigned hereby applies for a permit to construct an Individual Sewage Disposal System in conformance with Lincoln City Ordinance No. 9150, as described in this application and the annexed forms attached hereto.

1. Legal description of property: Twp. 10 N.; Range 6E; Section NE¼ 30
Block 1-2-15-16 Lot _____; Addition _____;
Street Address RT. 6.

2. Property Use: Residential _____ ☐; Commercial _____ ☒
No. of Bed Rooms _____ Describe: Truck - Sales & Service.
Other Use _____ ☐
Describe: _____

3. Type of Individual Sewage Disposal System: Septic Tank ☒; Other ☐

4. Plans and Specifications of Proposed System. (See FORM HD-32a(67) PLANS & SPECIFICATIONS, SEWAGE DISPOSAL SYSTEM, attached hereto.)

5. Soil Absorption Properties. (See FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT, attached hereto.)

Gerald B. Lewis
Signature of Applicant (owner or lessee)

Rt. 6 Lincoln
Address

(Do not write below double line)

REVIEWING ACTION

1. Date Rec'd: _____
Filing Fee: $ 30.00

2. Date Site Clearance _____

3. Site Visits:
Date: _____ by: [illegible]
Date: 12/16/71 by: L.L.D.
Date: _____ by: _____

4. Date: Approved ☒; Disapproved ☐: 10/28/71
by: Jerrold C. Hood

5. BUREAU OF LICENSES & PERMITS
Date Notified: _____
Date Issued: _____ Serial _____

6. INSTALLATION FINAL WRITTEN APPROVAL
Date: 12/20/71 by: Jerrold C. Hood

FORM HD-33(67) SOIL ABSORPTION TEST DATA REPORT
(Annex to Application)
(Reference: City Ordinance No. 9150)

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone 432-7611)

FILE NO. _____

PROPERTY WHERE SOIL TESTED:
Location: Township 10 N
Section & ¼ Sect. NE ¼-30
Property Dimensions: 629 ft. x 1254 ft.
Area: 20 acres. (Attach sketch of property showing hole location).

Owner: Gerald B. Lewis
Address Rt. 6 Lincoln

Soil Type: Silty Clay ☐; Silty Clay Loam ☐; Sandy Loam ☑
Silty Loam ☐; Clay Loam ☐; Sandy Clay ☐

Dates of Tests: 10-2-71 to 10-30-71. Weather: Precip. FAIR Temp. ___ F.

PERCOLATION TEST DATA TABLE

a.	b.	c.	d.	e.	f.	g.	h.	i.	j.	k.	l.	m.	n.
		Pre-Saturation Period				Percolation Readings					Results		
		Start		End		Start			End				
Hole No.	Hole Depth (in.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Date (Mo. Day)	Time (Hr. Min.)	Water Level (in.)	Time (Hr. Min.)	Water Level (in.)	Elapsed Time (Min.)	Water Level Drop (in.)	Percolation Rates (Min./inch)
1	36"	10-2	9:30 AM	10/3	10 AM	10-3	10 AM	12"					
2	"	"	"	"	"	"	"	12"					
3	"	"	"	"	"	"	"	12"					
4	"	"	"	"	"	"	"	12"					
5	"	"	"	"	"	"	"	12"					
6	"	"	"	"	"	"	"	12"					
					"	"	"	12"					

Sum of Percolation Rates _____
Average of Rates: _____
Mean of Rates: _____

_____
Signature of Person Conducting Test

Address _____
Phone: _____

(Do not write below this line)

REVIEWING ACTION

REMARKS: _____

Approved Percolation Rate(s)
A. _____ min./inch
B. _____ min./inch
C. _____ min./inch

DATE: _____

_____
Signature of Reviewing Official

9:30 A.M.

Oct. 2nd 1971

6 - holes - 7" Dia - 36" Deep.

Filled 6" of top with 6" gravel in bottom.

Oct 3rd, 10:00 A.M. holes empty.

Filled 12" from top.

	11:00	12:00	1:00	2:00	
No 1 -	17½"	23¾"	28¼"	5¼	EMPTY.
No 2	18"	24"	28"	4	"
No 3	17¾"	23¾"	28"	4¼	"
No 4	17¾"	24"	28¼"	4¼	"
No 5	17¼"	23½	27¾"	4¼	"
No 6.	17"	23½"	27¾	4¼	"

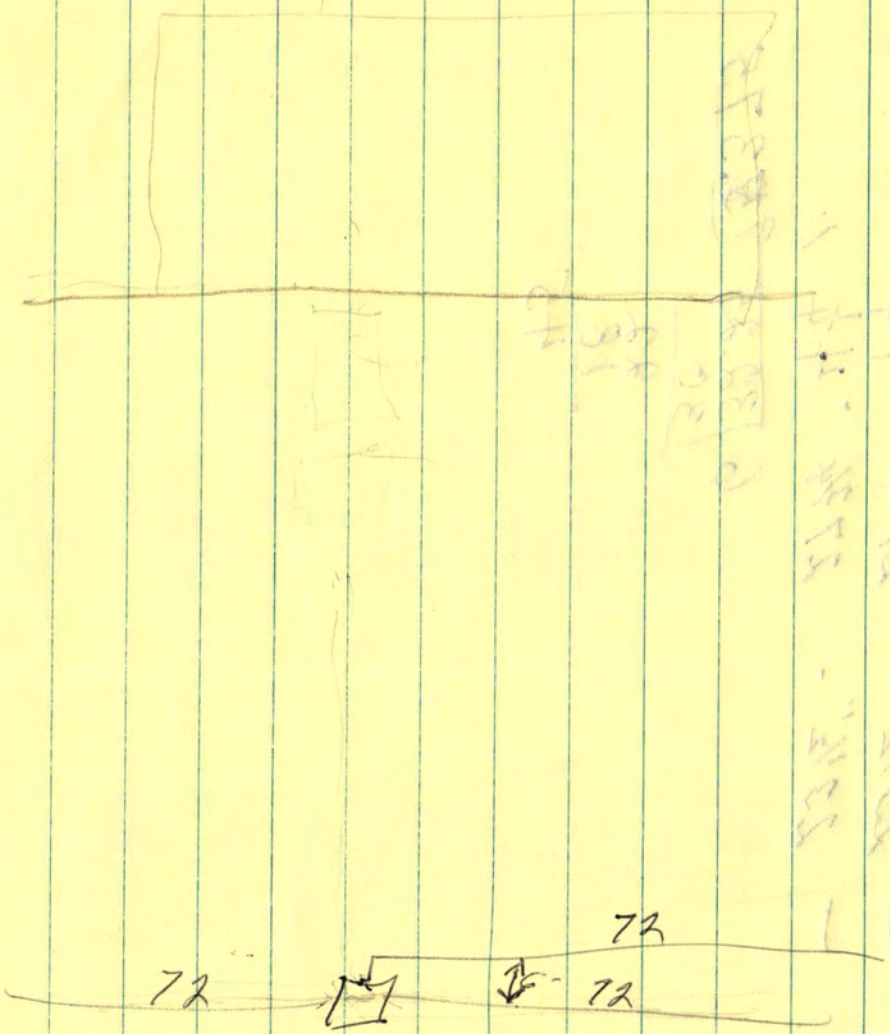
$$6 \overline{)32.25} \quad \$5.375$$

30

22

18

45


72
72
72

FORM HD-32a(67) PLANS & SPECIFICATIONS
SEWAGE DISPOSAL SYSTEM
(Annex to Application)
Ordinance No. 9150

LINCOLN-LANCASTER COUNTY HEALTH DEPARTMENT
Division of Environmental Health
2200 St. Marys Avenue
Lincoln, Nebraska 68502 (Phone: 432-7611)

FILE NO. 230

SPECIFICATIONS

DATE: _____

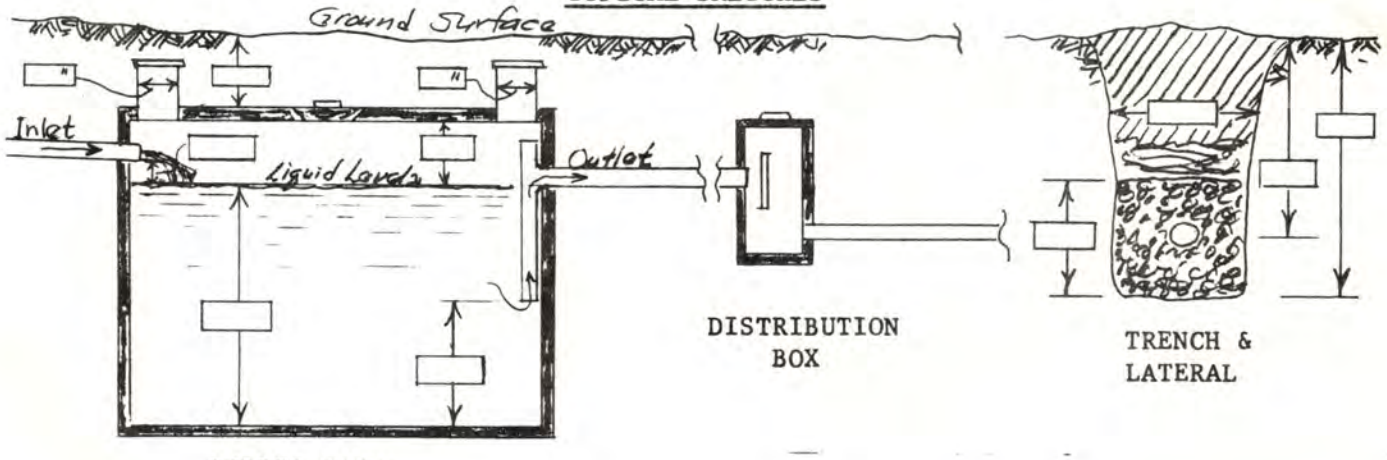
A. BUILDING SEWER:
1. Material CAST IRON; Diameter 4 in.
2. Distance above basement floor ___in.; or below basement floor ___in.
3. Distance between dwelling and septic tank 15 ft.
4. Number of clean-outs _____.
5. Distances To:
Well or Suction Line 105 ft.;
Stream ___ft.; Pressure Line 105 ft.;
Property Line 300 ft.

B. SEPTIC TANK (Provide construction drawings.)
1. Material CON; No. of compartments 1.
2. Capacity 1500 gals.; Liquid depth 47 in.
3. Factory Built: Yes ☒ (Company PRECAST STEP) No ☐
4. Manholes: Over Inlet; diam. 8 in.
Over Outlet; diam. 8 in.
Below Grade _____in.
5. Inlet: Baffle ☐; or Tee ☐
6. Outlet: Baffle ☐; or Tee ☒
Depth of outlet below inlet ___in.
7. Depth of top of tank below finished grade ___in.
8. Distances To:
Well or Suction Line 105 ft.;
Stream ___ft.; Pressure Line ___ft.;
Property Line ___ft.

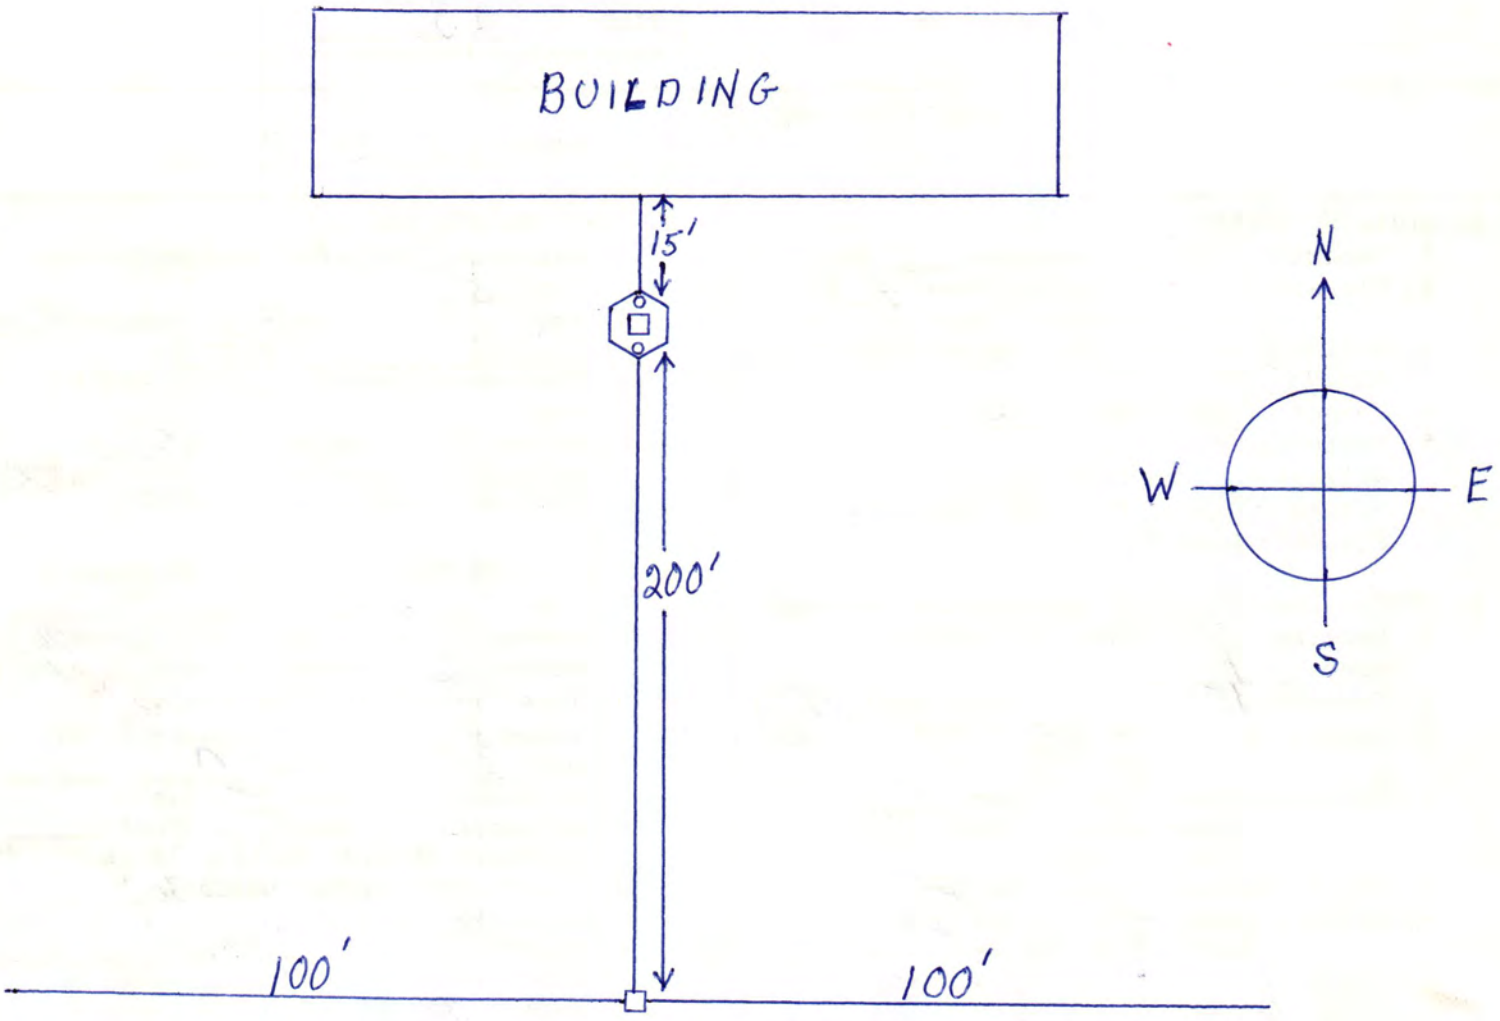
C. DISTRIBUTION BOX
1. Material CON; No. available outlets 5.
2. Factory Built: Yes ☒, (Company PRE-CAST STEP No ☐
3. Dimension: Length ___in.; Width ___in. Depth ___in.
4. Distance from Septic Tank 200 ft.
5. Serial Distribution: Yes ☐, No ☒ (If yes, show detailed plans.)

D. ABSORPTION FIELD: (Provide drawings.)
1. Type: CONCRETE HALF MOON
2. Lateral Lines: Depth below grade 36 in.
Number 2; Length of each line 100 ft
Total length of Laterals 200 ft.;
Slope 4 in/100 ft. Diameter of pipe 24 in.; Shape ∩
Material: concrete ☒; fiber asbestos ☐; clay ☐; other _____
Distance between lateral lines ___ft.
3. Trench Dimensions: Depth 36 in.; Width 48 in.
4. Filter Material: GRAVEL.
Depth of material from trench bottom ___in.
5. Distances To:
Well or Suction Line 305 ft.;
Stream ___ft.; Pressure Line ___ft.
Property Line ___ft.
6. Percolation Rate: _____minutes/inch

TYPICAL SKETCHES



Signature of Applicant


BUILDING
15'
200'
100'
100'
N
W
E
S